


OIL ANALYSIS REPORT

Sample Rating Trend



ISO

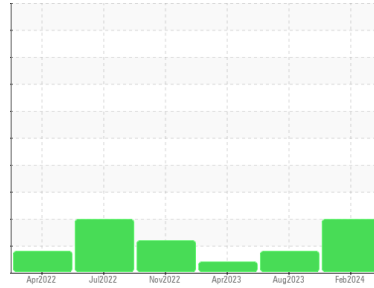

Area
COMPRESSOR STATIONS/RED HILLS WEST AREA

Machine Id
BODACIOUS (S/N 5629X3109)

Component
Compressor

Fluid
TULCO LUBSOIL LPG WS 150 (--- GAL)

DIAGNOSIS

Recommendation

We recommend you service the filters on this component. Resample at the next service interval to monitor.

Wear

All component wear rates are normal.

Contamination

There is a high amount of particulates present in the oil.

Fluid Condition

The AN level is acceptable for this fluid. The condition of the oil is suitable for further service.

SAMPLE INFORMATION	method	limit/base	current	history1	history2
Sample Number	Client Info		TO60002029	TO60001268	TO60000809
Sample Date	Client Info		06 Feb 2024	10 Aug 2023	13 Apr 2023
Machine Age	hrs	Client Info	31951	27736	25818
Oil Age	hrs	Client Info	0	2000	3487
Oil Changed	Client Info		N/A	Not Changd	N/A
Sample Status			ABNORMAL	ATTENTION	ABNORMAL

WEAR METALS	method	limit/base	current	history1	history2
Iron	ppm	ASTM D5185m >50	5	<1	0
Chromium	ppm	ASTM D5185m >10	<1	0	<1
Nickel	ppm	ASTM D5185m	0	<1	<1
Titanium	ppm	ASTM D5185m	0	0	0
Silver	ppm	ASTM D5185m	0	0	0
Aluminum	ppm	ASTM D5185m >25	2	<1	0
Lead	ppm	ASTM D5185m >25	0	0	0
Copper	ppm	ASTM D5185m >50	0	<1	0
Tin	ppm	ASTM D5185m >15	0	<1	<1
Vanadium	ppm	ASTM D5185m	0	0	0
Cadmium	ppm	ASTM D5185m	0	0	0

ADDITIVES	method	limit/base	current	history1	history2
Boron	ppm	ASTM D5185m 0	0	0	0
Barium	ppm	ASTM D5185m 0	8	0	0
Molybdenum	ppm	ASTM D5185m 0	0	0	0
Manganese	ppm	ASTM D5185m	0	<1	0
Magnesium	ppm	ASTM D5185m 0	<1	1	<1
Calcium	ppm	ASTM D5185m 0	<1	0	<1
Phosphorus	ppm	ASTM D5185m 0	25	3	5
Zinc	ppm	ASTM D5185m 0	0	0	0
Sulfur	ppm	ASTM D5185m 0	147	112	127


CONTAMINANTS	method	limit/base	current	history1	history2
Silicon	ppm	ASTM D5185m >25	0	<1	1
Sodium	ppm	ASTM D5185m	2	1	3
Potassium	ppm	ASTM D5185m >20	1	2	<1
Water	%	ASTM D6304 >2.26	0.218	0.545	0.330
ppm Water	ppm	ASTM D6304 >22600	2184	5454.0	3300

FLUID CLEANLINESS	method	limit/base	current	history1	history2
Particles >4µm	ASTM D7647	>10000	▲ 39978	4865	---
Particles >6µm	ASTM D7647	>1300	▲ 16070	● 1613	---
Particles >14µm	ASTM D7647	>320	▲ 1536	91	---
Particles >21µm	ASTM D7647	>80	▲ 322	14	---
Particles >38µm	ASTM D7647	>20	2	1	---
Particles >71µm	ASTM D7647	>4	0	0	---
Oil Cleanliness	ISO 4406 (c)	>20/17/15	▲ 22/21/18	● 19/18/14	---


FLUID DEGRADATION	method	limit/base	current	history1	history2
Acid Number (AN)	mg KOH/g	ASTM D8045	0.093	0.22	0.20

OIL ANALYSIS REPORT


▲ Particle Trend

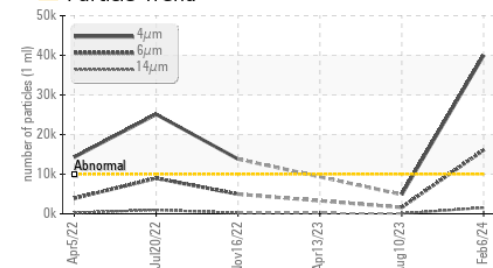


Water (KF)

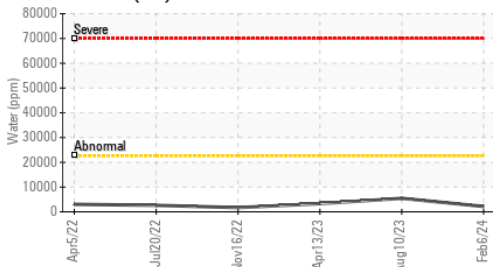


Viscosity @ 100°C

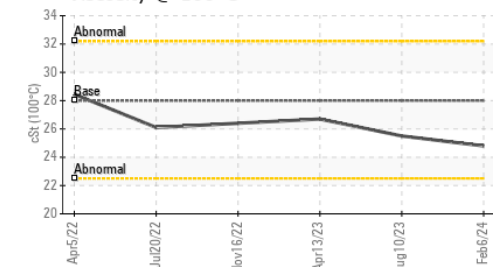

Water (KF)

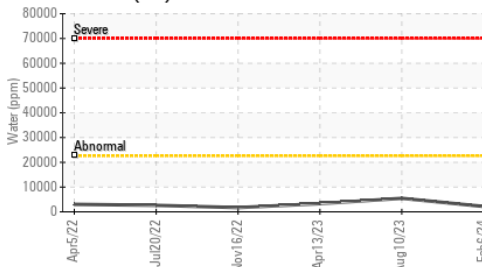

Viscosity @ 100°C

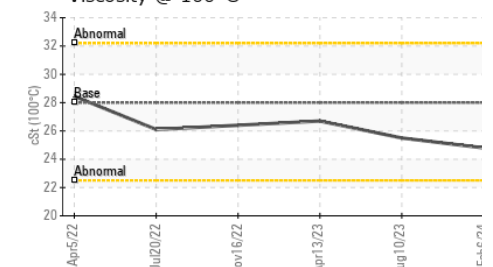

PARAMETER	method	limit/base	current	history1	history2
White Metal	scalar	*Visual	NONE	NONE	NONE
Yellow Metal	scalar	*Visual	NONE	NONE	NONE
Precipitate	scalar	*Visual	NONE	NONE	NONE
Silt	scalar	*Visual	NONE	NONE	NONE
Debris	scalar	*Visual	NONE	NONE	▲ MODER
Sand/Dirt	scalar	*Visual	NONE	NONE	NONE
Appearance	scalar	*Visual	NORML	NORML	NORML
Odor	scalar	*Visual	NORML	NORML	NORML
Emulsified Water	scalar	*Visual	>2.26	NEG	NEG
Free Water	scalar	*Visual		NEG	NEG

PARAMETER	method	limit/base	current	history1	history2
Visc @ 40°C	cSt	ASTM D445	151	145	157
Visc @ 100°C	cSt	ASTM D445	28	25.5	26.7
Viscosity Index (VI)	Scale	ASTM D2270	224	211	207

SAMPLE IMAGES

Color




Bottom




GRAPHS


Ferrous Alloys

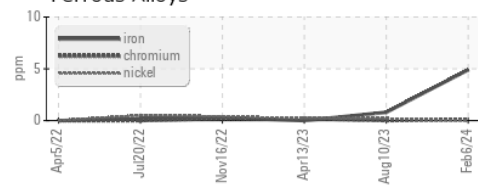


Non-ferrous Metals

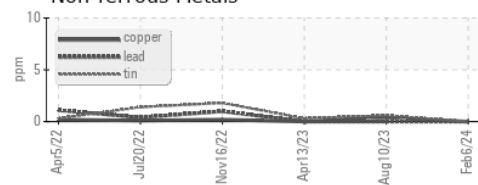


Viscosity @ 40°C

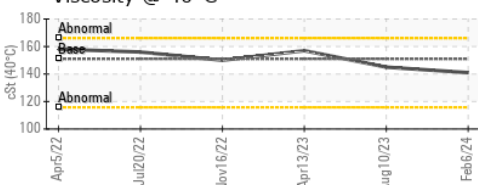

▲ Particle Count

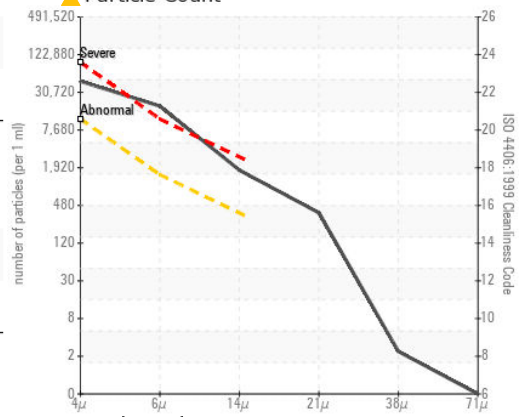

Acid Number

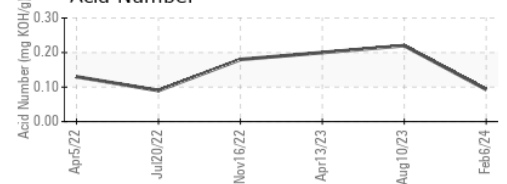

Certificate L2367

Laboratory : WearCheck USA - 501 Madison Ave., Cary, NC 27513
Sample No. : TO60002029 **Received** : 26 Feb 2024
Lab Number : 06100922 **Tested** : 27 Feb 2024
Unique Number : 10899152 **Diagnosed** : 28 Feb 2024 - Don Baldrige
Test Package : IND 2 (Additional Tests: KF, KV100, PrtCount, VI)

MIDLAND - EOG RESOURCES INC.
 5509 CHAMPIONS DRIVE
 MIDLAND, TX
 US 79706
 Contact: HERMAN GARZA
 herman_garza@eogresources.com
 T: (432)686-3600
 F:

To discuss this sample report, contact Customer Service at 1-800-237-1369.

* - Denotes test methods that are outside of the ISO 17025 scope of accreditation.

Statements of conformity to specifications are based on the simple acceptance decision rule (JCGM 106:2012)