


OIL ANALYSIS REPORT

Sample Rating Trend



ISO

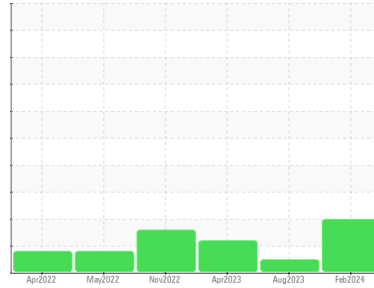

Area
COMPRESSOR STATIONS/RED HILLS WEST AREA

Machine Id
VALOR (S/N 5629X2172)

Component
Compressor

Fluid
TULCO LUBSOIL LPG WS 150 (--- GAL)

DIAGNOSIS

Recommendation

We recommend you service the filters on this component. Resample at the next service interval to monitor.

Wear

All component wear rates are normal.

Contamination

There is a high amount of particulates present in the oil.

Fluid Condition

The AN level is acceptable for this fluid. The condition of the oil is suitable for further service.

SAMPLE INFORMATION

method	limit/base	current	history1	history2
Sample Number	Client Info	TO60002026	TO60001214	TO60000806
Sample Date	Client Info	06 Feb 2024	10 Aug 2023	13 Apr 2023
Machine Age	hrs	37750	33716	30920
Oil Age	hrs	0	3114	27454
Oil Changed	Client Info	N/A	N/A	Not Changd
Sample Status		ABNORMAL	NORMAL	ABNORMAL

WEAR METALS

method	limit/base	current	history1	history2	
Iron	ppm	ASTM D5185m >50	2	6	37
Chromium	ppm	ASTM D5185m >10	<1	0	<1
Nickel	ppm	ASTM D5185m	0	<1	<1
Titanium	ppm	ASTM D5185m	0	0	0
Silver	ppm	ASTM D5185m	0	0	<1
Aluminum	ppm	ASTM D5185m >25	2	<1	0
Lead	ppm	ASTM D5185m >25	0	0	0
Copper	ppm	ASTM D5185m >50	0	<1	0
Tin	ppm	ASTM D5185m >15	0	<1	<1
Vanadium	ppm	ASTM D5185m	0	0	<1
Cadmium	ppm	ASTM D5185m	0	0	<1

ADDITIVES

method	limit/base	current	history1	history2	
Boron	ppm	ASTM D5185m 0	0	0	1
Barium	ppm	ASTM D5185m 0	8	0	1
Molybdenum	ppm	ASTM D5185m 0	0	0	0
Manganese	ppm	ASTM D5185m	0	<1	<1
Magnesium	ppm	ASTM D5185m 0	<1	2	3
Calcium	ppm	ASTM D5185m 0	2	0	2
Phosphorus	ppm	ASTM D5185m 0	127	19	52
Zinc	ppm	ASTM D5185m 0	0	0	18
Sulfur	ppm	ASTM D5185m 0	1316	377	1067

CONTAMINANTS

method	limit/base	current	history1	history2	
Silicon	ppm	ASTM D5185m >25	0	<1	<1
Sodium	ppm	ASTM D5185m	10	10	28
Potassium	ppm	ASTM D5185m >20	2	2	3
Water	%	ASTM D6304 >2.26	0.959	2.232	0.936
ppm Water	ppm	ASTM D6304 >22600	9598	22327.2	9360

FLUID CLEANLINESS


method	limit/base	current	history1	history2
Particles >4µm	ASTM D7647 >10000	▲ 34763	3201	▲ 31195
Particles >6µm	ASTM D7647 >1300	▲ 14462	817	● 2193
Particles >14µm	ASTM D7647 >320	▲ 1290	70	108
Particles >21µm	ASTM D7647 >80	▲ 183	20	27
Particles >38µm	ASTM D7647 >20	2	2	2
Particles >71µm	ASTM D7647 >4	1	1	1
Oil Cleanliness	ISO 4406 (c) >20/17/15	▲ 22/21/17	19/17/13	▲ 22/18/14

FLUID DEGRADATION


method	limit/base	current	history1	history2	
Acid Number (AN)	mg KOH/g	ASTM D8045	0.75	0.40	0.50

OIL ANALYSIS REPORT


▲ Particle Trend

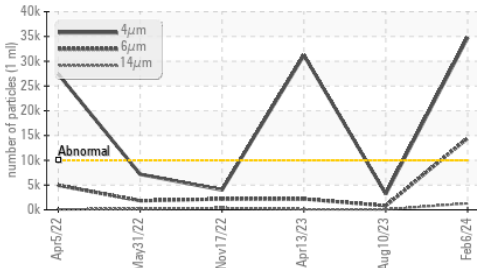


Water (KF)

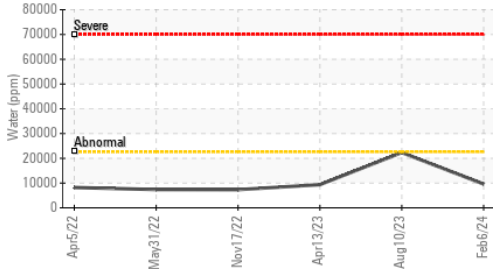


Viscosity @ 100°C

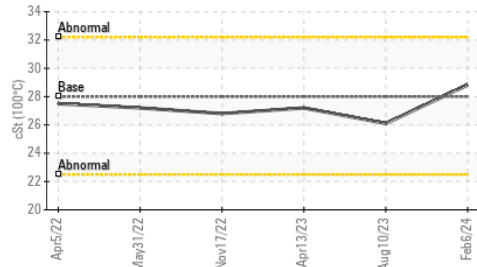

Water (KF)

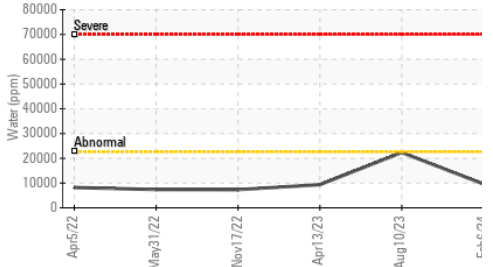

Viscosity @ 100°C

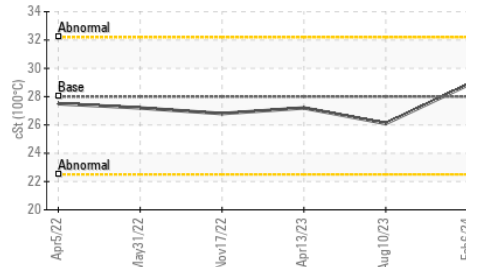

VISUAL	method	limit/base	current	history1	history2
White Metal	scalar	*Visual	NONE	NONE	NONE
Yellow Metal	scalar	*Visual	NONE	NONE	NONE
Precipitate	scalar	*Visual	NONE	NONE	NONE
Silt	scalar	*Visual	NONE	NONE	NONE
Debris	scalar	*Visual	NONE	NONE	NONE
Sand/Dirt	scalar	*Visual	NONE	NONE	NONE
Appearance	scalar	*Visual	NORML	NORML	NORML
Odor	scalar	*Visual	NORML	NORML	NORML
Emulsified Water	scalar	*Visual	>2.26	NEG	NEG
Free Water	scalar	*Visual		NEG	NEG

FLUID PROPERTIES	method	limit/base	current	history1	history2
Visc @ 40°C	cSt	ASTM D445	151	151	159
Visc @ 100°C	cSt	ASTM D445	28	26.1	27.2
Viscosity Index (VI)	Scale	ASTM D2270	224	209	209

SAMPLE IMAGES	method	limit/base	current	history1	history2
---------------	--------	------------	---------	----------	----------

Color




Bottom




GRAPHS


Ferrous Alloys

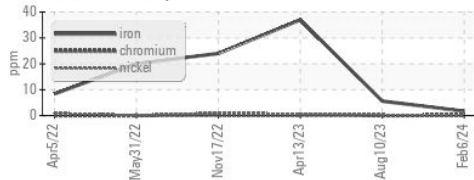


Non-ferrous Metals

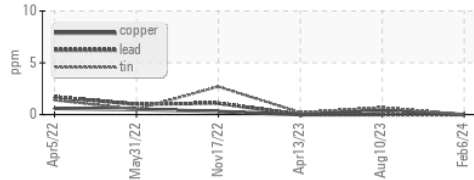


Viscosity @ 40°C

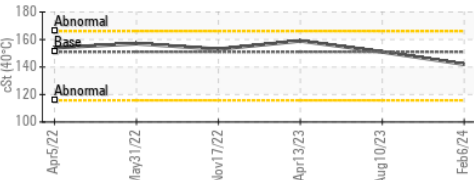

▲ Particle Count

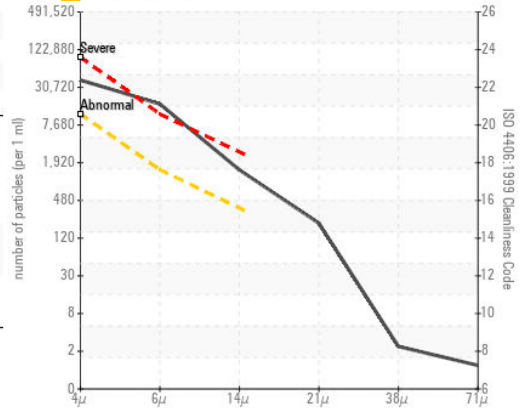

Acid Number

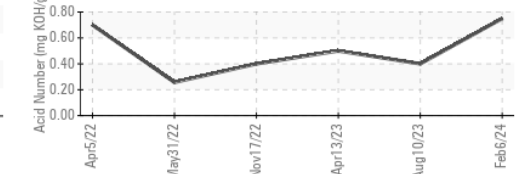

Certificate L2367

Laboratory : WearCheck USA - 501 Madison Ave., Cary, NC 27513
Sample No. : TO60002026 **Received** : 26 Feb 2024
Lab Number : 06100924 **Tested** : 01 Mar 2024
Unique Number : 10899154 **Diagnosed** : 01 Mar 2024 - Don Baldrige
Test Package : IND 2 (Additional Tests: KF, KV100, PrtCount, VI)

To discuss this sample report, contact Customer Service at 1-800-237-1369.

* - Denotes test methods that are outside of the ISO 17025 scope of accreditation.

Statements of conformity to specifications are based on the simple acceptance decision rule (JCGM 106:2012)

MIDLAND - EOG RESOURCES INC.
 5509 CHAMPIONS DRIVE
 MIDLAND, TX
 US 79706
 Contact: HERMAN GARZA
 herman_garza@eogresources.com
 T: (432)686-3600
 F: