

# OIL ANALYSIS REPORT

Sample Rating Trend

ISO



Area  
**COMPRESSOR STATIONS/RED HILLS WEST AREA [T060002086]**  
Machine Id  
**DEEP ELEM (S/N AS3190228)**

Component  
**Screw Compressor**  
Fluid  
**TULCO LUBSOIL LPG WS 150 (--- GAL)**



## DIAGNOSIS

**Recommendation**  
No corrective action is recommended at this time. Resample at the next service interval to monitor. ( Customer Sample Comment: Vru pm not due yet )

**Wear**  
All component wear rates are normal.

**Contamination**  
There is a moderate amount of silt (particulates < 14 microns in size) present in the oil.

**Fluid Condition**  
The AN level is acceptable for this fluid. The condition of the oil is suitable for further service.

SAMPLE INFORMATION		method	limit/base	current	history1	history2
Sample Number	Client Info			<b>TO60002086</b>	---	---
Sample Date	Client Info			<b>21 Feb 2024</b>	---	---
Machine Age	hrs Client Info			<b>25019</b>	---	---
Oil Age	hrs Client Info			<b>25019</b>	---	---
Oil Changed	Client Info			<b>Not Chngd</b>	---	---
Sample Status				<b>ATTENTION</b>	---	---

WEAR METALS		method	limit/base	current	history1	history2
Iron	ppm	ASTM D5185m	>60	<b>&lt;1</b>	---	---
Chromium	ppm	ASTM D5185m	>4	<b>&lt;1</b>	---	---
Nickel	ppm	ASTM D5185m		<b>0</b>	---	---
Titanium	ppm	ASTM D5185m		<b>0</b>	---	---
Silver	ppm	ASTM D5185m		<b>0</b>	---	---
Aluminum	ppm	ASTM D5185m	>5	<b>2</b>	---	---
Lead	ppm	ASTM D5185m	>10	<b>0</b>	---	---
Copper	ppm	ASTM D5185m	>30	<b>0</b>	---	---
Tin	ppm	ASTM D5185m	>15	<b>0</b>	---	---
Vanadium	ppm	ASTM D5185m		<b>0</b>	---	---
Cadmium	ppm	ASTM D5185m		<b>0</b>	---	---






ADDITIVES		method	limit/base	current	history1	history2
Boron	ppm	ASTM D5185m	0	<b>0</b>	---	---
Barium	ppm	ASTM D5185m	0	<b>8</b>	---	---
Molybdenum	ppm	ASTM D5185m	0	<b>0</b>	---	---
Manganese	ppm	ASTM D5185m		<b>0</b>	---	---
Magnesium	ppm	ASTM D5185m	0	<b>&lt;1</b>	---	---
Calcium	ppm	ASTM D5185m	0	<b>&lt;1</b>	---	---
Phosphorus	ppm	ASTM D5185m	0	<b>29</b>	---	---
Zinc	ppm	ASTM D5185m	0	<b>0</b>	---	---
Sulfur	ppm	ASTM D5185m	0	<b>171</b>	---	---

CONTAMINANTS		method	limit/base	current	history1	history2
Silicon	ppm	ASTM D5185m	>50	<b>0</b>	---	---
Sodium	ppm	ASTM D5185m		<b>0</b>	---	---
Potassium	ppm	ASTM D5185m	>20	<b>2</b>	---	---
Water	%	ASTM D6304	>2.26	<b>0.220</b>	---	---
ppm Water	ppm	ASTM D6304	>22600	<b>2205</b>	---	---

FLUID CLEANLINESS		method	limit/base	current	history1	history2
Particles >4µm		ASTM D7647	>10000	<b>6009</b>	---	---
Particles >6µm		ASTM D7647	>1300	<b>1745</b>	---	---
Particles >14µm		ASTM D7647	>320	<b>98</b>	---	---
Particles >21µm		ASTM D7647	>80	<b>21</b>	---	---
Particles >38µm		ASTM D7647	>20	<b>2</b>	---	---
Particles >71µm		ASTM D7647	>4	<b>0</b>	---	---
Oil Cleanliness		ISO 4406 (c)	>20/17/15	<b>20/18/14</b>	---	---

FLUID DEGRADATION		method	limit/base	current	history1	history2
Acid Number (AN)	mg KOH/g	ASTM D8045		<b>0.093</b>	---	---

# OIL ANALYSIS REPORT

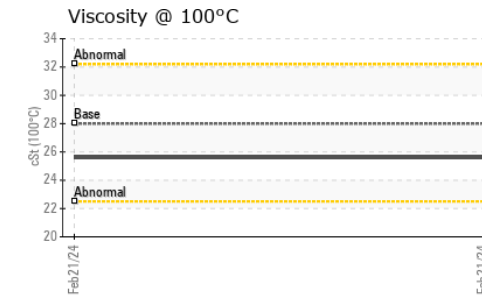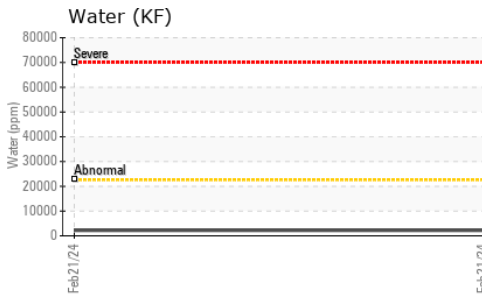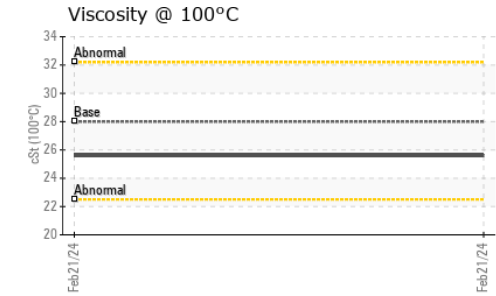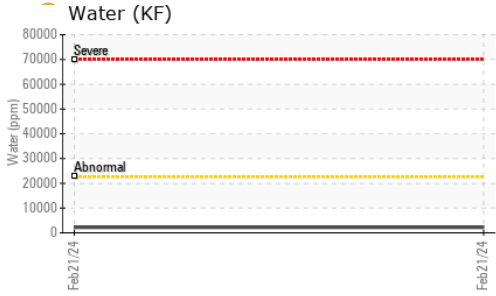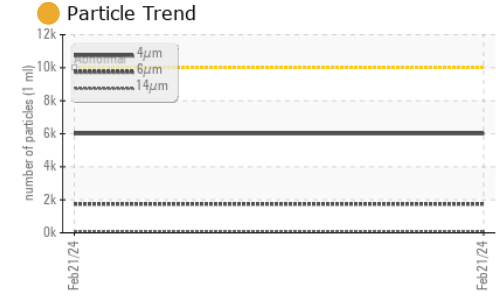





VISUAL	method	limit/base	current	history1	history2	
White Metal	scalar	*Visual	NONE	NONE	---	---
Yellow Metal	scalar	*Visual	NONE	NONE	---	---
Precipitate	scalar	*Visual	NONE	NONE	---	---
Silt	scalar	*Visual	NONE	NONE	---	---
Debris	scalar	*Visual	NONE	NONE	---	---
Sand/Dirt	scalar	*Visual	NONE	NONE	---	---
Appearance	scalar	*Visual	NORML	NORML	---	---
Odor	scalar	*Visual	NORML	NORML	---	---
Emulsified Water	scalar	*Visual	>2.26	NEG	---	---
Free Water	scalar	*Visual		NEG	---	---

FLUID PROPERTIES	method	limit/base	current	history1	history2	
Visc @ 40°C	cSt	ASTM D445	151	137	---	---
Visc @ 100°C	cSt	ASTM D445	28	25.6	---	---
Viscosity Index (VI)	Scale	ASTM D2270	224	222	---	---

SAMPLE IMAGES	method	limit/base	current	history1	history2
---------------	--------	------------	---------	----------	----------

Color				no image	no image
Bottom				no image	no image

## GRAPHS

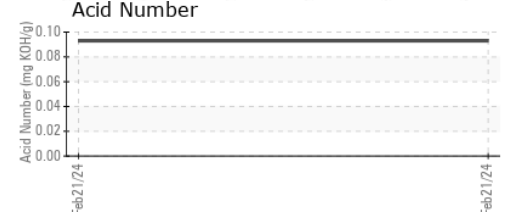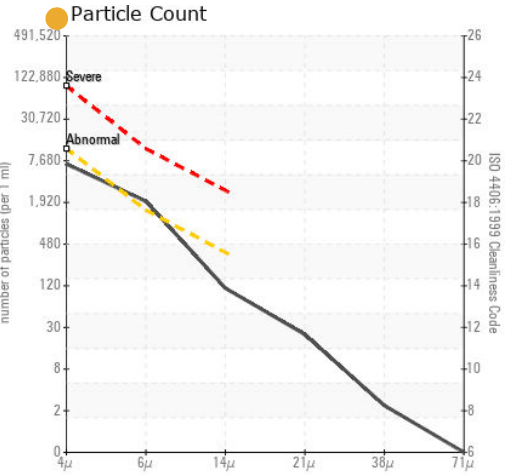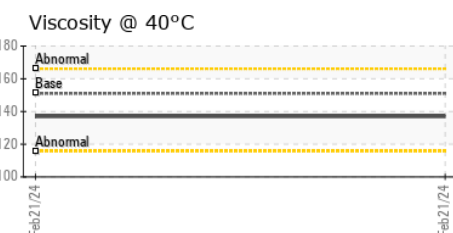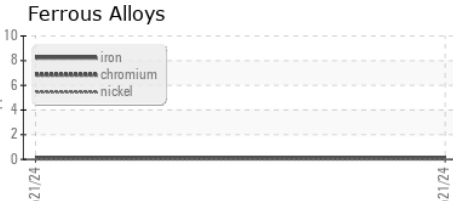

**Laboratory** : WearCheck USA - 501 Madison Ave., Cary, NC 27513  
**Sample No.** : TO60002086 **Received** : 26 Feb 2024  
**Lab Number** : 06100928 **Tested** : 27 Feb 2024  
**Unique Number** : 10899158 **Diagnosed** : 28 Feb 2024 - Don Baldrige  
**Test Package** : IND 2 ( Additional Tests: KF, KV100, PrtCount, VI )

**MIDLAND - EOG RESOURCES INC.**  
 5509 CHAMPIONS DRIVE  
 MIDLAND, TX  
 US 79706  
 Contact: ROBERT PRADO  
 robert\_prado@egoresources.com

To discuss this sample report, contact Customer Service at 1-800-237-1369.  
 \* - Denotes test methods that are outside of the ISO 17025 scope of accreditation.  
 Statements of conformity to specifications are based on the simple acceptance decision rule (JCGM 106:2012)