


OIL ANALYSIS REPORT

Sample Rating Trend

ISO

Area
COMPRESSOR STATIONS/ROSS DRAW AREA
 Machine Id
DOVE (S/N LE11333)
 Component
Compressor
 Fluid
TULCO LUBSOIL LPG WS 150 (--- GAL)

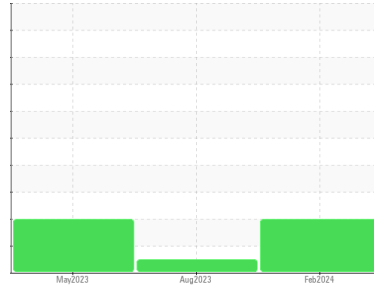

DIAGNOSIS

Recommendation

No corrective action is recommended at this time. The filter change at the time of sampling has been noted. Resample at the next service interval to monitor.

Wear

All component wear rates are normal.

Contamination

There is a high amount of particulates present in the oil.

Fluid Condition

The AN level is acceptable for this fluid. The condition of the oil is suitable for further service.

SAMPLE INFORMATION

method	limit/base	current	history1	history2
Sample Number	Client Info	TO60002091	TO60001245	TO60000850
Sample Date	Client Info	07 Feb 2024	09 Aug 2023	05 May 2023
Machine Age	hrs	11707	2817	4320
Oil Age	hrs	4320	4320	4320
Oil Changed	Client Info	Filtered	N/A	N/A
Sample Status		ABNORMAL	NORMAL	ABNORMAL

WEAR METALS

method	limit/base	current	history1	history2	
Iron	ppm	ASTM D5185m >50	0	<1	1
Chromium	ppm	ASTM D5185m >10	<1	0	<1
Nickel	ppm	ASTM D5185m	0	<1	<1
Titanium	ppm	ASTM D5185m	0	0	<1
Silver	ppm	ASTM D5185m	0	0	0
Aluminum	ppm	ASTM D5185m >25	2	<1	0
Lead	ppm	ASTM D5185m >25	0	0	0
Copper	ppm	ASTM D5185m >50	0	<1	0
Tin	ppm	ASTM D5185m >15	0	<1	<1
Vanadium	ppm	ASTM D5185m	0	0	<1
Cadmium	ppm	ASTM D5185m	0	0	<1

ADDITIVES

method	limit/base	current	history1	history2	
Boron	ppm	ASTM D5185m 0	0	0	0
Barium	ppm	ASTM D5185m 0	8	0	0
Molybdenum	ppm	ASTM D5185m 0	0	0	0
Manganese	ppm	ASTM D5185m	0	<1	0
Magnesium	ppm	ASTM D5185m 0	<1	2	<1
Calcium	ppm	ASTM D5185m 0	<1	0	2
Phosphorus	ppm	ASTM D5185m 0	25	3	4
Zinc	ppm	ASTM D5185m 0	0	0	0
Sulfur	ppm	ASTM D5185m 0	87	34	71

CONTAMINANTS

method	limit/base	current	history1	history2	
Silicon	ppm	ASTM D5185m >25	0	<1	14
Sodium	ppm	ASTM D5185m	4	2	6
Potassium	ppm	ASTM D5185m >20	1	2	<1
Water	%	ASTM D6304 >2.26	0.181	0.266	0.298
ppm Water	ppm	ASTM D6304 >22600	1810	2662.1	2980






FLUID CLEANLINESS

method	limit/base	current	history1	history2
Particles >4µm	ASTM D7647 >10000	▲ 27030	933	▲ 139284
Particles >6µm	ASTM D7647 >1300	▲ 9298	248	▲ 51371
Particles >14µm	ASTM D7647 >320	▲ 938	18	▲ 1517
Particles >21µm	ASTM D7647 >80	▲ 236	7	● 158
Particles >38µm	ASTM D7647 >20	4	0	3
Particles >71µm	ASTM D7647 >4	0	0	0
Oil Cleanliness	ISO 4406 (c) >20/17/15	▲ 22/20/17	17/15/11	▲ 24/23/18

FLUID DEGRADATION

method	limit/base	current	history1	history2	
Acid Number (AN)	mg KOH/g	ASTM D8045	0.21	0.089	0.105


OIL ANALYSIS REPORT

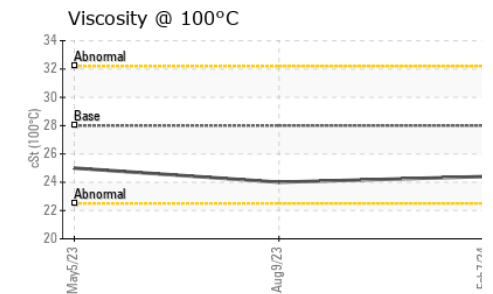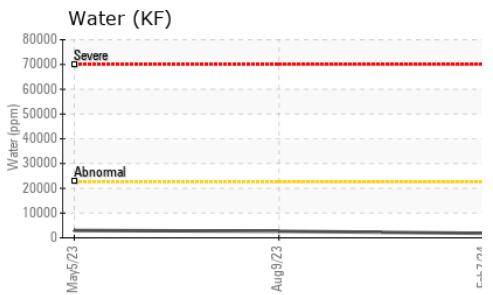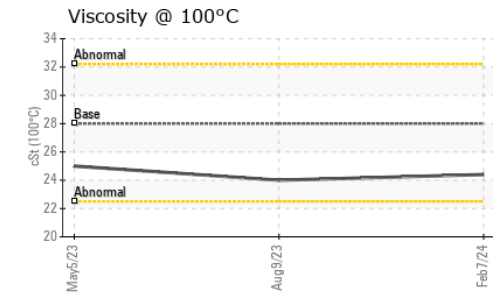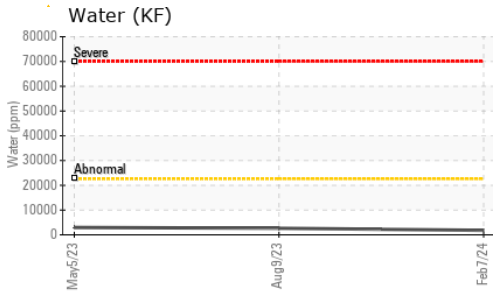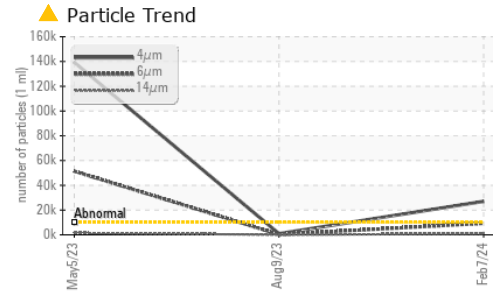






VISUAL	method	limit/base	current	history1	history2
White Metal	scalar	*Visual	NONE	NONE	NONE
Yellow Metal	scalar	*Visual	NONE	NONE	NONE
Precipitate	scalar	*Visual	NONE	NONE	NONE
Silt	scalar	*Visual	NONE	NONE	NONE
Debris	scalar	*Visual	NONE	NONE	NONE
Sand/Dirt	scalar	*Visual	NONE	NONE	NONE
Appearance	scalar	*Visual	NORML	NORML	NORML
Odor	scalar	*Visual	NORML	NORML	NORML
Emulsified Water	scalar	*Visual	>2.26	NEG	NEG
Free Water	scalar	*Visual		NEG	NEG

FLUID PROPERTIES	method	limit/base	current	history1	history2
Visc @ 40°C	cSt	ASTM D445	151	127	138
Visc @ 100°C	cSt	ASTM D445	28	24.0	25.0
Viscosity Index (VI)	Scale	ASTM D2270	224	222	215

SAMPLE IMAGES	method	limit/base	current	history1	history2
---------------	--------	------------	---------	----------	----------

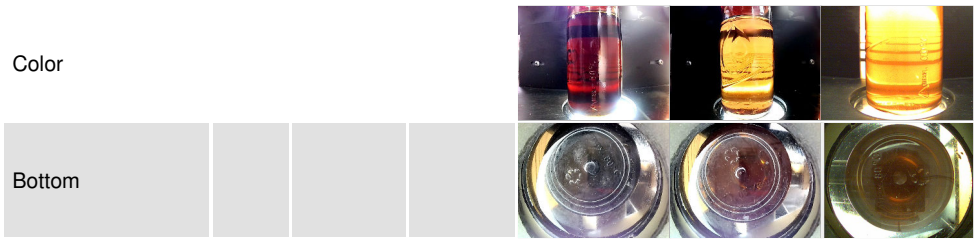

GRAPHS

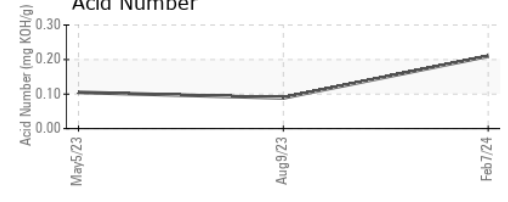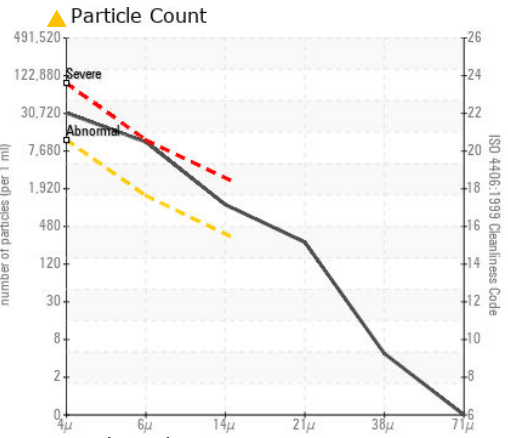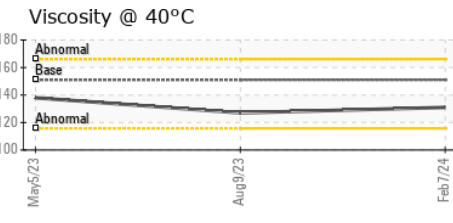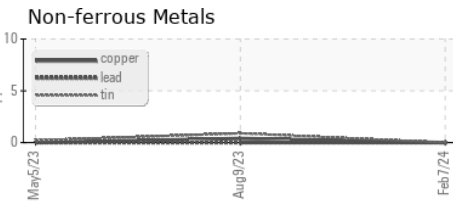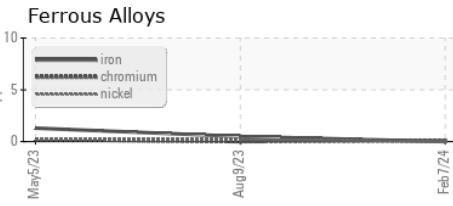

Laboratory : WearCheck USA - 501 Madison Ave., Cary, NC 27513
Sample No. : TO60002091 **Received** : 26 Feb 2024
Lab Number : 06100946 **Tested** : 27 Feb 2024
Unique Number : 10899176 **Diagnosed** : 28 Feb 2024 - Don Baldrige
Test Package : IND 2 (Additional Tests: KF , KV100, PrtCount, VI)

MIDLAND - EOG RESOURCES INC.
 5509 CHAMPIONS DRIVE
 MIDLAND, TX
 US 79706
 Contact: HERMAN GARZA
 herman_garza@eogresources.com
 T: (432)686-3600
 F:

To discuss this sample report, contact Customer Service at 1-800-237-1369.
 * - Denotes test methods that are outside of the ISO 17025 scope of accreditation.
 Statements of conformity to specifications are based on the simple acceptance decision rule (JCGM 106:2012)