


# OIL ANALYSIS REPORT

Sample Rating Trend



ISO

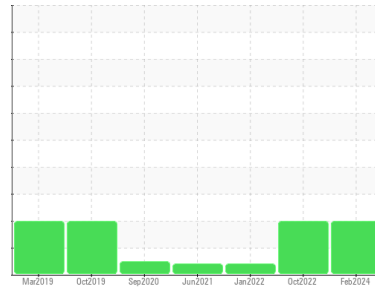

Machine Id  
**KAESER SX6 1988462 (S/N 1279)**

Component  
**Compressor**

Fluid  
**KAESER SIGMA (OEM) S-460 (--- QTS)**

## DIAGNOSIS

### ▲ Recommendation

Oil and filter change at the time of sampling has been noted. Resample at the next service interval to monitor.

### Wear

All component wear rates are normal.

### ▲ Contamination

There is a high amount of particulates present in the oil.

### Fluid Condition

The AN level is acceptable for this fluid. The condition of the oil is suitable for further service.

## SAMPLE INFORMATION

	method	limit/base	current	history1	history2
Sample Number	Client Info		<b>KCPA014235</b>	KCP05688455	KCP33876
Sample Date	Client Info		<b>21 Feb 2024</b>	28 Oct 2022	25 Jan 2022
Machine Age	hrs	Client Info	<b>68802</b>	61829	55219
Oil Age	hrs	Client Info	<b>0</b>	6000	6000
Oil Changed	Client Info		<b>Changed</b>	Changed	Not Changed
Sample Status			<b>ABNORMAL</b>	ABNORMAL	ABNORMAL

## WEAR METALS

	method	limit/base	current	history1	history2
Iron	ppm	ASTM D5185m >50	<b>0</b>	0	0
Chromium	ppm	ASTM D5185m >10	<b>&lt;1</b>	0	0
Nickel	ppm	ASTM D5185m >3	<b>0</b>	0	0
Titanium	ppm	ASTM D5185m >3	<b>0</b>	0	0
Silver	ppm	ASTM D5185m >2	<b>0</b>	0	0
Aluminum	ppm	ASTM D5185m >10	<b>2</b>	0	<1
Lead	ppm	ASTM D5185m >10	<b>0</b>	0	0
Copper	ppm	ASTM D5185m >50	<b>12</b>	8	8
Tin	ppm	ASTM D5185m >10	<b>0</b>	0	<1
Antimony	ppm	ASTM D5185m	<b>---</b>	---	0
Vanadium	ppm	ASTM D5185m	<b>0</b>	0	0
Cadmium	ppm	ASTM D5185m	<b>0</b>	0	0

## ADDITIVES

	method	limit/base	current	history1	history2
Boron	ppm	ASTM D5185m	<b>0</b>	0	0
Barium	ppm	ASTM D5185m 90	<b>8</b>	0	0
Molybdenum	ppm	ASTM D5185m	<b>0</b>	0	0
Manganese	ppm	ASTM D5185m	<b>0</b>	0	0
Magnesium	ppm	ASTM D5185m 90	<b>1</b>	0	0
Calcium	ppm	ASTM D5185m 2	<b>&lt;1</b>	0	0
Phosphorus	ppm	ASTM D5185m	<b>25</b>	12	2
Zinc	ppm	ASTM D5185m	<b>9</b>	0	0
Sulfur	ppm	ASTM D5185m	<b>17583</b>	18028	14775

## CONTAMINANTS

	method	limit/base	current	history1	history2
Silicon	ppm	ASTM D5185m >25	<b>0</b>	<1	<1
Sodium	ppm	ASTM D5185m	<b>0</b>	<1	<1
Potassium	ppm	ASTM D5185m >20	<b>&lt;1</b>	0	0
Water	%	ASTM D6304 >0.05	<b>0.004</b>	0.010	0.004
ppm Water	ppm	ASTM D6304 >500	<b>47</b>	102.2	44.3






## FLUID CLEANLINESS

	method	limit/base	current	history1	history2
Particles >4µm	ASTM D7647		<b>9412</b>	20238	---
Particles >6µm	ASTM D7647	>1300	▲ <b>3618</b>	▲ 6090	---
Particles >14µm	ASTM D7647	>80	▲ <b>520</b>	▲ 781	---
Particles >21µm	ASTM D7647	>20	▲ <b>176</b>	▲ 315	---
Particles >38µm	ASTM D7647	>4	▲ <b>11</b>	▲ 22	---
Particles >71µm	ASTM D7647	>3	<b>1</b>	0	---
Oil Cleanliness	ISO 4406 (c)	>--/17/13	▲ <b>20/19/16</b>	▲ 22/20/17	---

## FLUID DEGRADATION

	method	limit/base	current	history1	history2
Acid Number (AN)	mg KOH/g	ASTM D8045 0.4	<b>0.45</b>	0.50	0.39


# OIL ANALYSIS REPORT

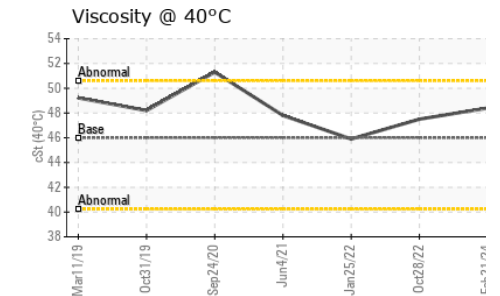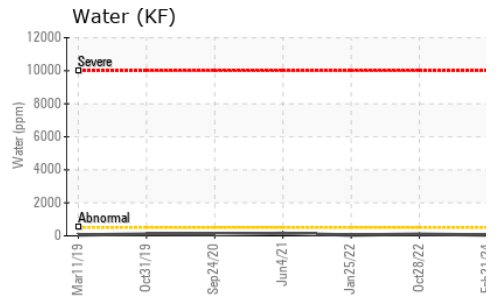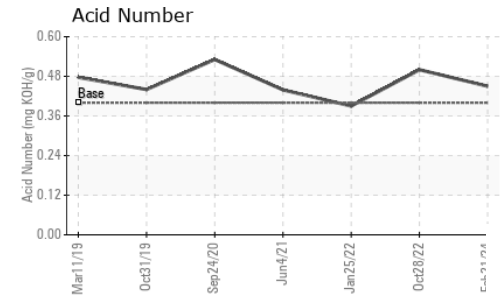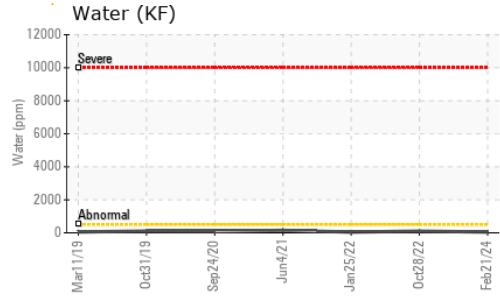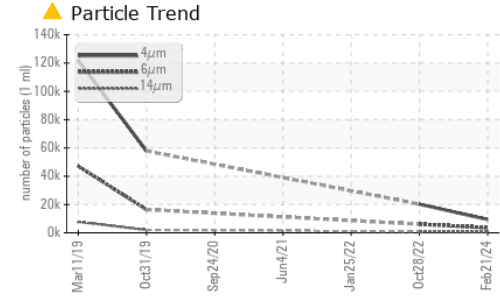






PARAMETER	method	limit/base	current	history1	history2
White Metal	scalar	*Visual	NONE	NONE	MODER
Yellow Metal	scalar	*Visual	NONE	NONE	NONE
Precipitate	scalar	*Visual	NONE	NONE	NONE
Silt	scalar	*Visual	NONE	NONE	NONE
Debris	scalar	*Visual	NONE	NONE	▲ MODER
Sand/Dirt	scalar	*Visual	NONE	NONE	NONE
Appearance	scalar	*Visual	NORML	NORML	NORML
Odor	scalar	*Visual	NORML	NORML	NORML
Emulsified Water	scalar	*Visual	>0.05	NEG	NEG
Free Water	scalar	*Visual		NEG	NEG

FLUID PROPERTIES	method	limit/base	current	history1	history2
Visc @ 40°C	cSt	ASTM D445	46	48.4	47.5

SAMPLE IMAGES	method	limit/base	current	history1	history2
---------------	--------	------------	---------	----------	----------

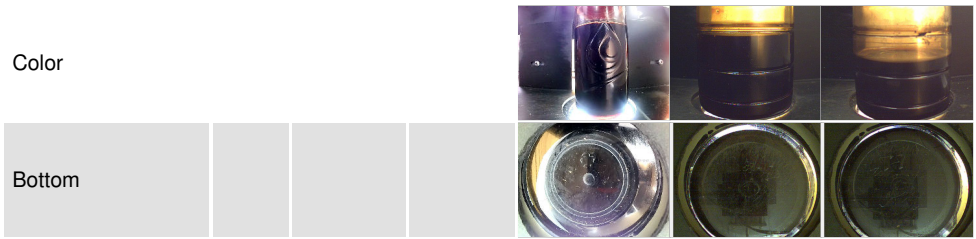

## GRAPHS

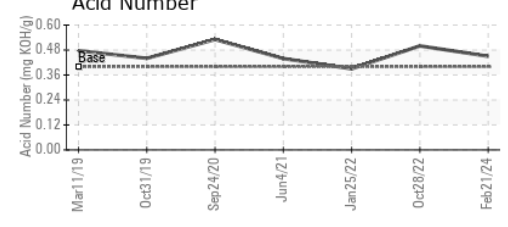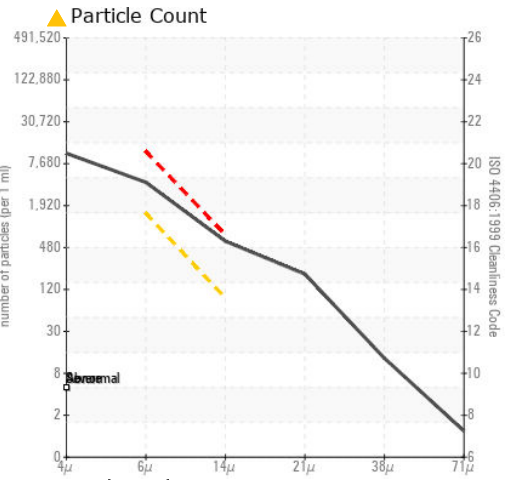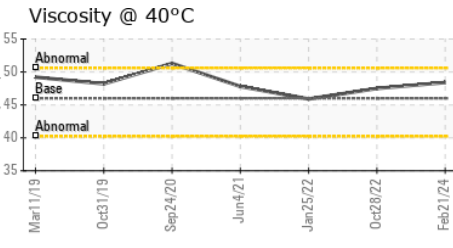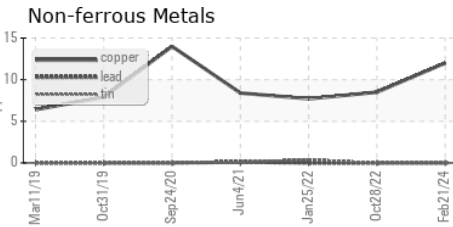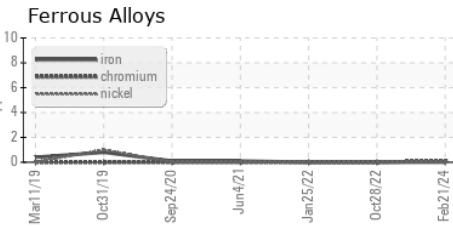

**Laboratory** : WearCheck USA - 501 Madison Ave., Cary, NC 27513  
**Sample No.** : KCPA014235  
**Lab Number** : 06100952  
**Unique Number** : 10899182  
**Test Package** : IND 2 ( Additional Tests: KF, PrtCount )

**OLD DOMINION FL**  
 4715 EVANS TOWN RD  
 GREENSBORO, NC  
 US 27406  
 Contact: Service Manager

**Received** : 26 Feb 2024  
**Tested** : 27 Feb 2024  
**Diagnosed** : 28 Feb 2024 - Jonathan Hester

To discuss this sample report, contact Customer Service at 1-800-237-1369.  
 \* - Denotes test methods that are outside of the ISO 17025 scope of accreditation.  
 Statements of conformity to specifications are based on the simple acceptance decision rule (JCGM 106:2012)