




# OIL ANALYSIS REPORT

Sample Rating Trend

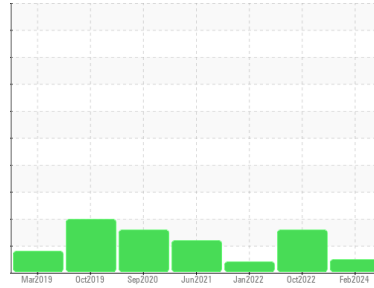

**NORMAL**



Machine Id  
**KAESER SK26 1423361 (S/N 0264459)**

Component  
**Compressor**

Fluid  
**KAESER SIGMA (OEM) S-460 (--- QTS)**

## DIAGNOSIS

### Recommendation

Resample at the next service interval to monitor.

### Wear

All component wear rates are normal.

### Contamination

There is no indication of any contamination in the oil. The amount and size of particulates present in the system are acceptable.

### Fluid Condition

The AN level is acceptable for this fluid. The condition of the oil is suitable for further service.

## SAMPLE INFORMATION

method	limit/base	current	history1	history2	
Sample Number	Client Info	<b>KCPA015218</b>	KCP47596	KCP48587	
Sample Date	Client Info	<b>21 Feb 2024</b>	28 Oct 2022	25 Jan 2022	
Machine Age	hrs	Client Info	<b>7394</b>	7286	7285
Oil Age	hrs	Client Info	<b>0</b>	1	16
Oil Changed	Client Info	<b>Changed</b>	Changed	Not Changed	
Sample Status		<b>NORMAL</b>	ATTENTION	ABNORMAL	

## WEAR METALS

method	limit/base	current	history1	history2	
Iron	ppm	ASTM D5185m >50	<b>0</b>	<1	<1
Chromium	ppm	ASTM D5185m >10	<b>&lt;1</b>	0	0
Nickel	ppm	ASTM D5185m >3	<b>0</b>	0	0
Titanium	ppm	ASTM D5185m >3	<b>0</b>	0	0
Silver	ppm	ASTM D5185m >2	<b>0</b>	0	<1
Aluminum	ppm	ASTM D5185m >10	<b>2</b>	<1	<1
Lead	ppm	ASTM D5185m >10	<b>0</b>	0	0
Copper	ppm	ASTM D5185m >50	<b>0</b>	<1	<1
Tin	ppm	ASTM D5185m >10	<b>0</b>	0	<1
Antimony	ppm	ASTM D5185m	<b>---</b>	---	0
Vanadium	ppm	ASTM D5185m	<b>0</b>	0	0
Cadmium	ppm	ASTM D5185m	<b>0</b>	0	0

## ADDITIVES

method	limit/base	current	history1	history2	
Boron	ppm	ASTM D5185m	<b>0</b>	0	<1
Barium	ppm	ASTM D5185m 90	<b>69</b>	43	56
Molybdenum	ppm	ASTM D5185m	<b>0</b>	0	0
Manganese	ppm	ASTM D5185m	<b>0</b>	<1	<1
Magnesium	ppm	ASTM D5185m 90	<b>78</b>	84	83
Calcium	ppm	ASTM D5185m 2	<b>3</b>	<1	2
Phosphorus	ppm	ASTM D5185m	<b>26</b>	16	4
Zinc	ppm	ASTM D5185m	<b>9</b>	0	9
Sulfur	ppm	ASTM D5185m	<b>18588</b>	21056	17934

## CONTAMINANTS

method	limit/base	current	history1	history2	
Silicon	ppm	ASTM D5185m >25	<b>0</b>	0	<1
Sodium	ppm	ASTM D5185m	<b>5</b>	6	6
Potassium	ppm	ASTM D5185m >20	<b>2</b>	0	<1
Water	%	ASTM D6304 >0.05	<b>0.013</b>	0.028	0.009
ppm Water	ppm	ASTM D6304 >500	<b>139</b>	284.2	97.2






## FLUID CLEANLINESS

method	limit/base	current	history1	history2
Particles >4µm	ASTM D7647	<b>5866</b>	16950	---
Particles >6µm	ASTM D7647 >1300	<b>786</b>	● 2337	---
Particles >14µm	ASTM D7647 >80	<b>35</b>	● 136	---
Particles >21µm	ASTM D7647 >20	<b>8</b>	● 46	---
Particles >38µm	ASTM D7647 >4	<b>1</b>	4	---
Particles >71µm	ASTM D7647 >3	<b>0</b>	0	---
Oil Cleanliness	ISO 4406 (c) >--/17/13	<b>20/17/12</b>	● 21/18/14	---

## FLUID DEGRADATION

method	limit/base	current	history1	history2	
Acid Number (AN)	mg KOH/g	ASTM D8045 0.4	<b>0.35</b>	0.40	0.37


# OIL ANALYSIS REPORT

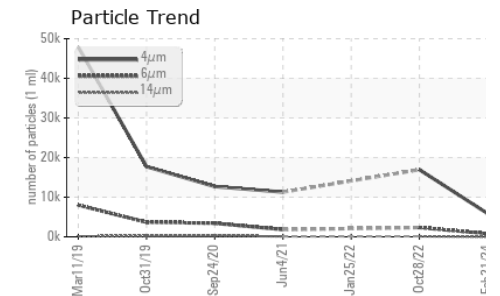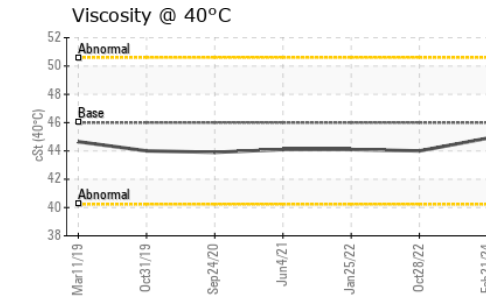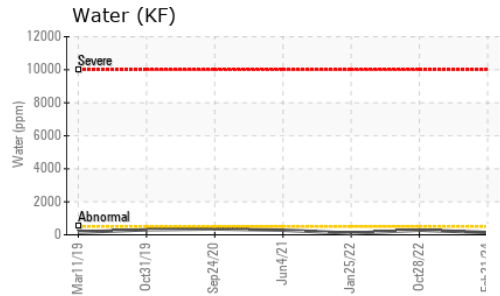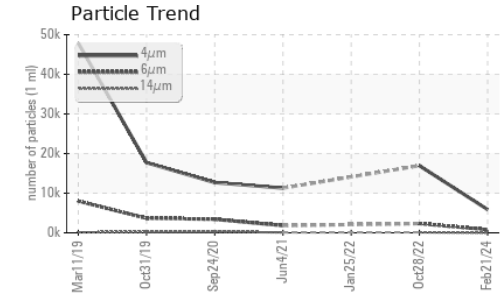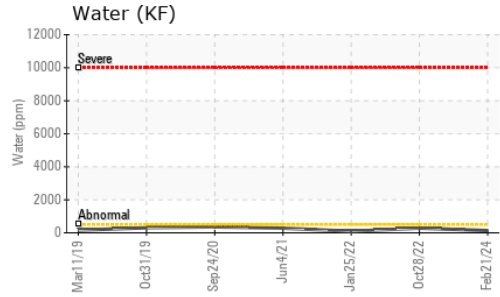






VISUAL	method	limit/base	current	history1	history2
White Metal	scalar	*Visual	NONE	NONE	NONE
Yellow Metal	scalar	*Visual	NONE	NONE	NONE
Precipitate	scalar	*Visual	NONE	NONE	NONE
Silt	scalar	*Visual	NONE	NONE	NONE
Debris	scalar	*Visual	NONE	NONE	LIGHT ▲ MODER
Sand/Dirt	scalar	*Visual	NONE	NONE	NONE
Appearance	scalar	*Visual	NORML	NORML	NORML
Odor	scalar	*Visual	NORML	NORML	NORML
Emulsified Water	scalar	*Visual	>0.05	NEG	NEG
Free Water	scalar	*Visual		NEG	NEG

FLUID PROPERTIES	method	limit/base	current	history1	history2
Visc @ 40°C	cSt	ASTM D445 46	44.9	44.0	44.1

SAMPLE IMAGES	method	limit/base	current	history1	history2
---------------	--------	------------	---------	----------	----------

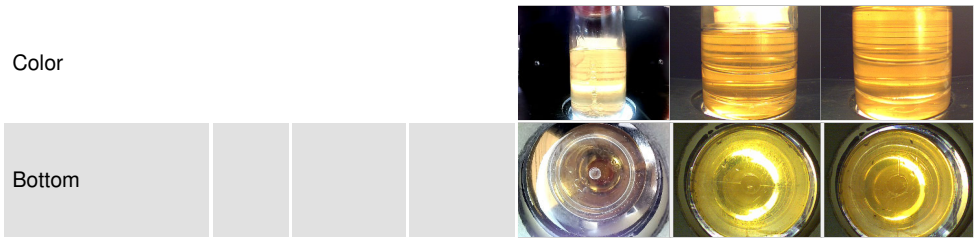

## GRAPHS

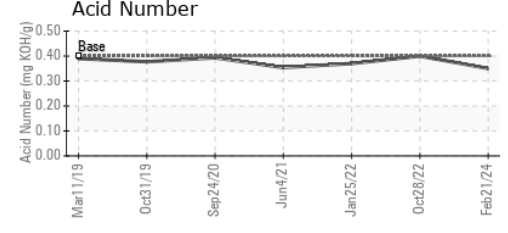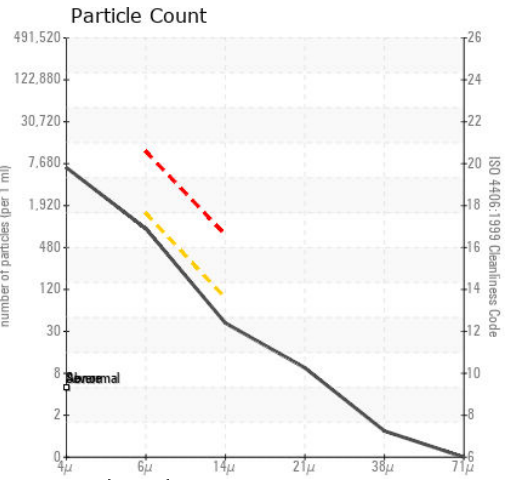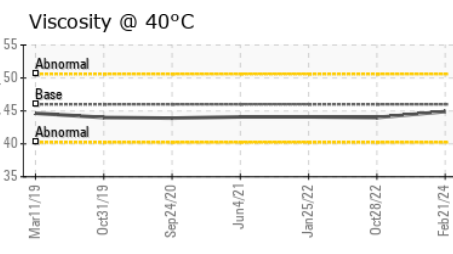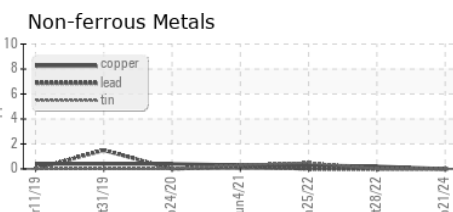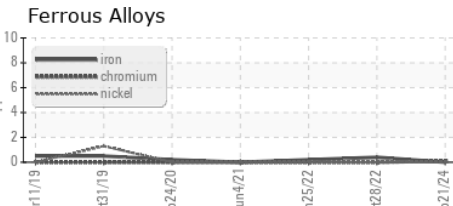

**Laboratory** : WearCheck USA - 501 Madison Ave., Cary, NC 27513  
**Sample No.** : KCPA015218 **Received** : 26 Feb 2024  
**Lab Number** : 06100953 **Tested** : 27 Feb 2024  
**Unique Number** : 10899183 **Diagnosed** : 28 Feb 2024 - Jonathan Hester  
**Test Package** : IND 2 ( Additional Tests: KF, PrtCount )

**OLD DOMINION FL**  
 4715 EVANS TOWN RD  
 GREENSBORO, NC  
 US 27406  
 Contact: Service Manager

To discuss this sample report, contact Customer Service at 1-800-237-1369.  
 \* - Denotes test methods that are outside of the ISO 17025 scope of accreditation.  
 Statements of conformity to specifications are based on the simple acceptance decision rule (JCGM 106:2012)