




OIL ANALYSIS REPORT

Sample Rating Trend

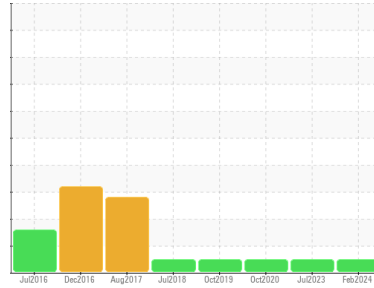

NORMAL



Machine Id
KAESER CSD 75 5210873 (S/N 1116)

Component
Compressor

Fluid
KAESER SIGMA (OEM) S-460 (--- LTR)

DIAGNOSIS

Recommendation

Resample at the next service interval to monitor.

Wear

All component wear rates are normal.

Contamination

There is no indication of any contamination in the oil. The amount and size of particulates present in the system are acceptable.

Fluid Condition

The AN level is acceptable for this fluid. The condition of the oil is suitable for further service.

SAMPLE INFORMATION		method	limit/base	current	history1	history2
Sample Number	Client Info			KCPA014724	KCPA001898	KCP29344
Sample Date	Client Info			09 Feb 2024	27 Jul 2023	15 Oct 2020
Machine Age	hrs	Client Info		13117	11083	8599
Oil Age	hrs	Client Info		2034	0	52
Oil Changed	Client Info			Not Chngd	N/A	Not Chngd
Sample Status				NORMAL	NORMAL	NORMAL

WEAR METALS		method	limit/base	current	history1	history2
Iron	ppm	ASTM D5185m	>50	0	0	0
Chromium	ppm	ASTM D5185m	>10	<1	0	0
Nickel	ppm	ASTM D5185m	>3	0	0	0
Titanium	ppm	ASTM D5185m	>3	0	0	0
Silver	ppm	ASTM D5185m	>2	0	0	0
Aluminum	ppm	ASTM D5185m	>10	2	0	<1
Lead	ppm	ASTM D5185m	>10	0	0	0
Copper	ppm	ASTM D5185m	>50	2	2	<1
Tin	ppm	ASTM D5185m	>10	0	0	0
Antimony	ppm	ASTM D5185m		---	---	0
Vanadium	ppm	ASTM D5185m		0	<1	0
Cadmium	ppm	ASTM D5185m		0	0	0






ADDITIVES		method	limit/base	current	history1	history2
Boron	ppm	ASTM D5185m		0	0	12
Barium	ppm	ASTM D5185m	90	11	0	45
Molybdenum	ppm	ASTM D5185m		0	0	0
Manganese	ppm	ASTM D5185m		0	0	0
Magnesium	ppm	ASTM D5185m	90	52	50	105
Calcium	ppm	ASTM D5185m	2	1	0	2
Phosphorus	ppm	ASTM D5185m		24	2	1
Zinc	ppm	ASTM D5185m		6	0	<1
Sulfur	ppm	ASTM D5185m		18474	22487	16902

CONTAMINANTS		method	limit/base	current	history1	history2
Silicon	ppm	ASTM D5185m	>25	<1	<1	<1
Sodium	ppm	ASTM D5185m		15	11	13
Potassium	ppm	ASTM D5185m	>20	4	4	2
Water	%	ASTM D6304	>0.05	0.017	0.019	0.045
ppm Water	ppm	ASTM D6304	>500	176	192.2	450.8

FLUID CLEANLINESS		method	limit/base	current	history1	history2
Particles >4µm		ASTM D7647		1590	924	2098
Particles >6µm		ASTM D7647	>1300	485	313	537
Particles >14µm		ASTM D7647	>80	75	28	68
Particles >21µm		ASTM D7647	>20	28	10	18
Particles >38µm		ASTM D7647	>4	2	0	2
Particles >71µm		ASTM D7647	>3	0	0	0
Oil Cleanliness		ISO 4406 (c)	>--/17/13	18/16/13	17/15/12	16/13

FLUID DEGRADATION		method	limit/base	current	history1	history2
Acid Number (AN)	mg KOH/g	ASTM D8045	0.4	0.37	0.36	0.367


OIL ANALYSIS REPORT

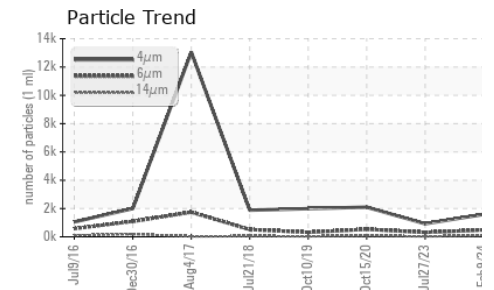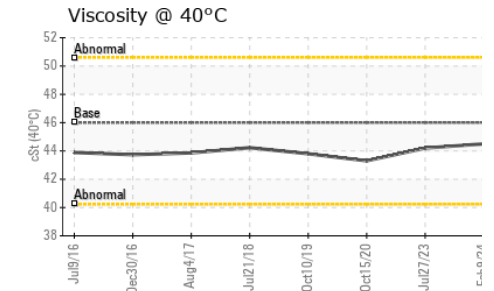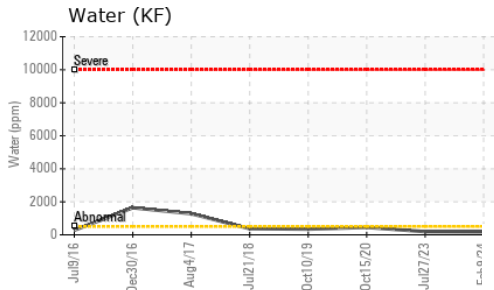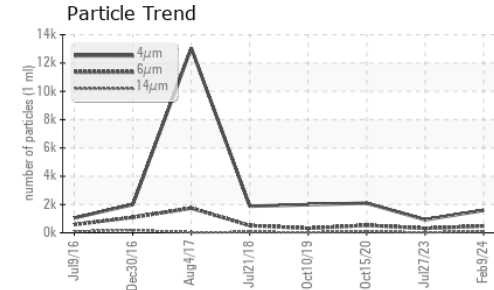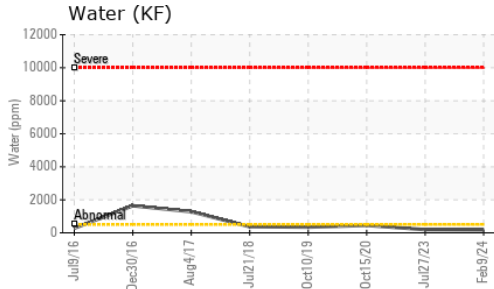






VISUAL	method	limit/base	current	history1	history2
White Metal	scalar	*Visual	NONE	NONE	NONE
Yellow Metal	scalar	*Visual	NONE	NONE	NONE
Precipitate	scalar	*Visual	NONE	NONE	NONE
Silt	scalar	*Visual	NONE	NONE	NONE
Debris	scalar	*Visual	NONE	NONE	NONE
Sand/Dirt	scalar	*Visual	NONE	NONE	NONE
Appearance	scalar	*Visual	NORML	NORML	NORML
Odor	scalar	*Visual	NORML	NORML	NORML
Emulsified Water	scalar	*Visual	>0.05	NEG	NEG
Free Water	scalar	*Visual		NEG	NEG

FLUID PROPERTIES	method	limit/base	current	history1	history2
Visc @ 40°C	cSt	ASTM D445 46	44.5	44.2	43.3

SAMPLE IMAGES	method	limit/base	current	history1	history2
---------------	--------	------------	---------	----------	----------

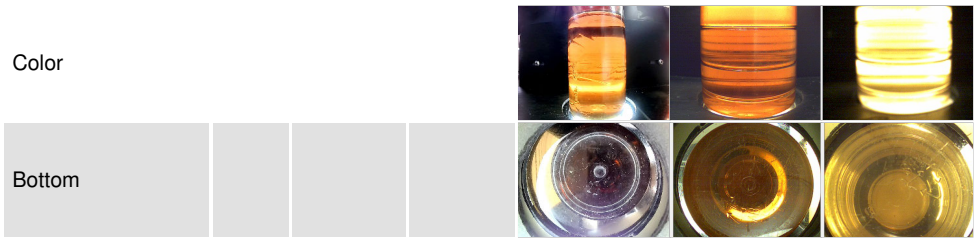

GRAPHS

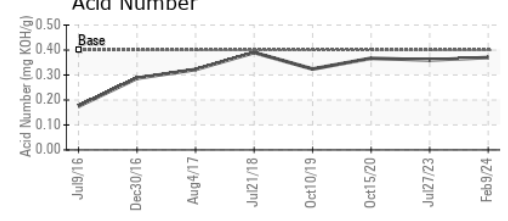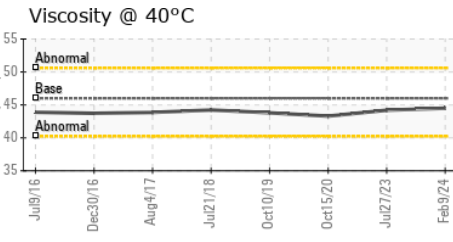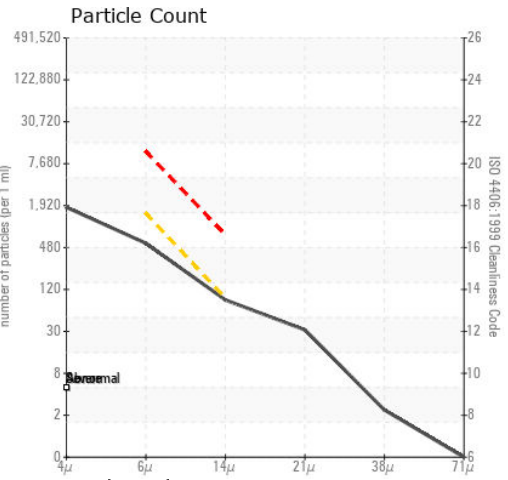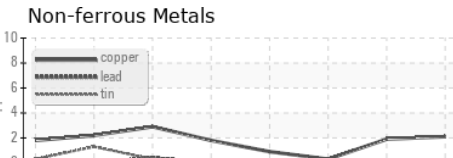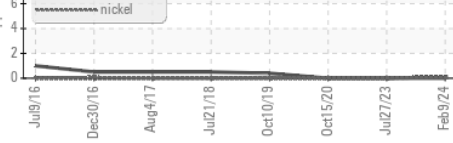

Laboratory : WearCheck USA - 501 Madison Ave., Cary, NC 27513
Sample No. : KCPA014724 **Received** : 26 Feb 2024
Lab Number : 06100957 **Tested** : 27 Feb 2024
Unique Number : 10899187 **Diagnosed** : 28 Feb 2024 - Jonathan Hester
Test Package : IND 2 (Additional Tests: KF, PrtCount)

HICKS PLASTICS
 1821 MIDPARK RD
 KNOXVILLE, TN
 US 37921
 Contact: PAUL MCMAHANY
 PAUL.MCMAHANY@HICKSPLASTICS.COM
 T:
 F:

To discuss this sample report, contact Customer Service at 1-800-237-1369.
 * - Denotes test methods that are outside of the ISO 17025 scope of accreditation.
 Statements of conformity to specifications are based on the simple acceptance decision rule (JCGM 106:2012)