




OIL ANALYSIS REPORT

Sample Rating Trend

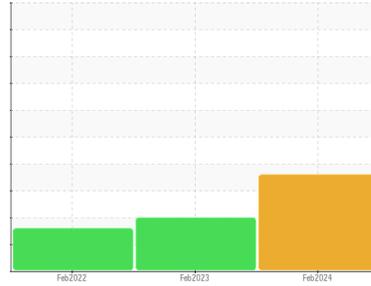

Machine Id
KAESER 7392552

Component
Compressor
Fluid
KAESER SIGMA (OEM) M-460 (--- GAL)

DIAGNOSIS

Recommendation

Oil and filter change at the time of sampling has been noted. Resample at the next service interval to monitor.

Wear

All component wear rates are normal.

Contamination

There is a moderate amount of particulates present in the oil. Elemental level of silicon (Si) above normal indicating ingress of seal material.

Fluid Condition

The oil viscosity is higher than normal. The AN level is acceptable for this fluid.

SAMPLE INFORMATION

method	limit/base	current	history1	history2	
Sample Number	Client Info	KCPA015126	KCP54636	KCP35355	
Sample Date	Client Info	19 Feb 2024	28 Feb 2023	22 Feb 2022	
Machine Age	hrs	Client Info	14256	11028	5852
Oil Age	hrs	Client Info	5225	5176	3284
Oil Changed	Client Info	Changed	Changed	Changed	
Sample Status		ABNORMAL	ABNORMAL	ABNORMAL	

WEAR METALS

method	limit/base	current	history1	history2
Iron ppm	ASTM D5185m >50	0	0	<1
Chromium ppm	ASTM D5185m >10	<1	0	0
Nickel ppm	ASTM D5185m >3	0	0	0
Titanium ppm	ASTM D5185m >3	0	0	0
Silver ppm	ASTM D5185m >2	0	<1	0
Aluminum ppm	ASTM D5185m >10	2	<1	<1
Lead ppm	ASTM D5185m >10	0	0	0
Copper ppm	ASTM D5185m >50	6	12	5
Tin ppm	ASTM D5185m >10	0	<1	<1
Antimony ppm	ASTM D5185m	---	---	2
Vanadium ppm	ASTM D5185m	0	0	0
Cadmium ppm	ASTM D5185m	0	0	0

ADDITIVES

method	limit/base	current	history1	history2
Boron ppm	ASTM D5185m 0	0	0	0
Barium ppm	ASTM D5185m 90	63	73	64
Molybdenum ppm	ASTM D5185m 0	0	0	0
Manganese ppm	ASTM D5185m	0	<1	0
Magnesium ppm	ASTM D5185m 100	61	75	83
Calcium ppm	ASTM D5185m 0	2	3	2
Phosphorus ppm	ASTM D5185m 0	26	2	2
Zinc ppm	ASTM D5185m 0	4	9	0
Sulfur ppm	ASTM D5185m 23500	20237	24423	18370

CONTAMINANTS

method	limit/base	current	history1	history2
Silicon ppm	ASTM D5185m >25	▲ 26	▲ 57	▲ 33
Sodium ppm	ASTM D5185m	31	40	30
Potassium ppm	ASTM D5185m >20	12	18	4
Water %	ASTM D6304 >0.05	0.011	0.003	0.011
ppm Water	ASTM D6304 >500	116	25.7	115.1

FLUID CLEANLINESS


method	limit/base	current	history1	history2
Particles >4µm	ASTM D7647	4777	2139	2332
Particles >6µm	ASTM D7647 >1300	● 1373	658	707
Particles >14µm	ASTM D7647 >80	● 123	72	72
Particles >21µm	ASTM D7647 >20	● 32	26	18
Particles >38µm	ASTM D7647 >4	2	2	3
Particles >71µm	ASTM D7647 >3	0	0	0
Oil Cleanliness	ISO 4406 (c) >--/17/13	● 19/18/14	18/17/13	17/13

FLUID DEGRADATION


method	limit/base	current	history1	history2
Acid Number (AN) mg KOH/g	ASTM D8045 1.0	0.48	0.50	0.48

OIL ANALYSIS REPORT


▲ Silicon (ppm)

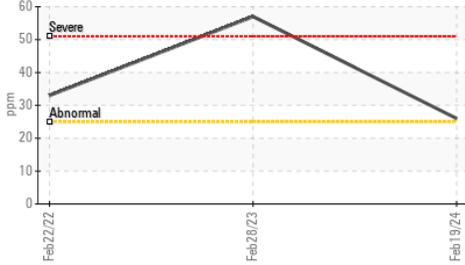


● Particle Trend

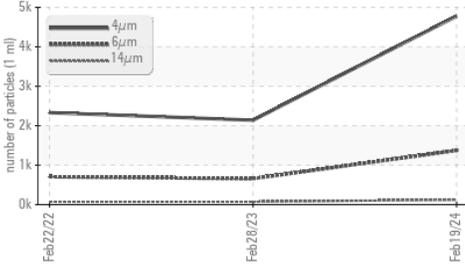


▲ Water (KF)

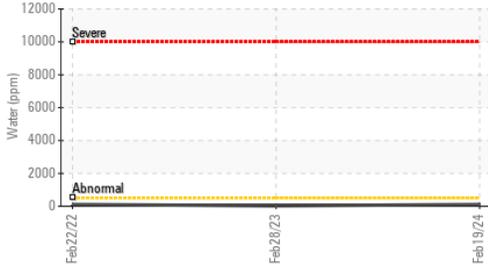

▲ Viscosity @ 40°C

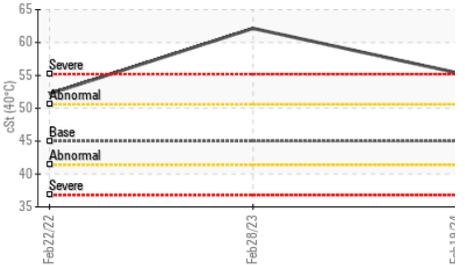


Acid Number

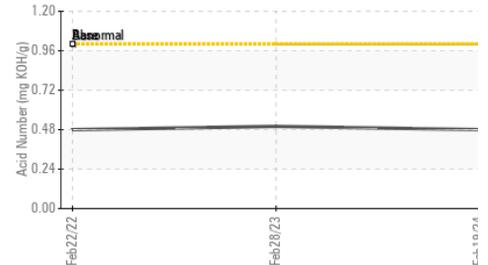

VISUAL	method	limit/base	current	history1	history2
White Metal	scalar	*Visual	NONE	NONE	NONE
Yellow Metal	scalar	*Visual	NONE	NONE	NONE
Precipitate	scalar	*Visual	NONE	NONE	NONE
Silt	scalar	*Visual	NONE	NONE	NONE
Debris	scalar	*Visual	NONE	NONE	NONE
Sand/Dirt	scalar	*Visual	NONE	NONE	NONE
Appearance	scalar	*Visual	NORML	NORML	NORML
Odor	scalar	*Visual	NORML	NORML	NORML
Emulsified Water	scalar	*Visual	>0.05	NEG	NEG
Free Water	scalar	*Visual		NEG	NEG


FLUID PROPERTIES	method	limit/base	current	history1	history2
Visc @ 40°C	cSt	ASTM D445	45 ▲ 55.4	▲ 62.15	52.2

SAMPLE IMAGES	method	limit/base	current	history1	history2
---------------	--------	------------	---------	----------	----------

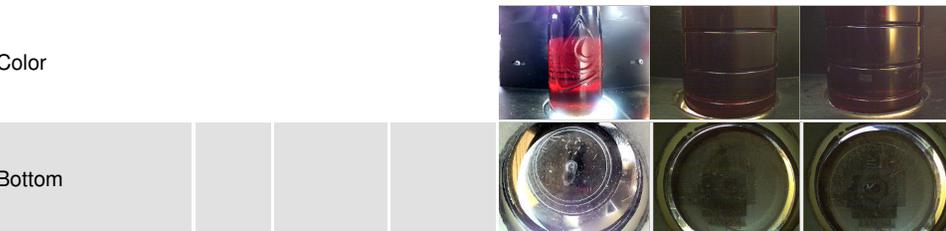


GRAPHS


Ferrous Alloys

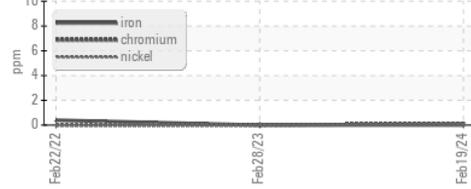


Non-ferrous Metals

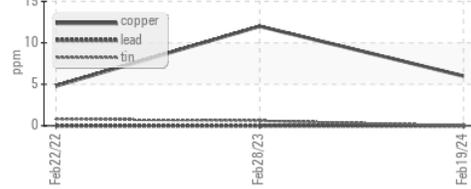


▲ Viscosity @ 40°C

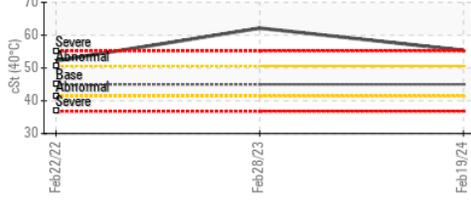

● Particle Count

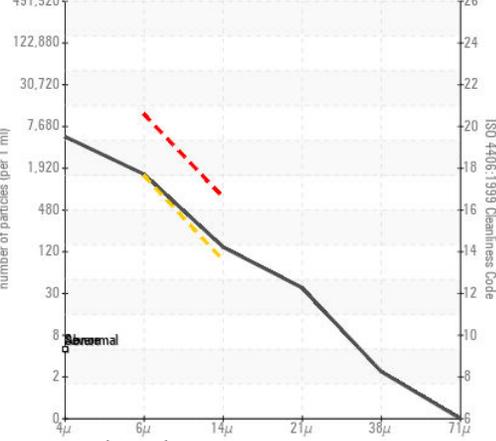

Acid Number

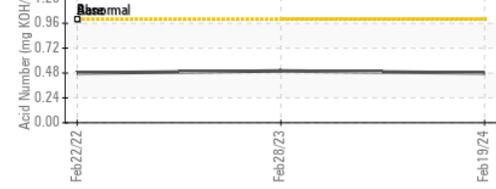

Laboratory : WearCheck USA - 501 Madison Ave., Cary, NC 27513
Sample No. : KCPA015126 **Received** : 26 Feb 2024
Lab Number : 06100985 **Tested** : 28 Feb 2024
Unique Number : 10899215 **Diagnosed** : 28 Feb 2024 - Jonathan Hester
Test Package : IND 2 (Additional Tests: KF, PrtCount)

MIKROS ENGINEERING
 8755 WYOMING AVE N
 MINNEAPOLIS, MN
 US 55445
 Contact: Service Manager

To discuss this sample report, contact Customer Service at 1-800-237-1369.
 * - Denotes test methods that are outside of the ISO 17025 scope of accreditation.
 Statements of conformity to specifications are based on the simple acceptance decision rule (JCGM 106:2012)

T:
F: