

OIL ANALYSIS REPORT

KAESER SK 15 AIRCENTER 3801743 (S/N 1301) Component

Compressor

KAESER SIGMA (OEM) S-460 (--- GAL)

DIAGNOSIS

Recommendation

Oil and filter change at the time of sampling has been noted. Resample at the next service interval to monitor.

Wear


All component wear rates are normal.

Contamination

There is a high amount of particulates present in the oil.

Fluid Condition

The AN level is acceptable for this fluid. The condition of the oil is suitable for further service.

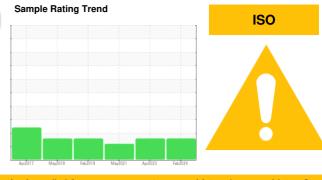

SAMPLE INFORM	ATION	method	limit/base	current	history1	history2
Sample Number		Client Info		KCPA013132	KCP53840	KCP35828
Sample Date		Client Info		16 Feb 2024	28 Apr 2023	25 May 2021
Machine Age	hrs	Client Info		32735	31069	26610
Oil Age	hrs	Client Info		1666	3409	2665
Oil Changed		Client Info		Changed	Changed	N/A
Sample Status				ABNORMAL	ABNORMAL	ABNORMAL
WEAR METALS		method	limit/base	current	history1	history2
Iron	ppm	ASTM D5185m	>50	0	<1	<1
Chromium	ppm	ASTM D5185m	>10	<1	0	0
Nickel	ppm	ASTM D5185m	>3	0	0	0
Titanium	ppm	ASTM D5185m	>3	0	0	0
Silver	ppm	ASTM D5185m	>2	0	0	<1
Aluminum	ppm	ASTM D5185m	>10	2	0	<1
Lead	ppm	ASTM D5185m	>10	0	0	0
Copper	ppm	ASTM D5185m		4	3	5
Tin	ppm	ASTM D5185m	>10	0	0	0
Antimony	ppm	ASTM D5185m	-			0
Vanadium	ppm	ASTM D5185m		0	0	0
Cadmium	ppm	ASTM D5185m		0	0	0
ADDITIVES	ppm	method	limit/base	-	-	
			inniv base	current	history1	history2
Boron	ppm	ASTM D5185m	00	0	0	10
Barium	ppm	ASTM D5185m	90	9	10	0
Molybdenum	ppm	ASTM D5185m		0	0	0
Manganese	ppm	ASTM D5185m		0	0	<1
Magnesium	ppm	ASTM D5185m	90	9	18	<1
Calcium	ppm	ASTM D5185m	2	0	<1	0
Phosphorus	ppm	ASTM D5185m		28	1	2
Zinc	ppm	ASTM D5185m		18	20	5
Sulfur	ppm	ASTM D5185m		18067	20055	17134
CONTAMINANTS		method	limit/base	current	history1	history2
Silicon	ppm	ASTM D5185m	>25	0	<1	1
Sodium	ppm	ASTM D5185m		0	<1	<1
Potassium	ppm	ASTM D5185m		1	<1	0
Water	%	ASTM D6304	>0.05	0.006	0.017	0.008
ppm Water	ppm	ASTM D6304	>500	66	171.1	80.1
FLUID CLEANLIN	IESS	method	limit/base	current	history1	history2
Particles >4µm		ASTM D7647		5805	13263	12872
Particles >6µm		ASTM D7647	>1300	<u> </u>	2 917	A 2961
Particles >14µm		ASTM D7647	>80	<u> </u>	159	<u> </u>
Particles >21µm		ASTM D7647	>20	<u> </u>	<u> </u>	<u> </u>
Particles >38µm		ASTM D7647	>4	0	4	2
Particles >71µm		ASTM D7647	>3	0	0	0
Oil Cleanliness		ISO 4406 (c)	>/17/13	A 20/18/15	2 1/19/14	▲ 19/15
FLUID DEGRADA	TION	method	limit/base	current	history1	history2
Acid Number (AN)	ma KOU/a		0.4	0.40	0.46	0.471

Acid Number (AN)

mg KOH/g ASTM D8045 0.4

0.40 0.46 0.471


Report Id: CRELEE [WUSCAR] 06100988 (Generated: 02/28/2024 16:39:31) Rev: 1

Contact/Location: SERVICE MANAGER ? - CRELEE




OIL ANALYSIS REPORT

VISUAL





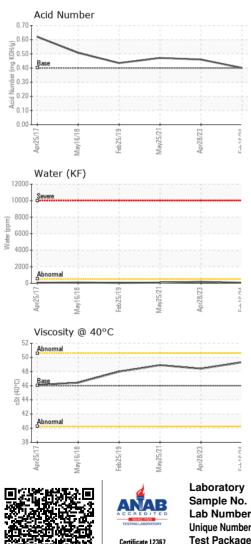


White Metal	scalar	*Visual	NONE	NONE	NONE	NONE
Yellow Metal	scalar	*Visual	NONE	NONE	NONE	NONE
Precipitate	scalar	*Visual	NONE	NONE	NONE	NONE
Silt	scalar	*Visual	NONE	NONE	NONE	NONE
Debris	scalar	*Visual	NONE	LIGHT	NONE	NONE
Sand/Dirt	scalar	*Visual	NONE	NONE	NONE	NONE
Appearance	scalar	*Visual	NORML	NORML	NORML	NORML
Odor	scalar	*Visual	NORML	NORML	NORML	NORML
Emulsified Water	scalar	*Visual	>0.05	NEG	NEG	NEG
Free Water	scalar	*Visual		NEG	NEG	NEG
FLUID PROPERTIES		method	limit/base	current	history1	history2
Visc @ 40°C	cSt	ASTM D445	46	49.3	48.4	48.9
SAMPLE IMAGES		method	limit/base	current	history1	history2
Color						

limit/base

current


method



history1

history2

Bottom

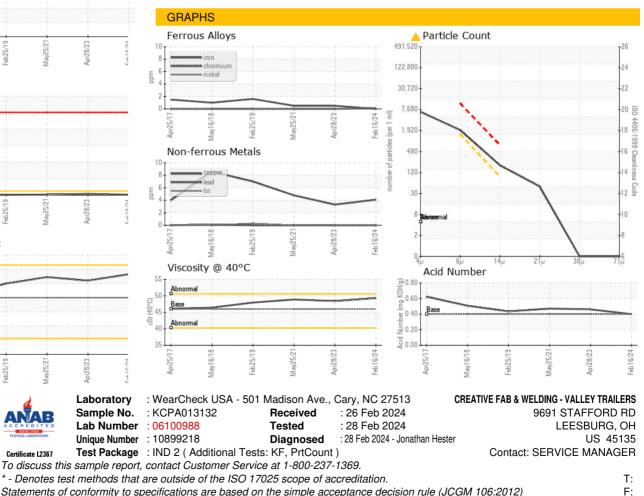

Statements of conformity to specifications are based on the simple acceptance decision rule (JCGM 106:2012)