

OIL ANALYSIS REPORT

Sample Rating Trend



NORMAL



FRICK C-3 (S/N SGC19180738)

Component

Refrigeration Compressor

USPI 1009-68 SC (--- GAL)

DIAGNOSIS

Recommendation

Resample at the next service interval to monitor.

Wear

All component wear rates are normal.

Contamination

There is no indication of any contamination in the oil. The amount and size of particulates present in the system are acceptable.


Fluid Condition

The AN level is acceptable for this fluid. The condition of the oil is suitable for further service.


w2012 Jul2013 Sep2014 Jul2015 Jul2016 Sep2017 Jan2019 Apr2020 Dec2021 Jun2023								
SAMPLE INFORM	MATION	method	limit/base	current	history1	history2		
Sample Number		Client Info		USP240280	USP243259	USP243258		
Sample Date		Client Info		21 Feb 2024	04 Oct 2023	14 Jun 2023		
Machine Age	hrs	Client Info		121808	119138	116433		
Oil Age	hrs	Client Info		0	0	0		
Oil Changed		Client Info		N/A	N/A	N/A		
Sample Status				NORMAL	NORMAL	ATTENTION		
WEAR METALS		method	limit/base	current	history1	history2		
Iron	ppm	ASTM D5185m	>8	11	9	11		
Chromium	ppm	ASTM D5185m	>2	<1	0	0		
Nickel	ppm	ASTM D5185m		0	<1	<1		
Titanium	ppm	ASTM D5185m		0	0	0		
Silver	ppm	ASTM D5185m	>2	0	0	0		
Aluminum	ppm	ASTM D5185m	>3	0	0	0		
Lead	ppm	ASTM D5185m	>2	0	0	0		
Copper	ppm	ASTM D5185m	>8	<1	0	0		
Tin	ppm	ASTM D5185m	>4	0	0	0		
Vanadium	ppm	ASTM D5185m		0	0	0		
Cadmium	ppm	ASTM D5185m		0	0	0		
ADDITIVES		method	limit/base	current	history1	history2		
Boron	ppm	ASTM D5185m		0	0	0		
Barium	ppm	ASTM D5185m		0	<1	0		
Molybdenum	ppm	ASTM D5185m		0	0	0		
Manganese	ppm	ASTM D5185m		0	0	0		
Magnesium	ppm	ASTM D5185m		<1	0	<1		
Calcium	ppm	ASTM D5185m		<1	<1	<1		
Phosphorus	ppm	ASTM D5185m		0	0	0		
Zinc	ppm	ASTM D5185m		6	0	0		
Sulfur	ppm	ASTM D5185m	50	404	544	560		
CONTAMINANTS		method	limit/base	current	history1	history2		
Silicon	ppm	ASTM D5185m	>15	6	7	6		
Sodium	ppm	ASTM D5185m		0	0	0		
Potassium	ppm	ASTM D5185m	>20	<1	<1	<1		
Water	%	ASTM D6304	>0.01	0.001	0.00	0.00		
ppm Water	ppm	ASTM D6304	>100	14	0.00	0.00		
FLUID CLEANLIN	IESS	method	limit/base	current	history1	history2		
Particles >4µm		ASTM D7647	>10000	7506	5704	1 6083		
Particles >6µm		ASTM D7647	>2500	1561	1279	4 194		
Particles >14μm		ASTM D7647	>320	51	50	100		
Particles >21µm		ASTM D7647	>80	7	9	8		
Particles >38μm		ASTM D7647	>20	0	1	0		
Particles >71µm		ASTM D7647	>4	0	0	0		
Oil Cleanliness		ISO 4406 (c)	>20/18/15	20/18/13	20/17/13	1 21/19/14		
FLUID DEGRADA	TION	method	limit/base	current	history1	history2		
Acid Number (AN)	mg KOH/g	ASTM D974	0.005	0.014	0.026	0.031		





OIL ANALYSIS REPORT




140k -		4μm 6μm							1
120k	******	14μm							1
100k -									11
80k -									11
60k -									11
UUK									
40k									fal.
40k -	lemon							٨	N
40k - 20k - Abr	normal						٨	1	M
40k - Abr	-	4	2	9	1 1	-6	202	1 2	M S
40k - 20k - Abr	Juli/13	Sep16/14	Jul15/15	Jul28/16	Sep28/17	Jan8/19	Apr22/20	Dec29/21	Jun14/23







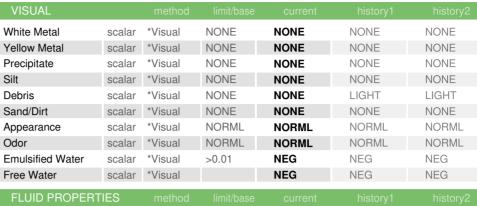

Visc @ 40°C	cSt	ASTM D445	67	69.4	70.3	69.7

SAMPLE IMAGES



Color



GRAPHS Ferrous Alloys Particle Count 491.52 122,88 1,920 Non-ferrous Metals 480 120 Viscosity @ 40°C Acid Number (mg KOH/g) 0.03 5 0.02 Base 0.00 PG Jun14/23



Certificate L2367

Laboratory Sample No. Lab Number

Test Package : IND 2

: USP240280 : 06101046 **Unique Number** : 10899276

: WearCheck USA - 501 Madison Ave., Cary, NC 27513 Received **Tested**

: 26 Feb 2024 : 27 Feb 2024

: 27 Feb 2024 - Doug Bogart Diagnosed

ASSOCIATED WHOLESALE GROCERS

5600 S COUNCIL RD OKLAHOMA CITY, OK US 73179

Contact: CHRIS DUNCAN cnduncan@awginc.com T: (405)518-3568

To discuss this sample report, contact Customer Service at 1-800-237-1369. * - Denotes test methods that are outside of the ISO 17025 scope of accreditation.

Statements of conformity to specifications are based on the simple acceptance decision rule (JCGM 106:2012)

F: