




# OIL ANALYSIS REPORT

Sample Rating Trend

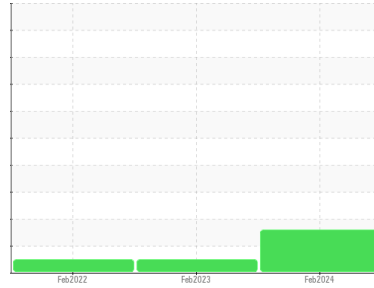

DIRT



Machine Id  
**DEARBORN HEIGHTS - D060911962**

Component  
**Diesel Engine**

Fluid  
**NAPA Motor Oil 15W40 (--- GAL)**

## DIAGNOSIS

### Recommendation

No corrective action is recommended at this time. Resample at the next service interval to monitor.

### Wear

All component wear rates are normal.

### Contamination

Elemental level of silicon (Si) above normal.

### Fluid Condition

The BN result indicates that there is suitable alkalinity remaining in the oil. The condition of the oil is acceptable for the time in service.

## SAMPLE INFORMATION

	method	limit/base	current	history1	history2
Sample Number	Client Info		<b>WC0894387</b>	WC0771505	WC0636997
Sample Date	Client Info		<b>23 Feb 2024</b>	22 Feb 2023	17 Feb 2022
Machine Age	hrs	Client Info	<b>573</b>	383	362
Oil Age	hrs	Client Info	<b>15</b>	15	28
Oil Changed	Client Info		<b>Not Chngd</b>	Not Chngd	Not Chngd
Sample Status			<b>ABNORMAL</b>	NORMAL	NORMAL

## CONTAMINATION

	method	limit/base	current	history1	history2
Fuel	WC Method	>3.0	<b>&lt;1.0</b>	<1.0	<1.0
Water	WC Method	>0.2	<b>NEG</b>	NEG	NEG
Glycol	WC Method		<b>NEG</b>	NEG	NEG

## WEAR METALS

	method	limit/base	current	history1	history2	
Iron	ppm	ASTM D5185m	>90	<b>2</b>	2	6
Chromium	ppm	ASTM D5185m	>20	<b>0</b>	0	<1
Nickel	ppm	ASTM D5185m	>2	<b>0</b>	0	0
Titanium	ppm	ASTM D5185m	>2	<b>0</b>	0	0
Silver	ppm	ASTM D5185m	>2	<b>0</b>	0	0
Aluminum	ppm	ASTM D5185m	>20	<b>&lt;1</b>	2	2
Lead	ppm	ASTM D5185m	>40	<b>0</b>	0	<1
Copper	ppm	ASTM D5185m	>330	<b>&lt;1</b>	0	1
Tin	ppm	ASTM D5185m	>15	<b>0</b>	0	<1
Antimony	ppm	ASTM D5185m		<b>---</b>	---	0
Vanadium	ppm	ASTM D5185m		<b>0</b>	0	0
Cadmium	ppm	ASTM D5185m		<b>0</b>	0	0

## ADDITIVES

	method	limit/base	current	history1	history2	
Boron	ppm	ASTM D5185m		<b>9</b>	109	417
Barium	ppm	ASTM D5185m		<b>0</b>	0	0
Molybdenum	ppm	ASTM D5185m		<b>6</b>	91	90
Manganese	ppm	ASTM D5185m		<b>0</b>	<1	<1
Magnesium	ppm	ASTM D5185m		<b>33</b>	39	429
Calcium	ppm	ASTM D5185m		<b>2193</b>	2134	1412
Phosphorus	ppm	ASTM D5185m		<b>898</b>	1021	850
Zinc	ppm	ASTM D5185m		<b>1020</b>	1260	935
Sulfur	ppm	ASTM D5185m		<b>3682</b>	4227	2459

## CONTAMINANTS

	method	limit/base	current	history1	history2	
Silicon	ppm	ASTM D5185m	>25	<b>▲ 32</b>	23	6
Sodium	ppm	ASTM D5185m		<b>&lt;1</b>	<1	<1
Potassium	ppm	ASTM D5185m	>20	<b>1</b>	0	0

## INFRA-RED

	method	limit/base	current	history1	history2	
Soot %	%	*ASTM D7844	>6	<b>0.1</b>	0.4	0.1
Nitration	Abs/cm	*ASTM D7624	>20	<b>5.1</b>	7.1	5.1
Sulfation	Abs/.1mm	*ASTM D7415	>30	<b>15.2</b>	18.3	20.8


## FLUID DEGRADATION

	method	limit/base	current	history1	history2	
Oxidation	Abs/.1mm	*ASTM D7414	>25	<b>8.8</b>	13.3	14.9
Base Number (BN)	mg KOH/g	ASTM D2896		<b>7.3</b>	7.2	9.1




# OIL ANALYSIS REPORT


▲ Silicon (ppm)

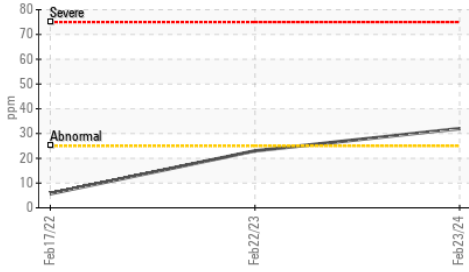

Base Number

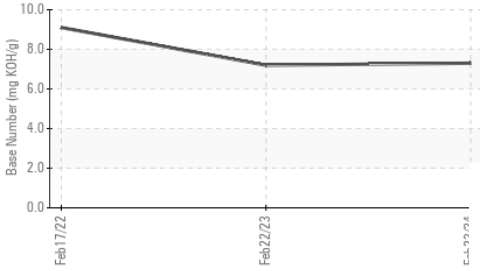

Viscosity @ 100°C

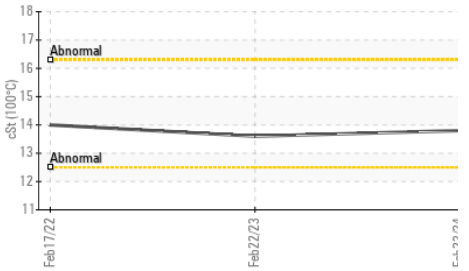


VISUAL	method	limit/base	current	history1	history2
White Metal	scalar	*Visual	NONE	NONE	NONE
Yellow Metal	scalar	*Visual	NONE	NONE	NONE
Precipitate	scalar	*Visual	NONE	NONE	NONE
Silt	scalar	*Visual	NONE	NONE	NONE
Debris	scalar	*Visual	NONE	NONE	LIGHT
Sand/Dirt	scalar	*Visual	NONE	NONE	NONE
Appearance	scalar	*Visual	NORML	NORML	NORML
Odor	scalar	*Visual	NORML	NORML	NORML
Emulsified Water	scalar	*Visual	>0.2	NEG	NEG
Free Water	scalar	*Visual		NEG	NEG


FLUID PROPERTIES	method	limit/base	current	history1	history2
Visc @ 100°C	cSt	ASTM D445	13.8	13.6	14.0

## GRAPHS


Iron (ppm)

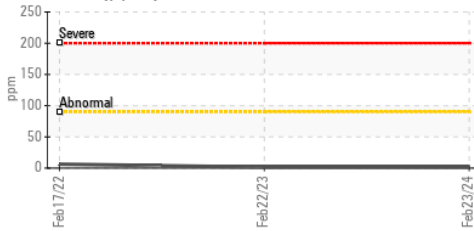


Lead (ppm)

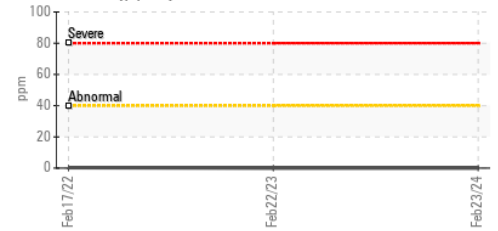


Aluminum (ppm)

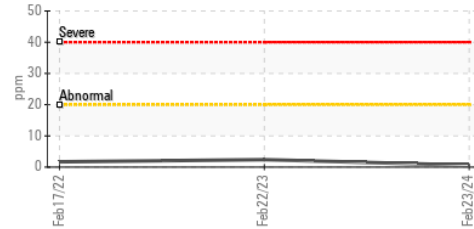


Chromium (ppm)

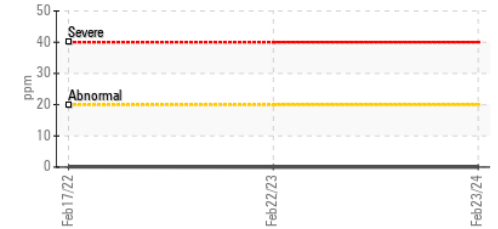


Copper (ppm)

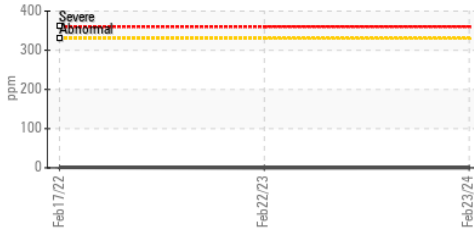


▲ Silicon (ppm)

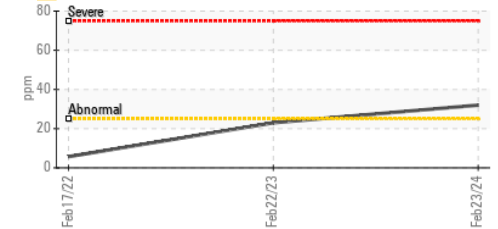

Viscosity @ 100°C

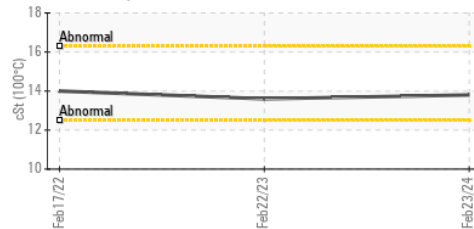

Base Number

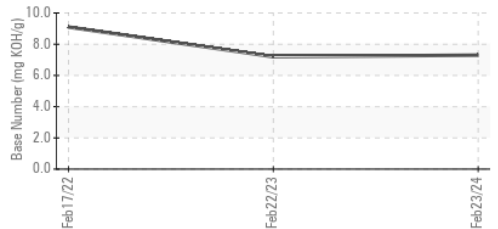

Certificate L2367

Laboratory : WearCheck USA - 501 Madison Ave., Cary, NC 27513  
 Sample No. : WC0894387 Received : 27 Feb 2024  
 Lab Number : 06101316 Tested : 28 Feb 2024  
 Unique Number : 10899546 Diagnosed : 28 Feb 2024 - Don Baldrige  
 Test Package : MOB 1 ( Additional Tests: TBN )

**NATIONAL POWER CORP**  
 4541 PRESLYN DR  
 RALEIGH, NC  
 US 27616  
 Contact: BRANDON RICE  
 brandon.rice@natpow.com

To discuss this sample report, contact Customer Service at 1-800-237-1369.

\* - Denotes test methods that are outside of the ISO 17025 scope of accreditation.

Statements of conformity to specifications are based on the simple acceptance decision rule (JCGM 106:2012)

T: (919)790-9714