




OIL ANALYSIS REPORT

Sample Rating Trend

NORMAL

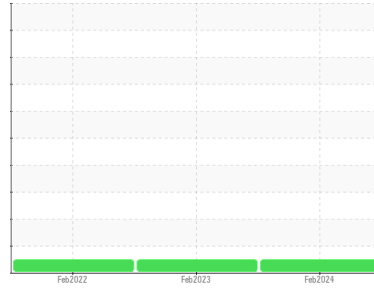

Machine Id
GARDEN CITY - 0646264
 Component
Diesel Engine
 Fluid
NAPA Motor Oil 15W40 (--- GAL)

DIAGNOSIS

Recommendation

Resample at the next service interval to monitor.

Wear

Metal levels are typical for a new component breaking in.

Contamination

There is no indication of any contamination in the oil.

Fluid Condition

The BN result indicates that there is suitable alkalinity remaining in the oil. The condition of the oil is suitable for further service.

SAMPLE INFORMATION		method	limit/base	current	history1	history2
Sample Number	Client Info			WC0894383	WC0771506	WC0637074
Sample Date	Client Info			23 Feb 2024	22 Feb 2023	16 Feb 2022
Machine Age	hrs	Client Info		829	714	683
Oil Age	hrs	Client Info		76	21	16
Oil Changed	Client Info			Not Chngd	Not Chngd	Not Chngd
Sample Status				NORMAL	NORMAL	NORMAL

CONTAMINATION		method	limit/base	current	history1	history2
Fuel	WC Method	>5		<1.0	<1.0	<1.0
Water	WC Method	>0.2		NEG	NEG	NEG
Glycol	WC Method			NEG	NEG	NEG

WEAR METALS		method	limit/base	current	history1	history2
Iron	ppm	ASTM D5185m	>100	3	<1	4
Chromium	ppm	ASTM D5185m	>20	0	0	<1
Nickel	ppm	ASTM D5185m	>4	0	0	0
Titanium	ppm	ASTM D5185m		0	0	0
Silver	ppm	ASTM D5185m	>3	0	0	<1
Aluminum	ppm	ASTM D5185m	>20	2	<1	5
Lead	ppm	ASTM D5185m	>40	0	0	<1
Copper	ppm	ASTM D5185m	>330	<1	0	1
Tin	ppm	ASTM D5185m	>15	0	0	<1
Antimony	ppm	ASTM D5185m		---	---	0
Vanadium	ppm	ASTM D5185m		0	0	0
Cadmium	ppm	ASTM D5185m		0	0	0

ADDITIVES		method	limit/base	current	history1	history2
Boron	ppm	ASTM D5185m		353	199	74
Barium	ppm	ASTM D5185m		0	0	0
Molybdenum	ppm	ASTM D5185m		78	24	86
Manganese	ppm	ASTM D5185m		0	<1	<1
Magnesium	ppm	ASTM D5185m		385	17	35
Calcium	ppm	ASTM D5185m		1582	2158	2207
Phosphorus	ppm	ASTM D5185m		967	1006	1038
Zinc	ppm	ASTM D5185m		1113	1222	1112
Sulfur	ppm	ASTM D5185m		3235	4071	3181



CONTAMINANTS		method	limit/base	current	history1	history2
Silicon	ppm	ASTM D5185m	>25	5	4	3
Sodium	ppm	ASTM D5185m		1	3	25
Potassium	ppm	ASTM D5185m	>20	0	5	1

INFRA-RED		method	limit/base	current	history1	history2
Soot %	%	*ASTM D7844	>3	0.1	0.2	0.1
Nitration	Abs/cm	*ASTM D7624	>20	5.6	7.2	9.6
Sulfation	Abs/.1mm	*ASTM D7415	>30	20.7	18.2	18.8

FLUID DEGRADATION		method	limit/base	current	history1	history2
Oxidation	Abs/.1mm	*ASTM D7414	>25	15.0	13.3	15.7
Base Number (BN)	mg KOH/g	ASTM D2896		8.1	6.5	7.4











OIL ANALYSIS REPORT

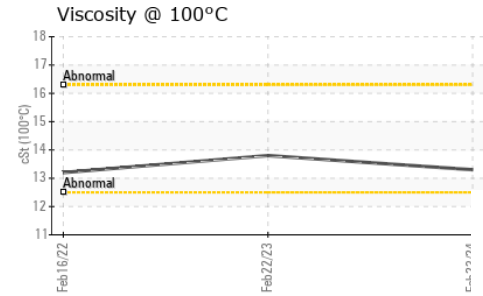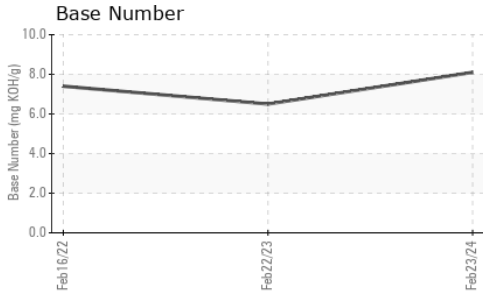

VISUAL	method	limit/base	current	history1	history2
White Metal	scalar	*Visual	NONE	NONE	NONE
Yellow Metal	scalar	*Visual	NONE	NONE	NONE
Precipitate	scalar	*Visual	NONE	NONE	NONE
Silt	scalar	*Visual	NONE	NONE	NONE
Debris	scalar	*Visual	NONE	NONE	NONE
Sand/Dirt	scalar	*Visual	NONE	NONE	NONE
Appearance	scalar	*Visual	NORML	NORML	NORML
Odor	scalar	*Visual	NORML	NORML	NORML
Emulsified Water	scalar	*Visual	>0.2	NEG	NEG
Free Water	scalar	*Visual		NEG	NEG

FLUID PROPERTIES	method	limit/base	current	history1	history2
Visc @ 100°C	cSt	ASTM D445	13.3	13.8	13.2

GRAPHS

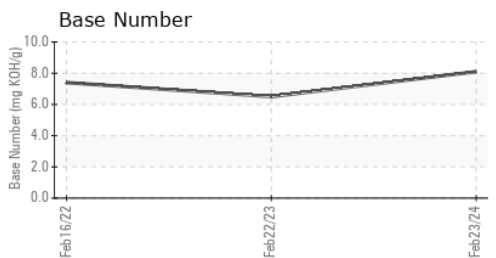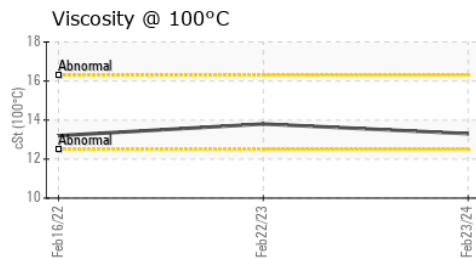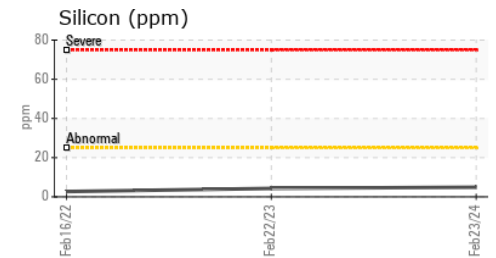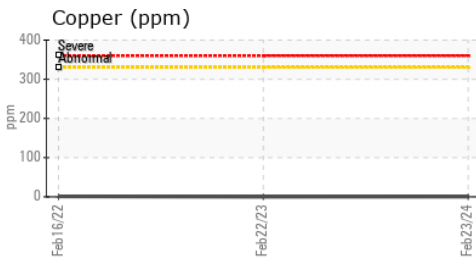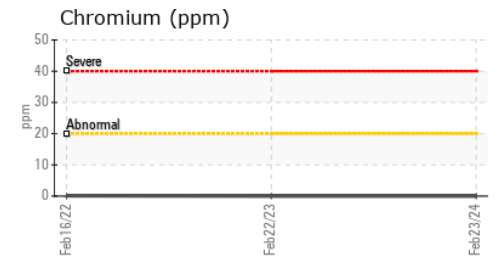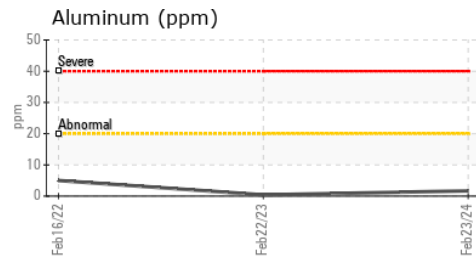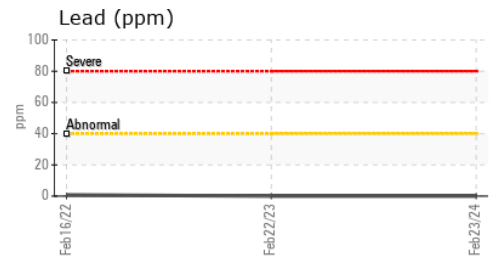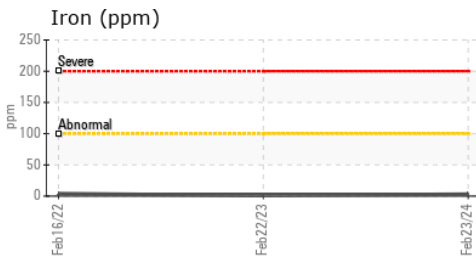

Certificate L2367

Laboratory : WearCheck USA - 501 Madison Ave., Cary, NC 27513
Sample No. : WC0894383 **Received** : 27 Feb 2024
Lab Number : 06101317 **Tested** : 28 Feb 2024
Unique Number : 10899547 **Diagnosed** : 28 Feb 2024 - Wes Davis
Test Package : MOB 1 (Additional Tests: TBN)

NATIONAL POWER CORP
 4541 PRESLYN DR
 RALEIGH, NC
 US 27616
 Contact: BRANDON RICE
 brandon.rice@natpow.com

To discuss this sample report, contact Customer Service at 1-800-237-1369.

* - Denotes test methods that are outside of the ISO 17025 scope of accreditation.

Statements of conformity to specifications are based on the simple acceptance decision rule (JCGM 106:2012)

F: (919)790-9714