




# OIL ANALYSIS REPORT

Sample Rating Trend

**NORMAL**

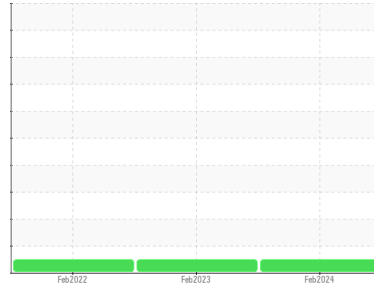

Machine Id  
**SOUTHWEST DETROIT - 3005676058**

Component  
**Diesel Engine**  
Fluid  
**NAPA 5W30 (--- GAL)**

## DIAGNOSIS

### Recommendation

Resample at the next service interval to monitor.

### Wear

All component wear rates are normal.

### Contamination

There is no indication of any contamination in the oil.

### Fluid Condition

The BN result indicates that there is suitable alkalinity remaining in the oil. The condition of the oil is acceptable for the time in service.

SAMPLE INFORMATION		method	limit/base	current	history1	history2
Sample Number	Client Info			<b>WC0894425</b>	WC0771553	WC0637068
Sample Date	Client Info			<b>21 Feb 2024</b>	07 Feb 2023	10 Feb 2022
Machine Age	hrs	Client Info		<b>100</b>	70	42
Oil Age	hrs	Client Info		<b>22</b>	23	20
Oil Changed	Client Info			<b>Not Changed</b>	Not Changed	Not Changed
Sample Status				<b>NORMAL</b>	NORMAL	NORMAL

CONTAMINATION		method	limit/base	current	history1	history2
Fuel	WC Method	>3.0		<b>&lt;1.0</b>	<1.0	<1.0
Water	WC Method	>0.2		<b>NEG</b>	NEG	NEG
Glycol	WC Method			<b>NEG</b>	NEG	NEG

WEAR METALS		method	limit/base	current	history1	history2
Iron	ppm	ASTM D5185m	>200	<b>0</b>	<1	4
Chromium	ppm	ASTM D5185m	>20	<b>0</b>	<1	0
Nickel	ppm	ASTM D5185m	>2	<b>0</b>	0	0
Titanium	ppm	ASTM D5185m	>2	<b>&lt;1</b>	<1	0
Silver	ppm	ASTM D5185m	>2	<b>0</b>	0	0
Aluminum	ppm	ASTM D5185m	>30	<b>&lt;1</b>	0	15
Lead	ppm	ASTM D5185m	>30	<b>0</b>	0	<1
Copper	ppm	ASTM D5185m	>30	<b>&lt;1</b>	0	2
Tin	ppm	ASTM D5185m	>15	<b>0</b>	0	0
Antimony	ppm	ASTM D5185m		<b>---</b>	---	0
Vanadium	ppm	ASTM D5185m		<b>0</b>	0	0
Cadmium	ppm	ASTM D5185m		<b>0</b>	0	0

ADDITIVES		method	limit/base	current	history1	history2
Boron	ppm	ASTM D5185m		<b>146</b>	175	104
Barium	ppm	ASTM D5185m		<b>0</b>	0	0
Molybdenum	ppm	ASTM D5185m		<b>54</b>	46	7
Manganese	ppm	ASTM D5185m		<b>0</b>	0	<1
Magnesium	ppm	ASTM D5185m		<b>483</b>	419	706
Calcium	ppm	ASTM D5185m		<b>1057</b>	1048	1402
Phosphorus	ppm	ASTM D5185m		<b>657</b>	627	687
Zinc	ppm	ASTM D5185m		<b>746</b>	761	771
Sulfur	ppm	ASTM D5185m		<b>2928</b>	2776	2579



CONTAMINANTS		method	limit/base	current	history1	history2
Silicon	ppm	ASTM D5185m	>30	<b>30</b>	27	16
Sodium	ppm	ASTM D5185m		<b>&lt;1</b>	5	4
Potassium	ppm	ASTM D5185m	>20	<b>2</b>	1	2

INFRA-RED		method	limit/base	current	history1	history2
Soot %	%	*ASTM D7844	>3	<b>0</b>	0.1	0.1
Nitration	Abs/cm	*ASTM D7624	>20	<b>4.1</b>	4.5	7.2
Sulfation	Abs/.1mm	*ASTM D7415	>30	<b>13.7</b>	14.1	19.9

FLUID DEGRADATION		method	limit/base	current	history1	history2
Oxidation	Abs/.1mm	*ASTM D7414	>25	<b>6.7</b>	7.1	15.3
Base Number (BN)	mg KOH/g	ASTM D2896		<b>6.3</b>	6.8	8.6











# OIL ANALYSIS REPORT

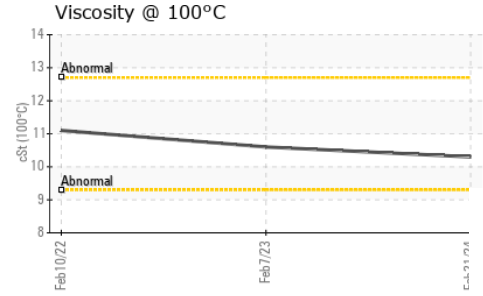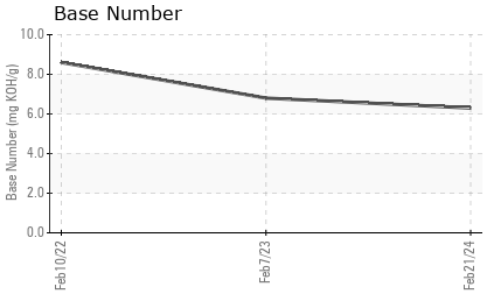

VISUAL	method	limit/base	current	history1	history2
White Metal	scalar	*Visual	NONE	NONE	LIGHT
Yellow Metal	scalar	*Visual	NONE	NONE	NONE
Precipitate	scalar	*Visual	NONE	NONE	NONE
Silt	scalar	*Visual	NONE	NONE	NONE
Debris	scalar	*Visual	NONE	NONE	NONE
Sand/Dirt	scalar	*Visual	NONE	NONE	NONE
Appearance	scalar	*Visual	NORML	NORML	NORML
Odor	scalar	*Visual	NORML	NORML	NORML
Emulsified Water	scalar	*Visual	>0.2	NEG	NEG
Free Water	scalar	*Visual		NEG	NEG

FLUID PROPERTIES	method	limit/base	current	history1	history2
Visc @ 100°C	cSt	ASTM D445	<b>10.3</b>	10.6	11.1

### GRAPHS

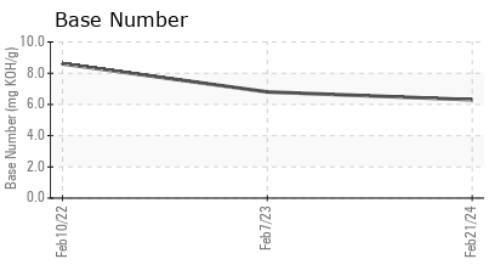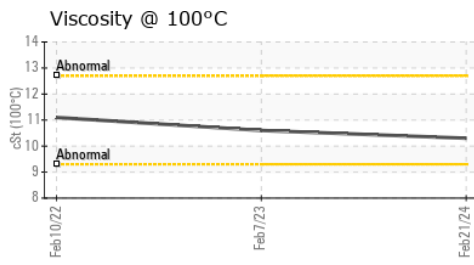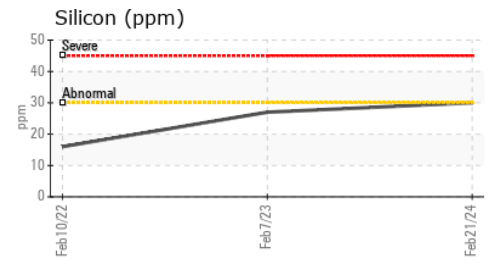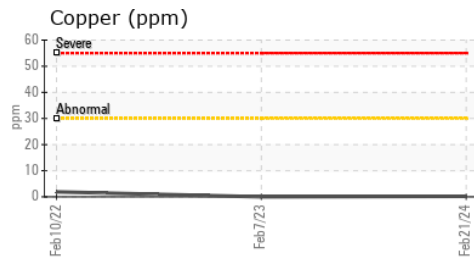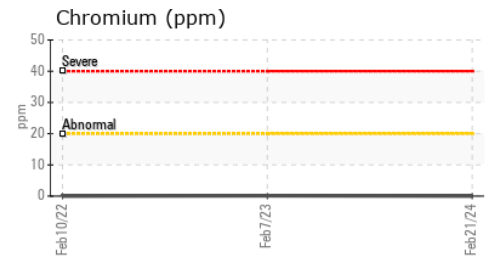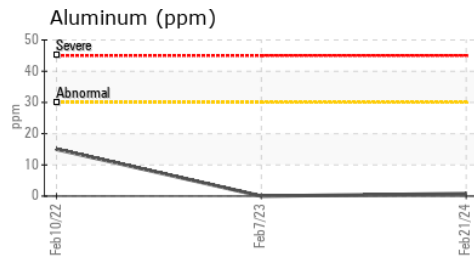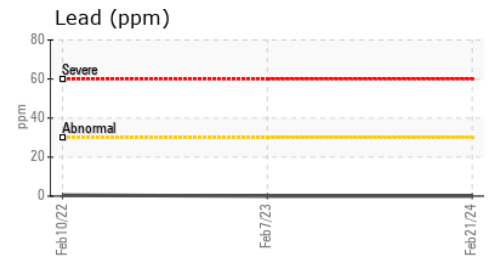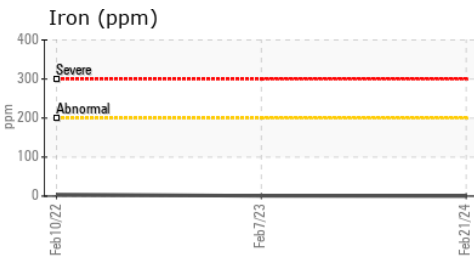

Certificate L2367

**Laboratory** : WearCheck USA - 501 Madison Ave., Cary, NC 27513  
**Sample No.** : WC0894425      **Received** : 27 Feb 2024  
**Lab Number** : **06101325**      **Tested** : 28 Feb 2024  
**Unique Number** : 10899555      **Diagnosed** : 28 Feb 2024 - Don Baldrige  
**Test Package** : MOB 1 ( Additional Tests: TBN )

**NATIONAL POWER CORP**  
 4541 PRESLYN DR  
 RALEIGH, NC  
 US 27616  
 Contact: BRANDON RICE  
 brandon.rice@natpow.com  
 T:  
 F: (919)790-9714

To discuss this sample report, contact Customer Service at 1-800-237-1369.  
 \* - Denotes test methods that are outside of the ISO 17025 scope of accreditation.  
 Statements of conformity to specifications are based on the simple acceptance decision rule (JCGM 106:2012)