


OIL ANALYSIS REPORT

Sample Rating Trend







WP29 MVR112-5 effect

Component **Hydraulic System**

MOBIL DTE 25 (93 GAL)

Recommendation

Resample at the next service interval to monitor.

All component wear rates are normal.

Contamination

The system cleanliness is acceptable for your target ISO 4406 cleanliness code. The system and fluid cleanliness is acceptable.

Fluid Condition

The AN level is acceptable for this fluid. The condition of the oil is suitable for further service.

		52023 Apr20	23 May2023 Aug2023	Sep2023 Nov2023 Dec2023	Jan2024	
SAMPLE INFORM	MATION	method	limit/base	current	history1	history2
Sample Number		Client Info		WC0859509	WC0884106	WC0884104
Sample Date		Client Info		19 Feb 2024	12 Feb 2024	05 Feb 2024
Machine Age	hrs	Client Info		0	0	0
Oil Age	hrs	Client Info		0	0	0
Oil Changed		Client Info		N/A	N/A	N/A
Sample Status				NORMAL	NORMAL	NORMAL
CONTAMINATION	٧	method	limit/base	current	history1	history2
Water		WC Method	>0.05	NEG	NEG	NEG
WEAR METALS		method	limit/base	current	history1	history2
Iron	ppm	ASTM D5185m	>20	0	0	0
Chromium	ppm	ASTM D5185m	>20	<1	0	0
Nickel	ppm	ASTM D5185m	>20	0	<1	0
Titanium	ppm	ASTM D5185m		0	0	0
Silver	ppm	ASTM D5185m		0	0	0
Aluminum	ppm	ASTM D5185m	>20	0	<1	0
Lead	ppm	ASTM D5185m	>20	0	<1	0
Copper	ppm	ASTM D5185m	>20	0	0	<1
Tin	ppm	ASTM D5185m	>20	0	<1	0
Vanadium	ppm	ASTM D5185m		0	0	0
Cadmium	ppm	ASTM D5185m		0	0	0
ADDITIVES		method	limit/base	current	history1	history2
Boron	ppm	ASTM D5185m		0	0	0
Barium	ppm	ASTM D5185m		0	0	0
Molybdenum	ppm	ASTM D5185m		0	0	0
Manganese	ppm	ASTM D5185m		<1	0	<1
Magnesium	ppm	ASTM D5185m		3	2	1
Calcium	ppm	ASTM D5185m		84	54	86
Phosphorus	ppm	ASTM D5185m		405	324	453
Zinc	ppm	ASTM D5185m		609	520	621
Sulfur	ppm	ASTM D5185m		2182	810	2317
CONTAMINANTS		method	limit/base	current	history1	history2
Silicon	ppm	ASTM D5185m	>15	<1	<1	<1
Sodium	ppm	ASTM D5185m		0	<1	2
Potassium	ppm	ASTM D5185m	>20	0	2	0
FLUID CLEANLIN	IESS	method	limit/base	current	history1	history2
Particles >4μm		ASTM D7647	>5000	606	185	369
Particles >6µm		ASTM D7647	>1300	108	76	85
Particles >14µm		ASTM D7647	>160	6	12	7
Particles >21µm		ASTM D7647	>40	2	3	1
Particles >38µm		ASTM D7647	>10	0	0	0
Particles >71μm		ASTM D7647	>3	0	0	0
Oil Cleanliness		ISO 4406 (c)	>19/17/14	16/14/10	15/13/11	16/14/10
FLUID DEGRADA	TION _	method	limit/base	current	history1	history2
A ! (ANI)	1/011/	AOTH Doors		0.02	0.40	0.70

Acid Number (AN)

mg KOH/g ASTM D8045


0.42


0.83


0.79




OIL ANALYSIS REPORT









VISUAL		method				history2
White Metal	scalar	*Visual	NONE	NONE	NONE	NONE
Yellow Metal	scalar	*Visual	NONE	NONE	NONE	NONE
Precipitate	scalar	*Visual	NONE	NONE	NONE	NONE
Silt	scalar	*Visual	NONE	NONE	NONE	NONE
Debris	scalar	*Visual	NONE	NONE	NONE	NONE
Sand/Dirt	scalar	*Visual	NONE	NONE	NONE	NONE
Appearance	scalar	*Visual	NORML	NORML	NORML	NORML
Odor	scalar	*Visual	NORML	NORML	NORML	NORML
Emulsified Water	scalar	*Visual	>0.05	NEG	NEG	NEG
Free Water	scalar	*Visual		NEG	NEG	NEG
		ام مالم مما	line it/le e e e		المرسمة ما	histow.0


FLUID PROPERT	IES	method			history1	history2
Visc @ 40°C	cSt	ASTM D445	44.2	47.4	43.8	47.9

SAMPLE IMAGES	method	

Color

Bottom



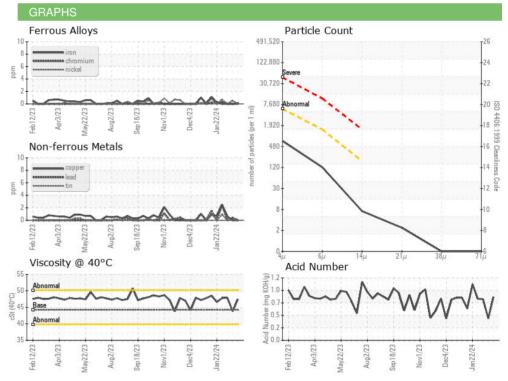





Certificate L2367

Laboratory Sample No.

: WC0859509 Lab Number : 06101579 Unique Number: 10899809 Test Package : IND 2

To discuss this sample report, contact Customer Service at 1-800-237-1369. * - Denotes test methods that are outside of the ISO 17025 scope of accreditation.

: WearCheck USA - 501 Madison Ave., Cary, NC 27513 Received : 27 Feb 2024 : 28 Feb 2024 **Tested**

> : 28 Feb 2024 - Wes Davis Diagnosed

LEPRINO FOODS-ROSWELL

5600 OMAHA RD ROSWELL, NM US 88203

Contact: VINCENT MCINTIRE vmcintire@leprinofoods.com

Statements of conformity to specifications are based on the simple acceptance decision rule (JCGM 106:2012)

T: F: (505)347-5728