


OIL ANALYSIS REPORT

Sample Rating Trend



WATER

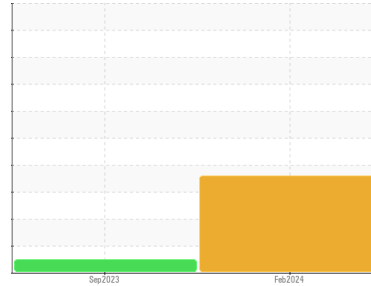

Machine Id
KAESER 7946992

Component
Compressor

Fluid
KAESER SIGMA (OEM) S-460 (--- QTS)

DIAGNOSIS

▲ Recommendation

The filter change at the time of sampling has been noted. We advise that you stop the unit and follow the water drain-off procedure for this component. We recommend an early resample in 500 hours to monitor this condition.

Wear

All component wear rates are normal.

▲ Contamination

There is a high amount of particulates present in the oil. There is a light concentration of water present in the oil.

Fluid Condition

The AN level is acceptable for this fluid. The condition of the oil is suitable for further service.

SAMPLE INFORMATION

method	limit/base	current	history1	history2
Sample Number	Client Info	KC122572	KC110811	---
Sample Date	Client Info	14 Feb 2024	20 Sep 2023	---
Machine Age	hrs	4189	3552	---
Oil Age	hrs	0	600	---
Oil Changed	Client Info	N/A	Changed	---
Sample Status		ABNORMAL	NORMAL	---

WEAR METALS

method	limit/base	current	history1	history2	
Iron	ppm	ASTM D5185m >50	0	0	---
Chromium	ppm	ASTM D5185m >10	<1	0	---
Nickel	ppm	ASTM D5185m >3	0	0	---
Titanium	ppm	ASTM D5185m >3	0	0	---
Silver	ppm	ASTM D5185m >2	0	0	---
Aluminum	ppm	ASTM D5185m >10	0	0	---
Lead	ppm	ASTM D5185m >10	<1	0	---
Copper	ppm	ASTM D5185m >50	2	0	---
Tin	ppm	ASTM D5185m >10	0	0	---
Vanadium	ppm	ASTM D5185m	0	0	---
Cadmium	ppm	ASTM D5185m	0	0	---

ADDITIVES

method	limit/base	current	history1	history2	
Boron	ppm	ASTM D5185m	0	0	---
Barium	ppm	ASTM D5185m 90	29	19	---
Molybdenum	ppm	ASTM D5185m	0	0	---
Manganese	ppm	ASTM D5185m	<1	0	---
Magnesium	ppm	ASTM D5185m 90	37	63	---
Calcium	ppm	ASTM D5185m 2	3	3	---
Phosphorus	ppm	ASTM D5185m	2	3	---
Zinc	ppm	ASTM D5185m	5	14	---

CONTAMINANTS

method	limit/base	current	history1	history2	
Silicon	ppm	ASTM D5185m >25	3	0	---
Sodium	ppm	ASTM D5185m	0	7	---
Potassium	ppm	ASTM D5185m >20	0	5	---
Water	%	ASTM D6304 >0.05	▲ 0.332	0.023	---
ppm Water	ppm	ASTM D6304 >500	▲ 3320	239.6	---






FLUID CLEANLINESS

method	limit/base	current	history1	history2
Particles >4µm	ASTM D7647	2714	1571	---
Particles >6µm	ASTM D7647 >1300	▲ 1479	620	---
Particles >14µm	ASTM D7647 >80	▲ 252	41	---
Particles >21µm	ASTM D7647 >20	▲ 85	6	---
Particles >38µm	ASTM D7647 >4	▲ 13	0	---
Particles >71µm	ASTM D7647 >3	1	0	---
Oil Cleanliness	ISO 4406 (c) >--/17/13	▲ 19/18/15	18/16/13	---

FLUID DEGRADATION

method	limit/base	current	history1	history2	
Acid Number (AN)	mg KOH/g	ASTM D8045 0.4	0.30	0.14	---


OIL ANALYSIS REPORT

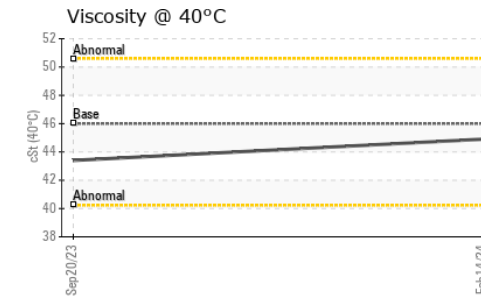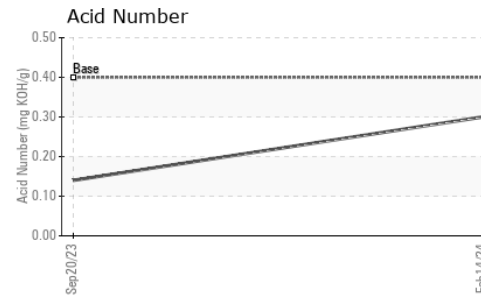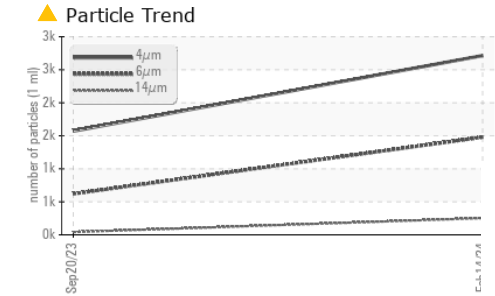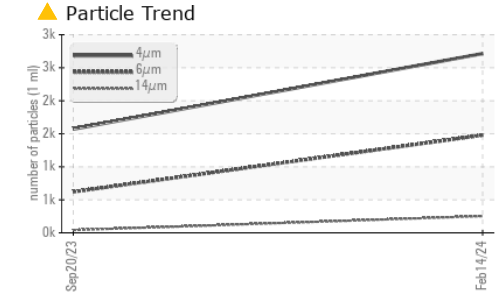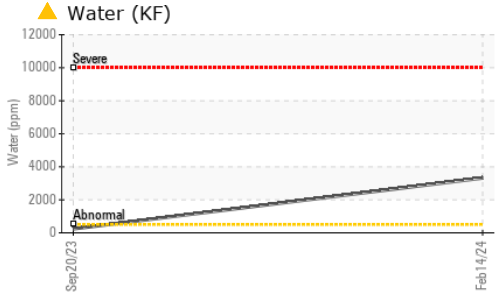






VISUAL	method	limit/base	current	history1	history2
White Metal	scalar	*Visual	NONE	NONE	---
Yellow Metal	scalar	*Visual	NONE	NONE	---
Precipitate	scalar	*Visual	NONE	NONE	---
Silt	scalar	*Visual	NONE	NONE	---
Debris	scalar	*Visual	NONE	NONE	---
Sand/Dirt	scalar	*Visual	NONE	NONE	---
Appearance	scalar	*Visual	NORML	NORML	---
Odor	scalar	*Visual	NORML	NORML	---
Emulsified Water	scalar	*Visual	>0.05	0.2%	NEG
Free Water	scalar	*Visual		NEG	---

FLUID PROPERTIES	method	limit/base	current	history1	history2
Visc @ 40°C	cSt	ASTM D445	46	44.9	43.4

SAMPLE IMAGES	method	limit/base	current	history1	history2
---------------	--------	------------	---------	----------	----------

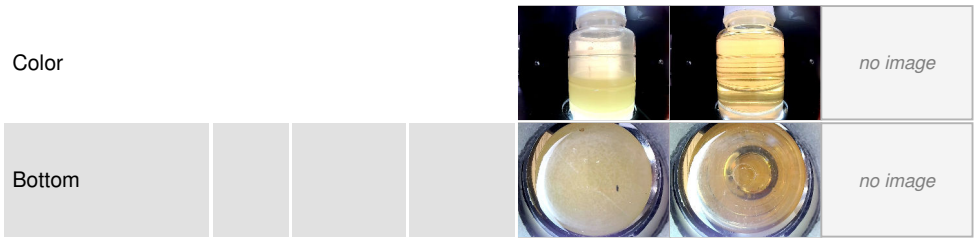

GRAPHS

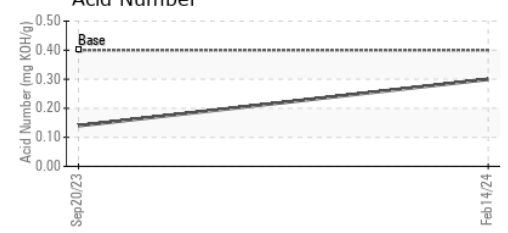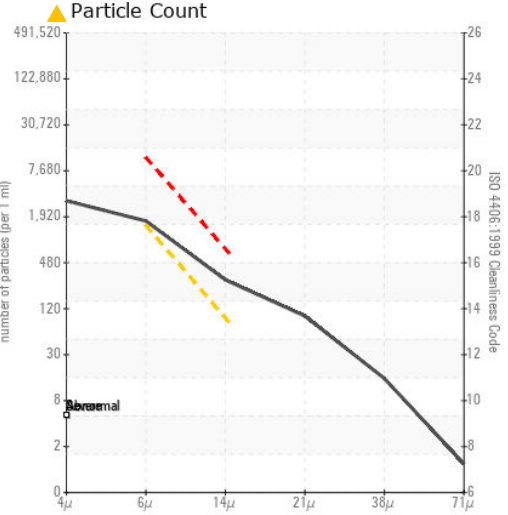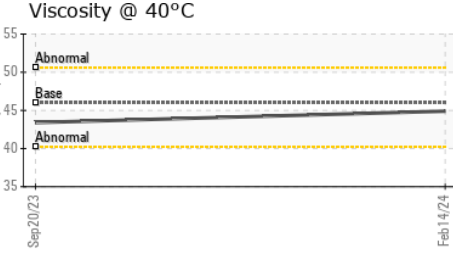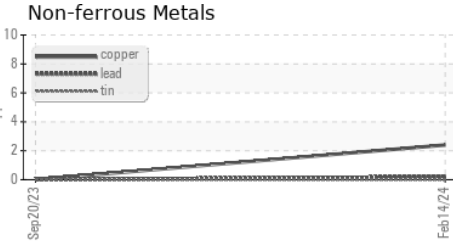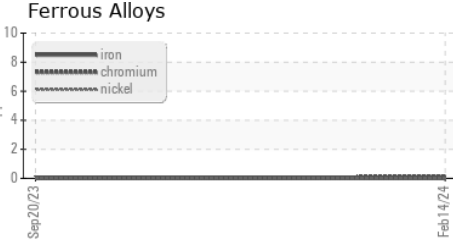

Laboratory : WearCheck USA - 501 Madison Ave., Cary, NC 27513
Sample No. : KC122572 **Received** : 27 Feb 2024
Lab Number : 06101635 **Tested** : 05 Mar 2024
Unique Number : 10899865 **Diagnosed** : 05 Mar 2024 - Jonathan Hester
Test Package : IND 2

AMAZON PIT-9
 17 WILLIAM DR
 IMPERIAL, PA
 US 15126
 Contact: Service Manager

To discuss this sample report, contact Customer Service at 1-800-237-1369.
 * - Denotes test methods that are outside of the ISO 17025 scope of accreditation.
 Statements of conformity to specifications are based on the simple acceptance decision rule (JCGM 106:2012)