


# **OIL ANALYSIS REPORT**



**NORMAL** 



# KAESER 7097213

Component

Compressor

KAESER SIGMA (OEM) S-460 (--- GAL)

### Recommendation

Resample at the next service interval to monitor.

All component wear rates are normal.

### Contamination

There is no indication of any contamination in the oil. The amount and size of particulates present in the system are acceptable.

### **Fluid Condition**

The AN level is acceptable for this fluid. The condition of the oil is suitable for further service.

				Feb 2024		
SAMPLE INFORM	MATION	method	limit/base	current	history1	history2
Sample Number		Client Info		KC06101653		
Sample Date		Client Info		16 Feb 2024		
Machine Age	hrs	Client Info		15392		
Oil Age	hrs	Client Info		0		
Oil Changed		Client Info		N/A		
Sample Status				NORMAL		
WEAR METALS		method	limit/base	current	history1	history2
Iron	ppm	ASTM D5185m	>50	0		
Chromium	ppm	ASTM D5185m	>10	<1		
Nickel	ppm	ASTM D5185m	>3	0		
Titanium	ppm	ASTM D5185m		0		
Silver	ppm	ASTM D5185m	>2	0		
Aluminum	ppm	ASTM D5185m		0		
Lead	ppm	ASTM D5185m	>10	0		
Copper			>50	43		
Tin	ppm	ASTM D5185m	>10	0		
Vanadium		ASTM D5185m	>10	0		
Cadmium	ppm	ASTM D5185m		0		
	ppm	A9 IIVI D3 I03III		0		
ADDITIVES		method	limit/base	current	history1	history2
Boron	ppm	ASTM D5185m		0		
Barium	ppm	ASTM D5185m	90	0		
Molybdenum	ppm	ASTM D5185m		0		
Manganese	ppm	ASTM D5185m		<1		
Magnesium	ppm	ASTM D5185m	90	0		
Calcium	ppm	ASTM D5185m	2	1		
Phosphorus	ppm	ASTM D5185m		0		
Zinc	ppm	ASTM D5185m		<1		
CONTAMINANTS	;	method	limit/base	current	history1	history2
Silicon	ppm	ASTM D5185m	>25	11		
Sodium	ppm	ASTM D5185m		0		
Potassium	ppm	ASTM D5185m	>20	0		
Water	%	ASTM D6304	>0.05	0.003		
ppm Water	ppm	ASTM D6304	>500	39		
FLUID CLEANLIN	IESS	method	limit/base	current	history1	history2
Particles >4µm		ASTM D7647		859		
Particles >6µm		ASTM D7647	>1300	323		
Particles >14µm		ASTM D7647	>80	29		
Particles >21µm		ASTM D7647		7		
Particles >38µm		ASTM D7647	>4	0		
Particles >71µm		ASTM D7647	>3	0		
Oil Cleanliness		ISO 4406 (c)	>/17/13	17/16/12		
On Oleaniness		100 7700 (0)	/ / 1 / / 13	17/10/12		
FLUID DEGRADA	T. C	method	limit/base	current	history1	history2


Acid Number (AN)

mg KOH/g ASTM D8045 0.4

0.38



## **OIL ANALYSIS REPORT**

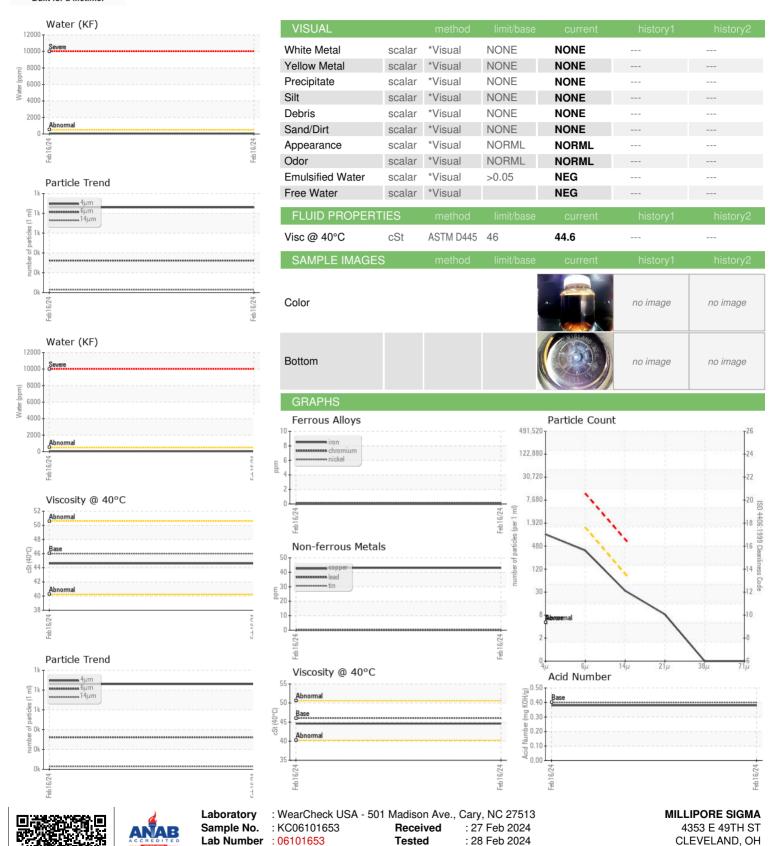

Certificate L2367

Unique Number : 10899883

To discuss this sample report, contact Customer Service at 1-800-237-1369.

\* - Denotes test methods that are outside of the ISO 17025 scope of accreditation.

Test Package : IND 2

: 29 Feb 2024 - Don Baldridge

Diagnosed

Statements of conformity to specifications are based on the simple acceptance decision rule (JCGM 106:2012)

US 44125

T:

F:

Contact: Service Manager