


OIL ANALYSIS REPORT

Sample Rating Trend



VISCOSITY

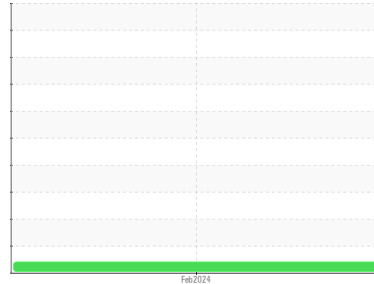

Machine Id
FRICK C-1620

Component
Screw Compressor

Fluid
TULCO LUBSOIL SYN RL WI 100 (300 GAL)

DIAGNOSIS

Recommendation

Resample at the next service interval to monitor.

Wear

All component wear rates are normal.

Contamination

The amount and size of particulates present in the system are acceptable. There is no indication of any contamination in the oil.

Fluid Condition

The oil viscosity is lower than normal. Confirm oil type. The AN level is acceptable for this fluid.

SAMPLE INFORMATION		method	limit/base	current	history1	history2
Sample Number	Client Info			TO90003224	---	---
Sample Date	Client Info			13 Feb 2024	---	---
Machine Age	hrs	Client Info		0	---	---
Oil Age	hrs	Client Info		0	---	---
Oil Changed	Client Info			N/A	---	---
Sample Status				ATTENTION	---	---

WEAR METALS		method	limit/base	current	history1	history2
Iron	ppm	ASTM D5185m	>60	0	---	---
Chromium	ppm	ASTM D5185m	>4	<1	---	---
Nickel	ppm	ASTM D5185m		0	---	---
Titanium	ppm	ASTM D5185m		0	---	---
Silver	ppm	ASTM D5185m		0	---	---
Aluminum	ppm	ASTM D5185m	>5	0	---	---
Lead	ppm	ASTM D5185m	>10	0	---	---
Copper	ppm	ASTM D5185m	>30	0	---	---
Tin	ppm	ASTM D5185m	>15	0	---	---
Vanadium	ppm	ASTM D5185m		0	---	---
Cadmium	ppm	ASTM D5185m		0	---	---






ADDITIVES		method	limit/base	current	history1	history2
Boron	ppm	ASTM D5185m		0	---	---
Barium	ppm	ASTM D5185m		0	---	---
Molybdenum	ppm	ASTM D5185m		0	---	---
Manganese	ppm	ASTM D5185m		<1	---	---
Magnesium	ppm	ASTM D5185m		1	---	---
Calcium	ppm	ASTM D5185m		2	---	---
Phosphorus	ppm	ASTM D5185m	1500	688	---	---
Zinc	ppm	ASTM D5185m		0	---	---
Sulfur	ppm	ASTM D5185m		0	---	---

CONTAMINANTS		method	limit/base	current	history1	history2
Silicon	ppm	ASTM D5185m	>50	0	---	---
Sodium	ppm	ASTM D5185m		0	---	---
Potassium	ppm	ASTM D5185m	>20	0	---	---
Water	%	ASTM D6304	>2.26	0.049	---	---
ppm Water	ppm	ASTM D6304	>22600	498	---	---

FLUID CLEANLINESS		method	limit/base	current	history1	history2
Particles >4µm		ASTM D7647	>10000	6602	---	---
Particles >6µm		ASTM D7647	>2500	1834	---	---
Particles >14µm		ASTM D7647	>320	93	---	---
Particles >21µm		ASTM D7647	>80	17	---	---
Particles >38µm		ASTM D7647	>20	1	---	---
Particles >71µm		ASTM D7647	>4	0	---	---
Oil Cleanliness		ISO 4406 (c)	>20/18/15	20/18/14	---	---

FLUID DEGRADATION		method	limit/base	current	history1	history2
Acid Number (AN)	mg KOH/g	ASTM D8045	0.04	0.047	---	---

OIL ANALYSIS REPORT

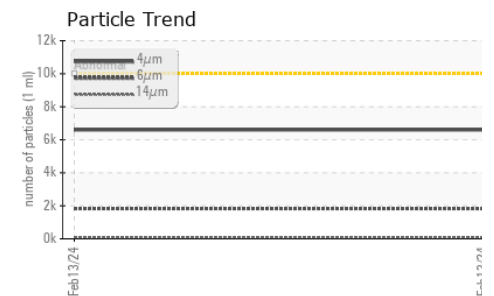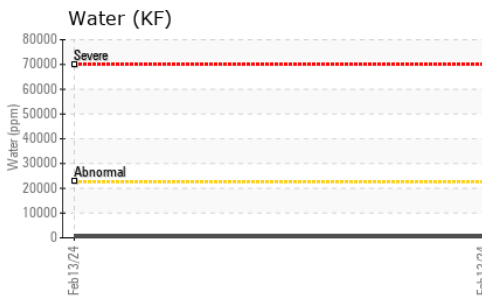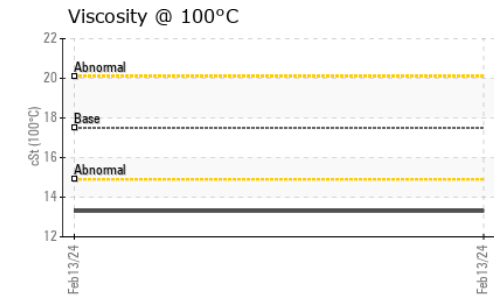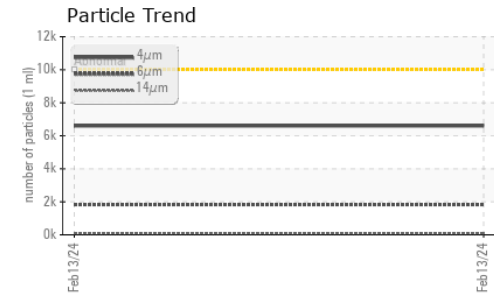
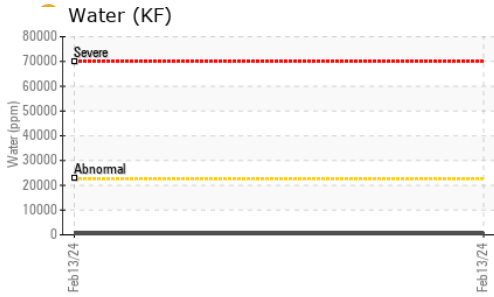


VISUAL	method	limit/base	current	history1	history2
White Metal	scalar	*Visual	NONE	NONE	---
Yellow Metal	scalar	*Visual	NONE	NONE	---
Precipitate	scalar	*Visual	NONE	NONE	---
Silt	scalar	*Visual	NONE	NONE	---
Debris	scalar	*Visual	NONE	NONE	---
Sand/Dirt	scalar	*Visual	NONE	NONE	---
Appearance	scalar	*Visual	NORML	NORML	---
Odor	scalar	*Visual	NORML	NORML	---
Emulsified Water	scalar	*Visual	>2.26	NEG	---
Free Water	scalar	*Visual		NEG	---

FLUID PROPERTIES	method	limit/base	current	history1	history2
Visc @ 40°C	cSt	ASTM D445	97	80.8	---
Visc @ 100°C	cSt	ASTM D445	17.5	13.3	---
Viscosity Index (VI)	Scale	ASTM D2270	198	167	---

SAMPLE IMAGES	method	limit/base	current	history1	history2
Color				no image	no image
Bottom				no image	no image

GRAPHS

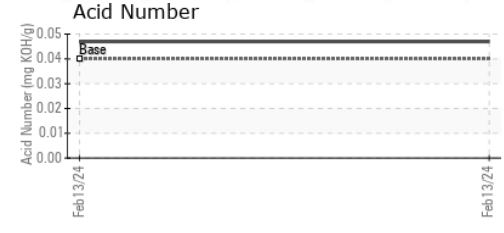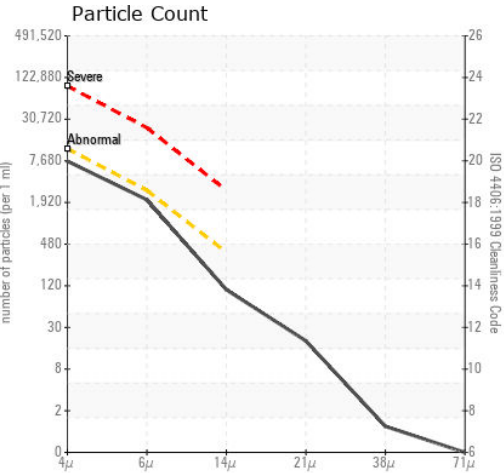

Laboratory : WearCheck USA - 501 Madison Ave., Cary, NC 27513
Sample No. : TO90003224 **Received** : 27 Feb 2024
Lab Number : 06101669 **Tested** : 28 Feb 2024
Unique Number : 10899899 **Diagnosed** : 29 Feb 2024 - Don Baldrige
Test Package : IND 2 (Additional Tests: KF, KV100, PrtCount, VI)

KINETIK HOLDINGS - EAST TOYAH
 49 COUNTY RD 419
 PECOS, TX
 US 79772
 Contact: Service Manager

To discuss this sample report, contact Customer Service at 1-800-237-1369.
 * - Denotes test methods that are outside of the ISO 17025 scope of accreditation.
 Statements of conformity to specifications are based on the simple acceptance decision rule (JCGM 106:2012)

T:
F: