




# OIL ANALYSIS REPORT

Sample Rating Trend

VIS DEBRIS

Machine Id  
**FRICK C6 (S/N TDSL193L000900R)**  
 Component  
**Refrigeration Compressor**  
 Fluid  
**ISEL NXT 717 (--- GAL)**

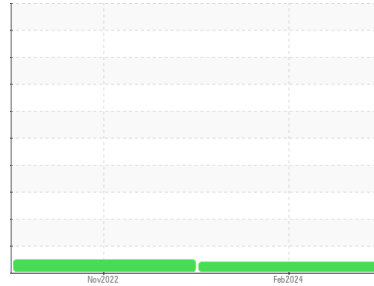

## DIAGNOSIS

### ▲ Recommendation

We recommend you service the filters on this component. Resample at the next service interval to monitor.

### Wear

All component wear rates are normal.

### ▲ Contamination

Moderate concentration of visible dirt/debris present in the oil.

### Fluid Condition

The AN level is acceptable for this fluid. The condition of the oil is suitable for further service.

## SAMPLE INFORMATION

	method	limit/base	current	history1	history2
Sample Number	Client Info		<b>WC0897994</b>	WC0746980	---
Sample Date	Client Info		<b>22 Feb 2024</b>	17 Nov 2022	---
Machine Age	hrs	Client Info	<b>44152</b>	35061	---
Oil Age	hrs	Client Info	<b>0</b>	0	---
Oil Changed		Client Info	<b>Not Chngd</b>	Not Chngd	---
Sample Status			<b>ABNORMAL</b>	NORMAL	---

## WEAR METALS

	method	limit/base	current	history1	history2
Iron	ppm	ASTM D5185m >8	<b>0</b>	<1	---
Chromium	ppm	ASTM D5185m >2	<b>&lt;1</b>	0	---
Nickel	ppm	ASTM D5185m	<b>0</b>	0	---
Titanium	ppm	ASTM D5185m	<b>0</b>	0	---
Silver	ppm	ASTM D5185m >2	<b>0</b>	0	---
Aluminum	ppm	ASTM D5185m >3	<b>0</b>	0	---
Lead	ppm	ASTM D5185m >2	<b>0</b>	0	---
Copper	ppm	ASTM D5185m >8	<b>0</b>	0	---
Tin	ppm	ASTM D5185m >4	<b>0</b>	0	---
Vanadium	ppm	ASTM D5185m	<b>0</b>	0	---
Cadmium	ppm	ASTM D5185m	<b>0</b>	0	---

## ADDITIVES

	method	limit/base	current	history1	history2
Boron	ppm	ASTM D5185m	<b>0</b>	0	---
Barium	ppm	ASTM D5185m	<b>0</b>	0	---
Molybdenum	ppm	ASTM D5185m	<b>0</b>	0	---
Manganese	ppm	ASTM D5185m	<b>&lt;1</b>	0	---
Magnesium	ppm	ASTM D5185m	<b>&lt;1</b>	0	---
Calcium	ppm	ASTM D5185m	<b>1</b>	0	---
Phosphorus	ppm	ASTM D5185m	<b>&lt;1</b>	<1	---
Zinc	ppm	ASTM D5185m	<b>0</b>	<1	---
Sulfur	ppm	ASTM D5185m	<b>0</b>	16	---

## CONTAMINANTS




	method	limit/base	current	history1	history2
Silicon	ppm	ASTM D5185m >15	<b>0</b>	0	---
Sodium	ppm	ASTM D5185m	<b>0</b>	0	---
Potassium	ppm	ASTM D5185m >20	<b>0</b>	0	---
Water	%	ASTM D6304 >0.01	<b>0.003</b>	0.003	---
ppm Water	ppm	ASTM D6304 >100	<b>26</b>	32.9	---

## FLUID DEGRADATION

	method	limit/base	current	history1	history2
Acid Number (AN)	mg KOH/g	ASTM D974	<b>0.014</b>	0.015	---




# OIL ANALYSIS REPORT

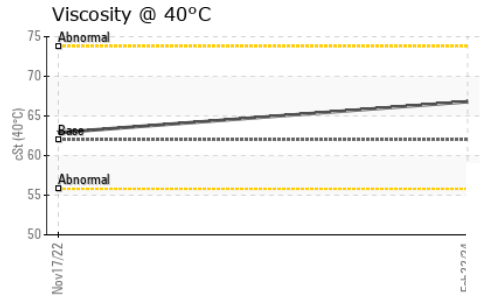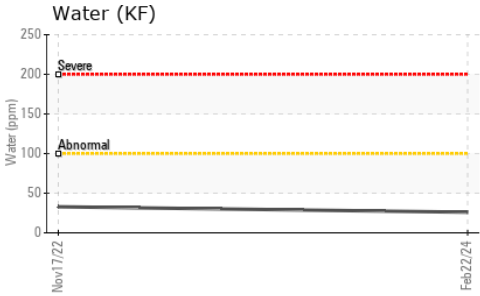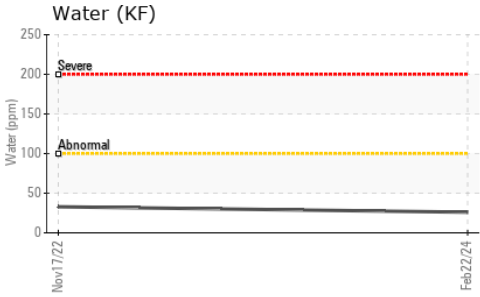





VISUAL	method	limit/base	current	history1	history2
White Metal	scalar	*Visual	NONE	NONE	---
Yellow Metal	scalar	*Visual	NONE	NONE	---
Precipitate	scalar	*Visual	NONE	NONE	---
Silt	scalar	*Visual	NONE	NONE	---
Debris	scalar	*Visual	NONE	▲ MODER	LIGHT
Sand/Dirt	scalar	*Visual	NONE	NONE	---
Appearance	scalar	*Visual	NORML	NORML	---
Odor	scalar	*Visual	NORML	NORML	---
Emulsified Water	scalar	*Visual	>0.01	NEG	---
Free Water	scalar	*Visual		NEG	---

FLUID PROPERTIES	method	limit/base	current	history1	history2
Visc @ 40°C	cSt	ASTM D445	62	66.8	62.9

### SAMPLE IMAGES

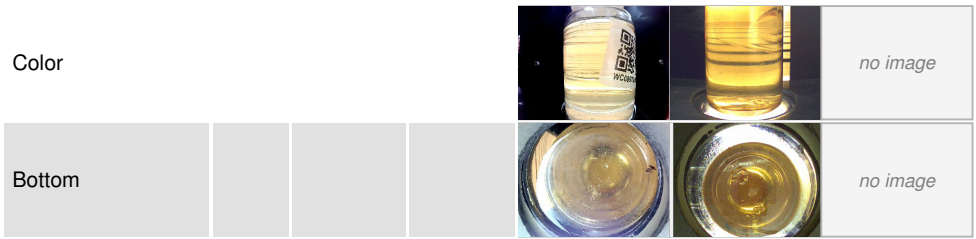

### GRAPHS

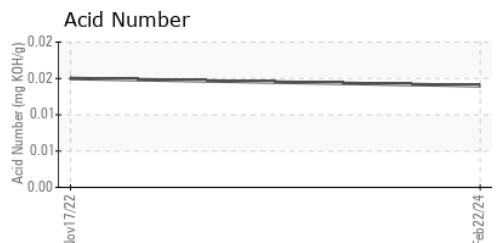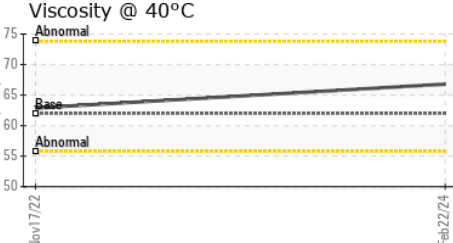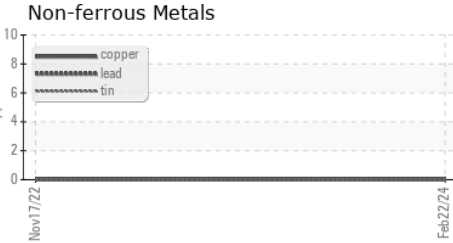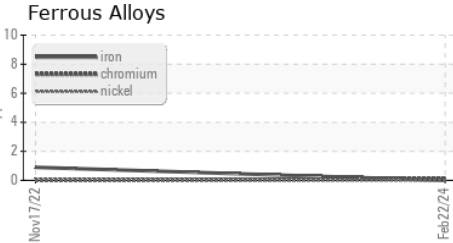

Certificate L2367

**Laboratory** : WearCheck USA - 501 Madison Ave., Cary, NC 27513  
**Sample No.** : WC0897994 **Received** : 27 Feb 2024  
**Lab Number** : 06101685 **Tested** : 28 Feb 2024  
**Unique Number** : 10899915 **Diagnosed** : 29 Feb 2024 - Don Baldrige  
**Test Package** : IND 2

**SPARTAN NASH**  
 4150 W BLOUNT ST  
 PENSACOLA, FL  
 US 32505  
 Contact: TRACY  
 tracy@serfco.com

To discuss this sample report, contact Customer Service at 1-800-237-1369.

\* - Denotes test methods that are outside of the ISO 17025 scope of accreditation.

Statements of conformity to specifications are based on the simple acceptance decision rule (JCGM 106:2012)

T:  
F: