

OIL ANALYSIS REPORT

Sample Rating Trend

WATER



Machine Id
NOT GIVEN RP0039421

Component
Unknown Component
Fluid
{not provided} (--- GAL)



DIAGNOSIS

Recommendation

Resample at the next service interval to monitor. Please specify the component make and model with your next sample. Please specify the brand, type, and viscosity of the oil on your next sample.

Wear

All component wear rates are normal.

Contamination

There is a light concentration of water present in the sample.

Fluid Condition

The AN level is acceptable for this fluid. The condition of the sample is acceptable for the time in service.

SAMPLE INFORMATION

method	limit/base	current	history1	history2
Sample Number	Client Info	RP0039421	---	---
Sample Date	Client Info	26 Feb 2024	---	---
Machine Age	hrs Client Info	0	---	---
Oil Age	hrs Client Info	0	---	---
Oil Changed	Client Info	N/A	---	---
Sample Status		MARGINAL	---	---

WEAR METALS

method	limit/base	current	history1	history2
Iron ppm ASTM D5185m		6	---	---
Chromium ppm ASTM D5185m		0	---	---
Nickel ppm ASTM D5185m		0	---	---
Titanium ppm ASTM D5185m		0	---	---
Silver ppm ASTM D5185m		0	---	---
Aluminum ppm ASTM D5185m		0	---	---
Lead ppm ASTM D5185m		0	---	---
Copper ppm ASTM D5185m		56	---	---
Tin ppm ASTM D5185m		0	---	---
Vanadium ppm ASTM D5185m		0	---	---
Cadmium ppm ASTM D5185m		0	---	---

ADDITIVES

method	limit/base	current	history1	history2
Boron ppm ASTM D5185m		0	---	---
Barium ppm ASTM D5185m		0	---	---
Molybdenum ppm ASTM D5185m		0	---	---
Manganese ppm ASTM D5185m		0	---	---
Magnesium ppm ASTM D5185m		<1	---	---
Calcium ppm ASTM D5185m		2	---	---
Phosphorus ppm ASTM D5185m		3	---	---
Zinc ppm ASTM D5185m		0	---	---

CONTAMINANTS

method	limit/base	current	history1	history2
Silicon ppm ASTM D5185m		<1	---	---
Sodium ppm ASTM D5185m		<1	---	---
Potassium ppm ASTM D5185m	>20	0	---	---
Water % ASTM D6304		▲ 0.177	---	---
ppm Water ppm ASTM D6304		▲ 1770	---	---




FLUID DEGRADATION

method	limit/base	current	history1	history2
Acid Number (AN) mg KOH/g ASTM D8045		0.30	---	---

VISUAL

method	limit/base	current	history1	history2
White Metal scalar *Visual	NONE	NONE	---	---
Yellow Metal scalar *Visual	NONE	NONE	---	---
Precipitate scalar *Visual	NONE	NONE	---	---
Silt scalar *Visual	NONE	NONE	---	---
Debris scalar *Visual	NONE	NONE	---	---
Sand/Dirt scalar *Visual	NONE	NONE	---	---
Appearance scalar *Visual	NORML	NORML	---	---
Odor scalar *Visual	NORML	NORML	---	---
Emulsified Water scalar *Visual		0.2%	---	---
Free Water scalar *Visual		NEG	---	---

OIL ANALYSIS REPORT


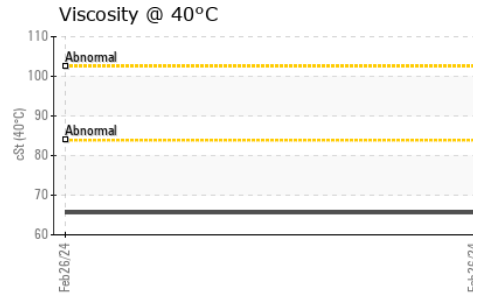
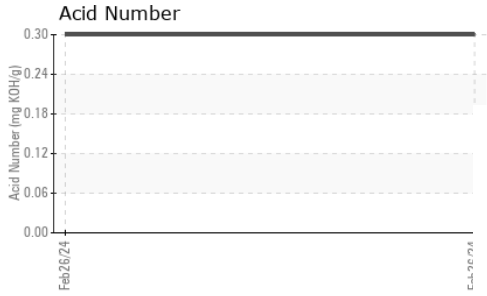
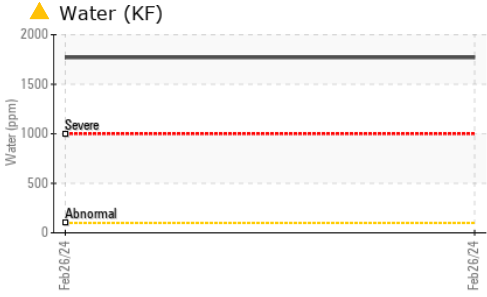


FLUID PROPERTIES	method	limit/base	current	history1	history2
Visc @ 40°C	cSt	ASTM D445	65.6	---	---

SAMPLE IMAGES	method	limit/base	current	history1	history2
---------------	--------	------------	---------	----------	----------

Color				no image	no image
Bottom				no image	no image

GRAPHS

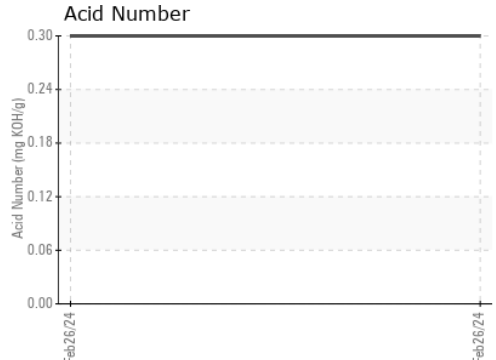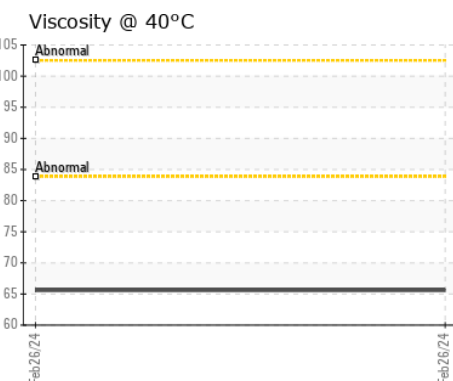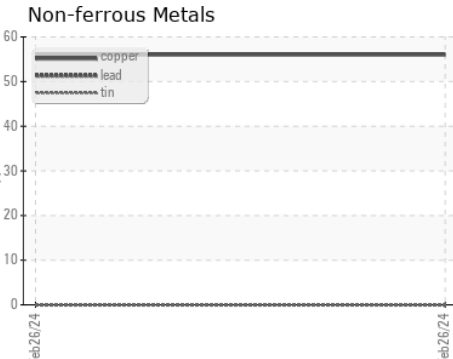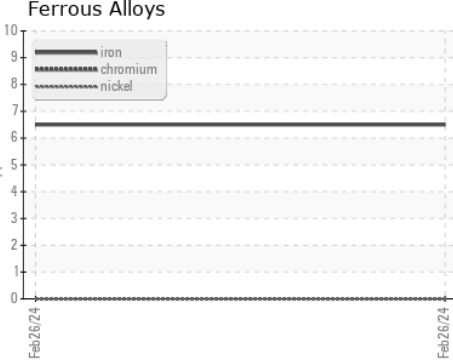

Laboratory : WearCheck USA - 501 Madison Ave., Cary, NC 27513
Sample No. : RP0039421
Lab Number : **06101748**
Unique Number : 10899978
Test Package : IND 2
Received : 27 Feb 2024
Tested : 28 Feb 2024
Diagnosed : 29 Feb 2024 - Don Baldrige

ENGIE-MATEP
 474 BROOKLINE AVE
 BOSTON, MA
 US 02215
 Contact: ROBERT ST SAUVEUR
 robert.stsauveur@engie.com
 T: (401)651-9381
 F:

To discuss this sample report, contact Customer Service at 1-800-237-1369.
 * - Denotes test methods that are outside of the ISO 17025 scope of accreditation.
 Statements of conformity to specifications are based on the simple acceptance decision rule (JCGM 106:2012)