


# **OIL ANALYSIS REPORT**

# ROTO XTEND [13849874] Machine Id ATLAS COPCO S99219601 - AEP AMOS

Component

Compressor





### DIAGNOSIS

## Recommendation

Resample at the next service interval to monitor.

#### Wear

All component wear rates are normal.

## Contamination

There is no indication of any contamination in the oil

# Fluid Condition

The AN level is acceptable for this fluid. The condition of the oil is suitable for further service.

		Jun202	1 Mar2023	Aug2023 Fel	Feb2024			
SAMPLE INFORM	MATION	method	limit/base	current	history1	history2		
Sample Number		Client Info		UCH06101765	UCH05943710	UCH05796007		
Sample Date		Client Info		09 Feb 2024	31 Aug 2023	19 Mar 2023		
Machine Age	hrs	Client Info		57654	55848	53504		
Oil Age	hrs	Client Info		6648	4842	2498		
Oil Changed		Client Info		Not Changd	Not Changd	Not Changd		
Sample Status				NORMAL	NORMAL	NORMAL		
CONTAMINATION	V	method	limit/base	current	history1	history2		
Water		WC Method	>0.1	NEG	NEG	NEG		
WEAR METALS		method	limit/base	current	history1	history2		
Iron	ppm	ASTM D5185m	>50	0	<1	0		
Chromium	ppm	ASTM D5185m	>5	0	0	0		
Nickel	ppm	ASTM D5185m		0	0	0		
Titanium	ppm	ASTM D5185m		0	0	0		
Silver	ppm	ASTM D5185m		0	0	0		
Aluminum	ppm	ASTM D5185m	>15	0	0	<1		
Lead	ppm	ASTM D5185m	>65	0	0	<1		
Copper	ppm	ASTM D5185m	>65	<1	<1	<1		
Tin	ppm	ASTM D5185m	>10	0	0	0		
Antimony	ppm	ASTM D5185m						
Vanadium	ppm	ASTM D5185m		0	0	0		
Cadmium	ppm	ASTM D5185m		0	0	0		
ADDITIVES		method	limit/base	current	history1	history2		
Boron	ppm	ASTM D5185m		0	0	0		
Barium	ppm	ASTM D5185m		0	2	0		
Molybdenum	ppm	ASTM D5185m		0	0	0		
Manganese	ppm	ASTM D5185m		0	0	0		
Magnesium	ppm	ASTM D5185m		0	0	<1		
Calcium	ppm	ASTM D5185m		0	0	0		
Phosphorus	ppm	ASTM D5185m		37	13	15		
Zinc	ppm	ASTM D5185m		0	8	4		
Sulfur	ppm	ASTM D5185m		92	22	36		
CONTAMINANTS	;	method	limit/base	current	history1	history2		
Silicon	ppm	ASTM D5185m	>35	0	0	<1		
Sodium	ppm	ASTM D5185m		<1	0	0		
Potassium	ppm	ASTM D5185m	>20	0	<1	<1		
FLUID DEGRADA	TION	method	limit/base	current	history1	history2		
A stal Nicosala au (ANI)		A OTA A DOC 45	0.44	0.00	0.00	0.47		

0.39

Acid Number (AN)


mg KOH/g ASTM D8045 0.14

0.30

0.17




# **OIL ANALYSIS REPORT**



I			
Abnormal			
2+			
1			
Base			
3			
Base			
1			
2 + Abnormal			
· ÷	Mar19/23 -	m	

VISUAL		method	limit/base	current	history1	history2
White Metal	scalar	*Visual	NONE	NONE	NONE	NONE
Yellow Metal	scalar	*Visual	NONE	NONE	NONE	NONE
Precipitate	scalar	*Visual	NONE	NONE	NONE	NONE
Silt	scalar	*Visual	NONE	NONE	NONE	NONE
Debris	scalar	*Visual	NONE	NONE	NONE	NONE
Sand/Dirt	scalar	*Visual	NONE	NONE	NONE	NONE
Appearance	scalar	*Visual	NORML	NORML	NORML	NORML
Odor	scalar	*Visual	NORML	NORML	NORML	NORML
<b>Emulsified Water</b>	scalar	*Visual	>0.1	NEG	NEG	NEG
Free Water	scalar	*Visual		NEG	NEG	NEG
FLUID PROPERT	IES	method	limit/base	current	history1	history2
Visc @ 40°C	cSt	ASTM D445	46	49.6	50.1	49.1
SAMPLE IMAGES	3	method	limit/base	current	history1	history2
Color						

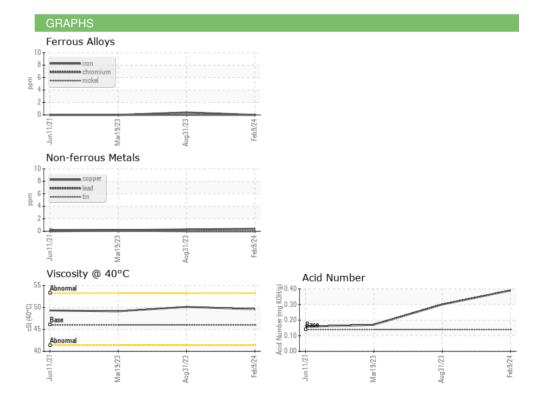





Certificate L2367

Laboratory Sample No.

Lab Number : 06101765 Unique Number : 10899995 Test Package : IND 2

: WearCheck USA - 501 Madison Ave., Cary, NC 27513 : UCH06101765

Received

**Tested** Diagnosed

: 28 Feb 2024 : 29 Feb 2024 - Don Baldridge

: 27 Feb 2024

**TOTAL EQUIPMENT COMPANY** 

200 SMILEY DR SAINT ALBANS, WV US 25177

Contact: Isabel Weimer

To discuss this sample report, contact Customer Service at 1-800-237-1369.

**Bottom** 

Isabel.weimer@totalequipment.com T:

\* - Denotes test methods that are outside of the ISO 17025 scope of accreditation.

Statements of conformity to specifications are based on the simple acceptance decision rule (JCGM 106:2012)

F: