




OIL ANALYSIS REPORT

Sample Rating Trend

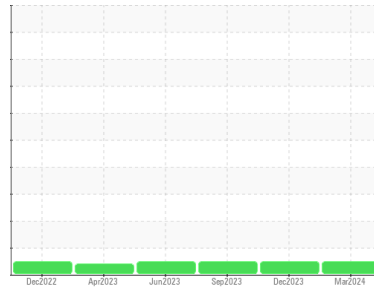

NORMAL



Machine Id

F19

Component

Diesel Engine

Fluid

DIESEL ENGINE OIL SAE 15W40 (--- GAL)

DIAGNOSIS

Recommendation

No corrective action is recommended at this time. Resample at the next service interval to monitor. Please specify the brand, type, and viscosity of the oil on your next sample.

Wear

All component wear rates are normal.

Contamination

Fuel content negligible. There is no indication of any contamination in the oil.

Fluid Condition

The BN result indicates that there is suitable alkalinity remaining in the oil. The condition of the oil is suitable for further service.

SAMPLE INFORMATION		method	limit/base	current	history1	history2
Sample Number	Client Info			WC0874301	WC0874366	WC0784015
Sample Date	Client Info			02 Mar 2024	11 Dec 2023	16 Sep 2023
Machine Age	hrs	Client Info		9954	9956	6936
Oil Age	hrs	Client Info		593	567	1732
Oil Changed	Client Info			Changed	Changed	Changed
Sample Status				NORMAL	NORMAL	NORMAL

CONTAMINATION		method	limit/base	current	history1	history2
Water	WC Method		>0.2	NEG	NEG	NEG
Glycol	WC Method			NEG	NEG	NEG

WEAR METALS		method	limit/base	current	history1	history2
Iron	ppm	ASTM D5185m	>110	9	6	9
Chromium	ppm	ASTM D5185m	>4	<1	<1	<1
Nickel	ppm	ASTM D5185m	>2	0	0	<1
Titanium	ppm	ASTM D5185m		0	0	0
Silver	ppm	ASTM D5185m	>2	0	0	<1
Aluminum	ppm	ASTM D5185m	>25	3	4	3
Lead	ppm	ASTM D5185m	>45	<1	0	1
Copper	ppm	ASTM D5185m	>85	1	2	3
Tin	ppm	ASTM D5185m	>4	<1	0	<1
Vanadium	ppm	ASTM D5185m		0	0	0
Cadmium	ppm	ASTM D5185m		0	0	0

ADDITIVES		method	limit/base	current	history1	history2
Boron	ppm	ASTM D5185m	250	14	14	22
Barium	ppm	ASTM D5185m	10	0	0	0
Molybdenum	ppm	ASTM D5185m	100	68	62	82
Manganese	ppm	ASTM D5185m		0	<1	<1
Magnesium	ppm	ASTM D5185m	450	912	823	225
Calcium	ppm	ASTM D5185m	3000	1232	1314	2234
Phosphorus	ppm	ASTM D5185m	1150	1093	1078	1125
Zinc	ppm	ASTM D5185m	1350	1258	1279	1373
Sulfur	ppm	ASTM D5185m	4250	3564	3266	4538




CONTAMINANTS		method	limit/base	current	history1	history2
Silicon	ppm	ASTM D5185m	>30	6	5	6
Sodium	ppm	ASTM D5185m	>158	3	5	3
Potassium	ppm	ASTM D5185m	>20	3	9	7
Fuel	%	ASTM D3524	>5	0.2	<1.0	<1.0

INFRA-RED		method	limit/base	current	history1	history2
Soot %	%	*ASTM D7844	>3	0.3	0.4	0.4
Nitration	Abs/cm	*ASTM D7624	>20	7.5	8.3	9.6
Sulfation	Abs/.1mm	*ASTM D7415	>30	18.6	19.2	20.7

FLUID DEGRADATION		method	limit/base	current	history1	history2
Oxidation	Abs/.1mm	*ASTM D7414	>25	13.9	14.8	16.0
Base Number (BN)	mg KOH/g	ASTM D2896	8.5	8.1	7.9	6.0







OIL ANALYSIS REPORT

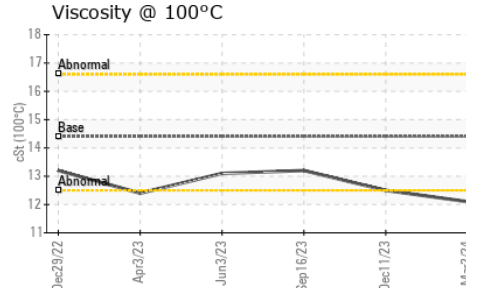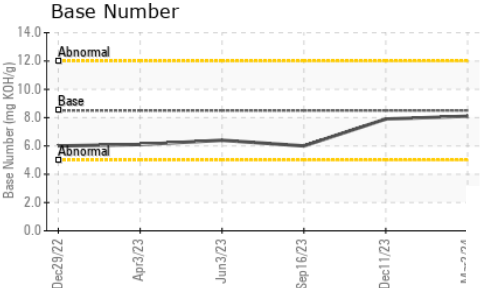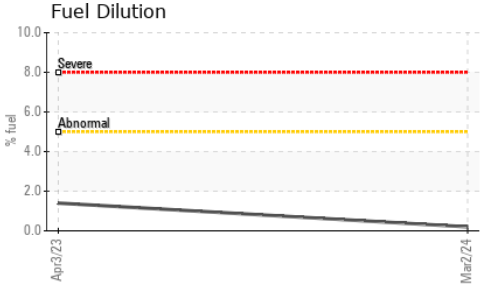

VISUAL	method	limit/base	current	history1	history2
White Metal	scalar	*Visual	NONE	NONE	NONE
Yellow Metal	scalar	*Visual	NONE	NONE	NONE
Precipitate	scalar	*Visual	NONE	NONE	NONE
Silt	scalar	*Visual	NONE	NONE	NONE
Debris	scalar	*Visual	NONE	NONE	NONE
Sand/Dirt	scalar	*Visual	NONE	NONE	NONE
Appearance	scalar	*Visual	NORML	NORML	NORML
Odor	scalar	*Visual	NORML	NORML	NORML
Emulsified Water	scalar	*Visual	>0.2	NEG	NEG
Free Water	scalar	*Visual		NEG	NEG

FLUID PROPERTIES	method	limit/base	current	history1	history2	
Visc @ 100°C	cSt	ASTM D445	14.4	12.1	12.5	13.2

GRAPHS

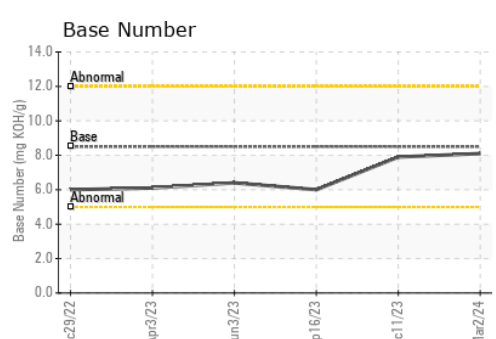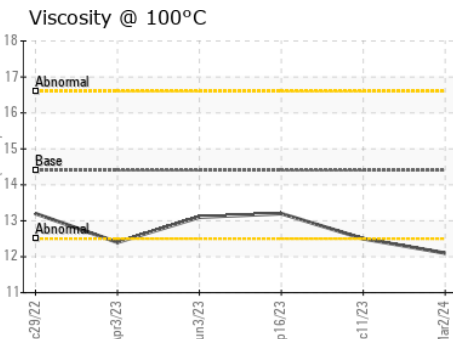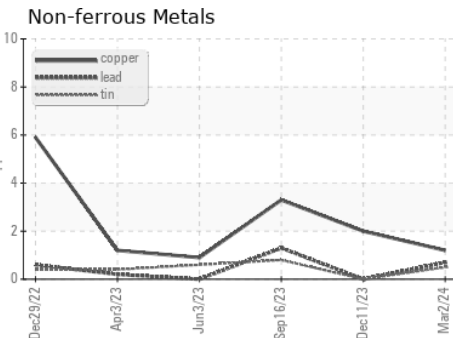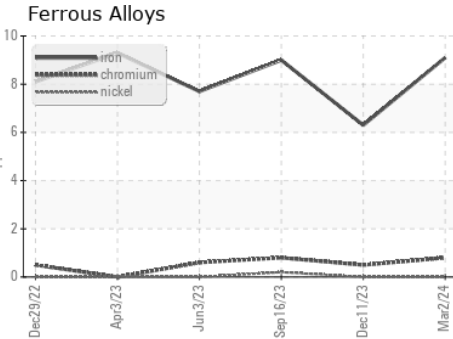

Certificate L2367

Laboratory : WearCheck USA - 501 Madison Ave., Cary, NC 27513
Sample No. : WC0874301 **Received** : 18 Mar 2024
Lab Number : **06121396** **Tested** : 21 Mar 2024
Unique Number : 10930229 **Diagnosed** : 21 Mar 2024 - Wes Davis
Test Package : CONST (Additional Tests: FuelDilution, PercentFuel, TBN)

Apple Valley Waste - EHT Location
 6626 Delilah Road
 Egg Harbor Township, NJ
 US 08234
 Contact: Service Manager

To discuss this sample report, contact Customer Service at 1-800-237-1369.
 * - Denotes test methods that are outside of the ISO 17025 scope of accreditation.
 Statements of conformity to specifications are based on the simple acceptance decision rule (JCGM 106:2012)

T:
F: