




# OIL ANALYSIS REPORT

Sample Rating Trend

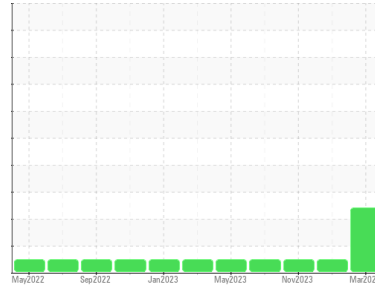

GLYCOL



Machine Id  
**SANDY LOU**

Component  
**Port Genset**

Fluid  
**CHEVRON DELO 400 SDE SAE 15W40 (3 GAL)**

## DIAGNOSIS

### Recommendation

We advise that you check for the source of the coolant leak. Check for low coolant level. Oil and filter change at the time of sampling has been noted. We recommend an early resample to monitor this condition.

### Wear

All component wear rates are normal.

### Contamination

Sodium and/or potassium levels are high.

### Fluid Condition

The BN result indicates that there is suitable alkalinity remaining in the oil.

## SAMPLE INFORMATION

method	limit/base	current	history1	history2
Sample Number	Client Info	<b>MW0047383</b>	MW0047396	MW0047392
Sample Date	Client Info	<b>13 Mar 2024</b>	30 Jan 2024	28 Nov 2023
Machine Age	hrs	<b>26554</b>	31827	31182
Oil Age	hrs	<b>170</b>	645	166
Oil Changed	Client Info	<b>Changed</b>	Changed	Changed
Sample Status		<b>ABNORMAL</b>	NORMAL	NORMAL

## CONTAMINATION

method	limit/base	current	history1	history2
Fuel	WC Method >4.0	<b>&lt;1.0</b>	<1.0	<1.0
Water	WC Method >0.1	<b>NEG</b>	NEG	NEG
Glycol	WC Method	<b>NEG</b>	NEG	NEG

## WEAR METALS

method	limit/base	current	history1	history2
Iron	ppm ASTM D5185m >50	<b>13</b>	5	5
Chromium	ppm ASTM D5185m >4	<b>&lt;1</b>	0	<1
Nickel	ppm ASTM D5185m >2	<b>&lt;1</b>	0	0
Titanium	ppm ASTM D5185m	<b>14</b>	14	0
Silver	ppm ASTM D5185m >5	<b>0</b>	0	0
Aluminum	ppm ASTM D5185m >12	<b>5</b>	2	2
Lead	ppm ASTM D5185m >17	<b>3</b>	<1	0
Copper	ppm ASTM D5185m >70	<b>2</b>	0	1
Tin	ppm ASTM D5185m >15	<b>&lt;1</b>	<1	0
Vanadium	ppm ASTM D5185m	<b>&lt;1</b>	<1	0
Cadmium	ppm ASTM D5185m	<b>0</b>	0	0

## ADDITIVES

method	limit/base	current	history1	history2
Boron	ppm ASTM D5185m	<b>34</b>	104	<1
Barium	ppm ASTM D5185m	<b>0</b>	0	0
Molybdenum	ppm ASTM D5185m	<b>72</b>	49	55
Manganese	ppm ASTM D5185m	<b>&lt;1</b>	<1	<1
Magnesium	ppm ASTM D5185m	<b>705</b>	742	903
Calcium	ppm ASTM D5185m	<b>1453</b>	1574	1045
Phosphorus	ppm ASTM D5185m 760	<b>795</b>	753	1000
Zinc	ppm ASTM D5185m 800	<b>886</b>	864	1213
Sulfur	ppm ASTM D5185m 3000	<b>3324</b>	3054	2913

## CONTAMINANTS

method	limit/base	current	history1	history2
Silicon	ppm ASTM D5185m >25	<b>6</b>	4	4
Sodium	ppm ASTM D5185m	<b>▲ 170</b>	3	10
Potassium	ppm ASTM D5185m >20	<b>▲ 350</b>	3	2

## INFRA-RED

method	limit/base	current	history1	history2
Soot %	% *ASTM D7844	<b>0.1</b>	0.1	0.1
Nitration	Abs/cm *ASTM D7624 >20	<b>11.2</b>	10.2	8.7
Sulfation	Abs/.1mm *ASTM D7415 >30	<b>19.6</b>	21.5	19.3


## FLUID DEGRADATION

method	limit/base	current	history1	history2
Oxidation	Abs/.1mm *ASTM D7414 >25	<b>14.9</b>	19.9	15.0
Base Number (BN)	mg KOH/g ASTM D2896 10	<b>8.7</b>	6.6	7.8




# OIL ANALYSIS REPORT


### ▲ Glycol Contamination

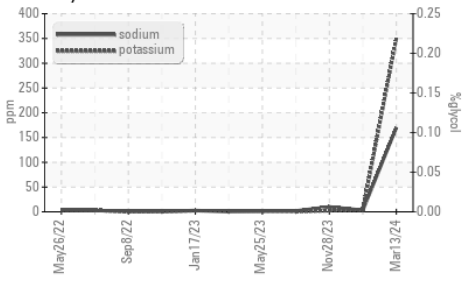

### Base Number

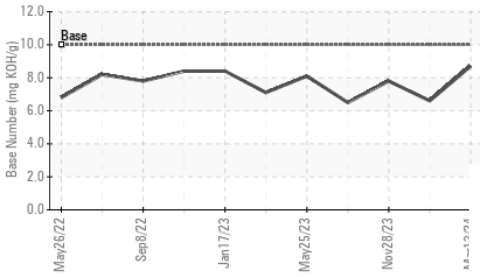

### Viscosity @ 100°C

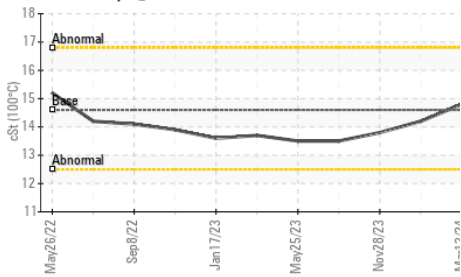


VISUAL	method	limit/base	current	history1	history2
White Metal	scalar	*Visual	NONE	NONE	NONE
Yellow Metal	scalar	*Visual	NONE	NONE	NONE
Precipitate	scalar	*Visual	NONE	NONE	NONE
Silt	scalar	*Visual	NONE	NONE	NONE
Debris	scalar	*Visual	NONE	NONE	NONE
Sand/Dirt	scalar	*Visual	NONE	NONE	NONE
Appearance	scalar	*Visual	NORML	NORML	NORML
Odor	scalar	*Visual	NORML	NORML	NORML
Emulsified Water	scalar	*Visual	>0.1	NEG	NEG
Free Water	scalar	*Visual		NEG	NEG


FLUID PROPERTIES	method	limit/base	current	history1	history2
Visc @ 100°C	cSt	ASTM D445	14.6	14.8	14.2

### GRAPHS


#### Ferrous Alloys

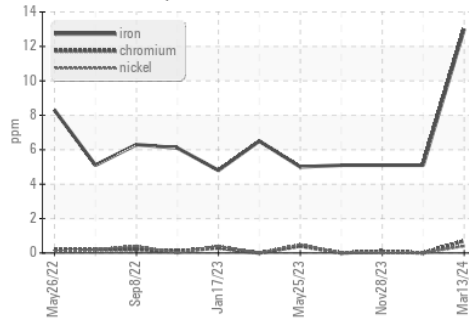


#### Non-ferrous Metals

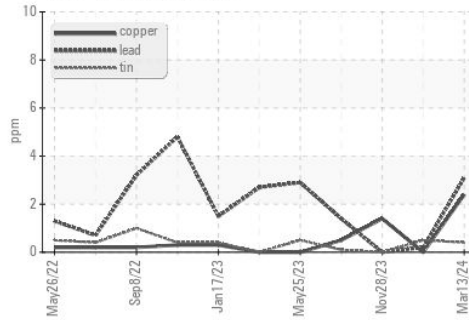

#### Viscosity @ 100°C

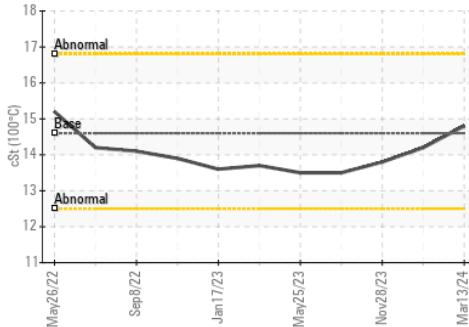

#### Base Number

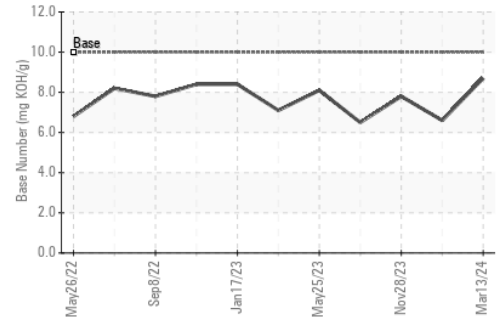

Certificate L2367

**Laboratory** : WearCheck USA - 501 Madison Ave., Cary, NC 27513  
**Sample No.** : MW0047383  
**Lab Number** : 06121467  
**Unique Number** : 10930300  
**Test Package** : MAR 2  
**Received** : 18 Mar 2024  
**Tested** : 19 Mar 2024  
**Diagnosed** : 21 Mar 2024 - Jonathan Hester

**OSAGE MARINE**  
 7501 E DAVIS ST  
 ST LOUIS, MO  
 US 63111

Contact: MIKE KESSLER  
 mike.kessler@osagemarine.com

To discuss this sample report, contact Customer Service at 1-800-237-1369.

\* - Denotes test methods that are outside of the ISO 17025 scope of accreditation.

Statements of conformity to specifications are based on the simple acceptance decision rule (JCGM 106:2012)

T:  
F: