


OIL ANALYSIS REPORT

Sample Rating Trend



NORMAL

Machine Id KAESER SK 15 5624173 (S/N 1003)

Compressor

KAESER SIGMA (OEM) S-460 (--- GAL)

Recommendation

Resample at the next service interval to monitor.

All component wear rates are normal.

Contamination

There is no indication of any contamination in the oil. The amount and size of particulates present in the system are acceptable.


Fluid Condition

The AN level is acceptable for this fluid. The condition of the oil is suitable for further service.

		Oct2017	Apr2019 Apr2020	Jun2021 Jul2022	Jan 2024	
SAMPLE INFORM	MATION	method	limit/base	current	history1	history2
Sample Number		Client Info		KC126792	KC105826	KC102597
Sample Date		Client Info		30 Jan 2024	30 Dec 2022	01 Jul 2022
Machine Age	hrs	Client Info		6105	5623	5339
Oil Age	hrs	Client Info		0	0	292
Oil Changed		Client Info		N/A	Changed	Not Changd
Sample Status				NORMAL	ABNORMAL	ABNORMAL
WEAR METALS		method	limit/base	current	history1	history2
Iron	ppm	ASTM D5185m	>50	0	0	0
Chromium	ppm	ASTM D5185m	>10	<1	0	0
Nickel	ppm	ASTM D5185m	>3	<1	0	0
Titanium	ppm	ASTM D5185m	>3	0	0	0
Silver	ppm	ASTM D5185m	>2	0	0	0
Aluminum	ppm	ASTM D5185m	>10	<1	0	<1
Lead	ppm	ASTM D5185m	>10	0	0	0
Copper	ppm	ASTM D5185m	>50	1	<1	<1
Tin	ppm	ASTM D5185m	>10	0	<1	0
Antimony	ppm	ASTM D5185m				
Vanadium	ppm	ASTM D5185m		0	0	0
Cadmium	ppm	ASTM D5185m		0	0	0
ADDITIVES		method	limit/base	current	history1	history2
Boron	ppm	ASTM D5185m		0	0	0
Barium	ppm	ASTM D5185m	90	0	0	32
Molybdenum	ppm	ASTM D5185m		0	0	0
Manganese	ppm	ASTM D5185m		<1	0	0
Magnesium	ppm	ASTM D5185m	90	48	56	69
Calcium	ppm	ASTM D5185m	2	0	<1	<1
Phosphorus	ppm	ASTM D5185m		0	4	<1
Zinc	ppm	ASTM D5185m		3	6	2
CONTAMINANTS		method	limit/base	current	history1	history2
Silicon	ppm	ASTM D5185m	>25	0	0	0
Sodium	ppm	ASTM D5185m		14	14	11
Potassium	ppm	ASTM D5185m	>20	2	4	0
Water	%	ASTM D6304	>0.05	0.014	△ 0.065	0.039
ppm Water	ppm	ASTM D6304	>500	142	△ 650	391.5
FLUID CLEANLIN	ESS	method	limit/base	current	history1	history2
Particles >4µm		ASTM D7647		1721	7977	17076
Particles >6µm		ASTM D7647	>1300	443	<u>^</u> 2901	△ 3929
Particles >14µm		ASTM D7647	>80	30	<u></u> ▲ 183	▲ 307
Particles >21µm		ASTM D7647	>20	8	<u>^</u> 24	△ 68
Particles >38µm		ASTM D7647	>4	0	1	3
Particles >71µm		ASTM D7647	>3	0	0	1
Oil Cleanliness		ISO 4406 (c)	>17/13	16/12	△ 19/15	△ 19/15
FLUID DEGRADA	TION	method	limit/base	current	history1	history2
Acid Number (AN)	mg KOH/g	ASTM D8045	0.4	0.36	0.37	0.40



OIL ANALYSIS REPORT

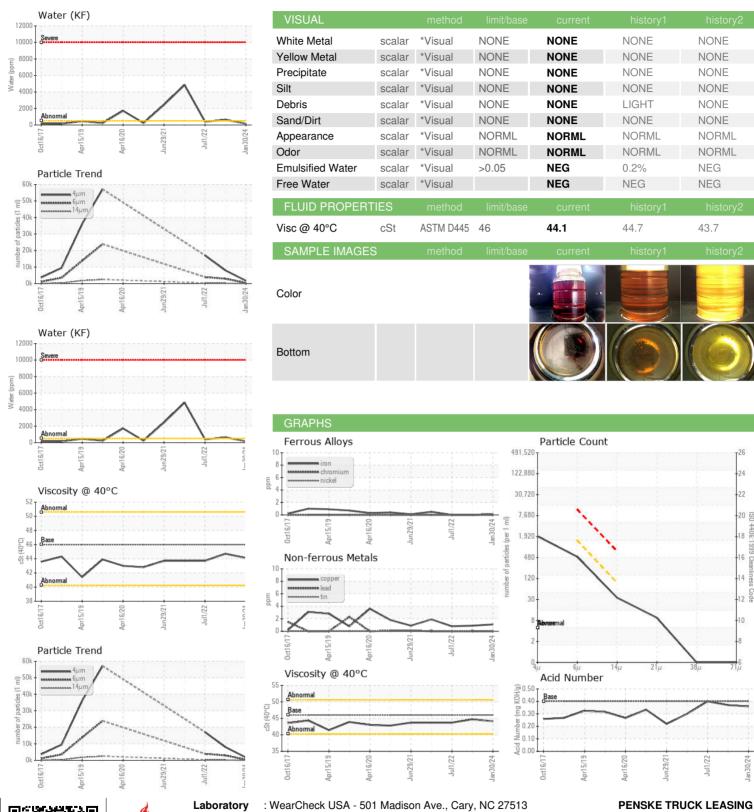



Certificate L2367

Sample No. Lab Number

Unique Number: 10930412 Test Package : IND 2

: KC126792 : 06121579

Received : 18 Mar 2024 **Tested** : 19 Mar 2024

: 21 Mar 2024 - Jonathan Hester Diagnosed

2821 INNOVATIVE DR NORTHWOOD, OH US 43619

Contact:

T: F:

To discuss this sample report, contact Customer Service at 1-800-237-1369.

* - Denotes test methods that are outside of the ISO 17025 scope of accreditation.

Statements of conformity to specifications are based on the simple acceptance decision rule (JCGM 106:2012)