


# **OIL ANALYSIS REPORT**

Sample Rating Trend



**NORMAL** 



# Machine Id KAESER ASD 25T 5895588 (S/N 1106)

Compressor

KAESER SIGMA (OEM) S-460 (--- GAL)

## Recommendation

Resample at the next service interval to monitor.

All component wear rates are normal.

## Contamination

The amount and size of particulates present in the system are acceptable. There is no indication of any contamination in the oil.


## **Fluid Condition**

The AN level is acceptable for this fluid. The condition of the oil is suitable for further service.


|                  |          | Jul2017      | Aug2018 Jan2020 | Jan 2021 Mar 2022 Feb 2023 | Feb2024     |             |
|------------------|----------|--------------|-----------------|----------------------------|-------------|-------------|
| SAMPLE INFORM    | MATION   | method       | limit/base      | current                    | history1    | history2    |
| Sample Number    |          | Client Info  |                 | KC121766                   | KC06005596  | KC105613    |
| Sample Date      |          | Client Info  |                 | 16 Feb 2024                | 10 Aug 2023 | 03 Feb 2023 |
| Machine Age      | hrs      | Client Info  |                 | 25029                      | 23060       | 20776       |
| Oil Age          | hrs      | Client Info  |                 | 0                          | 0           | 5000        |
| Oil Changed      |          | Client Info  |                 | N/A                        | N/A         | Changed     |
| Sample Status    |          |              |                 | NORMAL                     | ABNORMAL    | NORMAL      |
| WEAR METALS      |          | method       | limit/base      | current                    | history1    | history2    |
| Iron             | ppm      | ASTM D5185m  | >50             | 0                          | 0           | 0           |
| Chromium         | ppm      | ASTM D5185m  | >10             | <1                         | 0           | 0           |
| Nickel           | ppm      | ASTM D5185m  | >3              | 0                          | 0           | 0           |
| Titanium         | ppm      | ASTM D5185m  | >3              | 0                          | 0           | 0           |
| Silver           | ppm      | ASTM D5185m  | >2              | 0                          | 0           | 0           |
| Aluminum         | ppm      | ASTM D5185m  | >10             | 0                          | 0           | 0           |
| Lead             | ppm      | ASTM D5185m  | >10             | 0                          | 0           | 0           |
| Copper           | ppm      | ASTM D5185m  | >50             | 24                         | 22          | 30          |
| Tin              | ppm      | ASTM D5185m  | >10             | 0                          | 0           | 0           |
| Vanadium         | ppm      | ASTM D5185m  |                 | 0                          | 0           | 0           |
| Cadmium          | ppm      | ASTM D5185m  |                 | 0                          | 0           | 0           |
| ADDITIVES        |          | method       | limit/base      | current                    | history1    | history2    |
| Boron            | ppm      | ASTM D5185m  |                 | 0                          | 0           | 0           |
| Barium           | ppm      | ASTM D5185m  | 90              | 0                          | 0           | 0           |
| Molybdenum       | ppm      | ASTM D5185m  |                 | 0                          | 0           | 0           |
| Manganese        | ppm      | ASTM D5185m  |                 | <1                         | 0           | <1          |
| Magnesium        | ppm      | ASTM D5185m  | 90              | 0                          | 0           | 0           |
| Calcium          | ppm      | ASTM D5185m  | 2               | 0                          | 0           | 0           |
| Phosphorus       | ppm      | ASTM D5185m  |                 | 0                          | 0           | 2           |
| Zinc             | ppm      | ASTM D5185m  |                 | <1                         | 0           | <1          |
| CONTAMINANTS     | ;        | method       | limit/base      | current                    | history1    | history2    |
| Silicon          | ppm      | ASTM D5185m  | >25             | 0                          | <1          | 0           |
| Sodium           | ppm      | ASTM D5185m  |                 | <1                         | 0           | <1          |
| Potassium        | ppm      | ASTM D5185m  | >20             | 0                          | 1           | 0           |
| Water            | %        | ASTM D6304   | >0.05           | 0.002                      | 0.005       | 0.005       |
| ppm Water        | ppm      | ASTM D6304   | >500            | 21                         | 58.8        | 50.8        |
| FLUID CLEANLIN   | IESS     | method       | limit/base      | current                    | history1    | history2    |
| Particles >4µm   |          | ASTM D7647   |                 | 2071                       |             | 1262        |
| Particles >6µm   |          | ASTM D7647   | >1300           | 402                        |             | 435         |
| Particles >14μm  |          | ASTM D7647   | >80             | 21                         |             | 20          |
| Particles >21µm  |          | ASTM D7647   | >20             | 5                          |             | 5           |
| Particles >38μm  |          | ASTM D7647   | >4              | 0                          |             | 0           |
| Particles >71μm  |          | ASTM D7647   | >3              | 0                          |             | 0           |
| Oil Cleanliness  |          | ISO 4406 (c) | >/17/13         | 18/16/12                   |             | 17/16/11    |
| FLUID DEGRADA    | TION     | method       | limit/base      | current                    | history1    | history2    |
| Acid Number (AN) | mg KOH/g | ASTM D8045   | 0.4             | 0.38                       | 0.37        | 0.42        |





## **OIL ANALYSIS REPORT**




|         | Jan16/20 | Jan19/21                        | Mar2/22 | Feb3/23                      | Feb16/24 |
|---------|----------|---------------------------------|---------|------------------------------|----------|
| en      | d        |                                 |         |                              |          |
|         |          |                                 |         |                              |          |
| n       |          |                                 |         |                              |          |
|         |          |                                 |         |                              |          |
| 1       |          |                                 |         |                              |          |
| •       | \        |                                 |         | an and the same pair and the | ***      |
| - Sales |          | ** And And Address of the Anti- |         |                              |          |
|         | 9        | 5                               | 7       | 22                           | 44       |







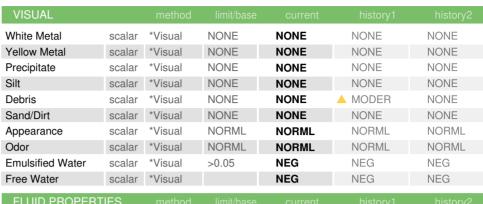


| I LOID I HOI LITT | ILO |           |    |      |      |      |
|-------------------|-----|-----------|----|------|------|------|
| Visc @ 40°C       | cSt | ASTM D445 | 46 | 44.6 | 44.4 | 43.8 |


| SAMPLE IMAGES | method |
|---------------|--------|
|               |        |

Color

**Bottom** 





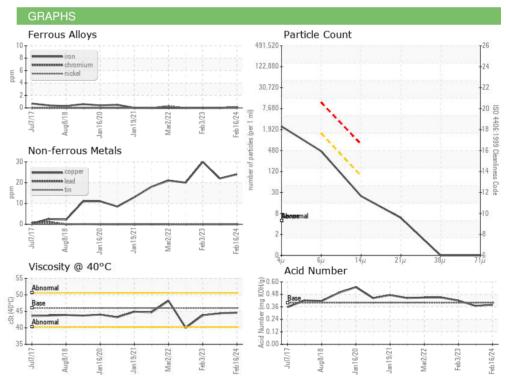



Certificate L2367

Laboratory Sample No. Lab Number

: KC121766 : 06121585 Unique Number: 10930418 Test Package : IND 2

: WearCheck USA - 501 Madison Ave., Cary, NC 27513 Received : 18 Mar 2024 **Tested** 

Diagnosed

: 19 Mar 2024 : 21 Mar 2024 - Jonathan Hester **GREEN MANUFACTURING** 

9650 PACKARD RD MORENCI, MI US 49256

Contact:

T: F:

To discuss this sample report, contact Customer Service at 1-800-237-1369.

\* - Denotes test methods that are outside of the ISO 17025 scope of accreditation.

Statements of conformity to specifications are based on the simple acceptance decision rule (JCGM 106:2012)