




# OIL ANALYSIS REPORT

Sample Rating Trend

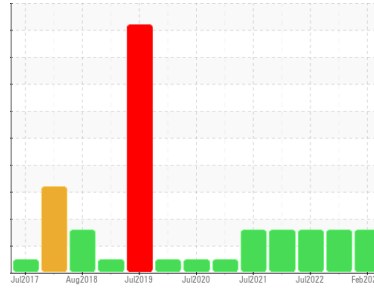

ISO



Machine Id  
**KAESER ASD 25T 5767217 (S/N 1090)**

Component  
**Compressor**

Fluid  
**KAESER SIGMA (OEM) S-460 (--- GAL)**

## DIAGNOSIS

### Recommendation

No corrective action is recommended at this time. The filter change at the time of sampling has been noted. Resample at the next service interval to monitor.

### Wear

All component wear rates are normal.

### Contamination

There is a moderate amount of silt (particulates < 14 microns in size) present in the oil.

### Fluid Condition

The AN level is acceptable for this fluid. The condition of the oil is suitable for further service.

SAMPLE INFORMATION		method	limit/base	current	history1	history2
Sample Number	Client Info			<b>KC1217690</b>	KC111315	KC101590
Sample Date	Client Info			<b>16 Feb 2024</b>	10 Aug 2023	22 Jul 2022
Machine Age	hrs	Client Info		<b>4513</b>	4007	3704
Oil Age	hrs	Client Info		<b>0</b>	400	382
Oil Changed	Client Info			<b>N/A</b>	Not Changd	Not Changd
Sample Status				<b>ATTENTION</b>	ATTENTION	ATTENTION

WEAR METALS		method	limit/base	current	history1	history2
Iron	ppm	ASTM D5185m	>50	<b>0</b>	0	0
Chromium	ppm	ASTM D5185m	>10	<b>&lt;1</b>	<1	0
Nickel	ppm	ASTM D5185m	>3	<b>0</b>	<1	0
Titanium	ppm	ASTM D5185m	>3	<b>0</b>	<1	0
Silver	ppm	ASTM D5185m	>2	<b>0</b>	<1	0
Aluminum	ppm	ASTM D5185m	>10	<b>&lt;1</b>	2	<1
Lead	ppm	ASTM D5185m	>10	<b>0</b>	<1	0
Copper	ppm	ASTM D5185m	>50	<b>2</b>	3	2
Tin	ppm	ASTM D5185m	>10	<b>0</b>	<1	0
Antimony	ppm	ASTM D5185m		<b>---</b>	---	---
Vanadium	ppm	ASTM D5185m		<b>0</b>	0	0
Cadmium	ppm	ASTM D5185m		<b>0</b>	<1	0






ADDITIVES		method	limit/base	current	history1	history2
Boron	ppm	ASTM D5185m		<b>0</b>	0	0
Barium	ppm	ASTM D5185m	90	<b>15</b>	26	32
Molybdenum	ppm	ASTM D5185m		<b>0</b>	<1	0
Manganese	ppm	ASTM D5185m		<b>&lt;1</b>	0	<1
Magnesium	ppm	ASTM D5185m	90	<b>3</b>	22	50
Calcium	ppm	ASTM D5185m	2	<b>2</b>	3	3
Phosphorus	ppm	ASTM D5185m		<b>0</b>	5	<1
Zinc	ppm	ASTM D5185m		<b>30</b>	17	17

CONTAMINANTS		method	limit/base	current	history1	history2
Silicon	ppm	ASTM D5185m	>25	<b>0</b>	<1	<1
Sodium	ppm	ASTM D5185m		<b>23</b>	16	16
Potassium	ppm	ASTM D5185m	>20	<b>8</b>	9	4
Water	%	ASTM D6304	>0.05	<b>0.003</b>	0.013	0.036
ppm Water	ppm	ASTM D6304	>500	<b>35</b>	138.3	363.7

FLUID CLEANLINESS		method	limit/base	current	history1	history2
Particles >4µm		ASTM D7647		<b>5411</b>	5920	9649
Particles >6µm		ASTM D7647	>1300	<b>1675</b>	1553	2332
Particles >14µm		ASTM D7647	>80	<b>144</b>	122	138
Particles >21µm		ASTM D7647	>20	<b>40</b>	34	38
Particles >38µm		ASTM D7647	>4	<b>2</b>	2	2
Particles >71µm		ASTM D7647	>3	<b>0</b>	0	0
Oil Cleanliness		ISO 4406 (c)	>--/17/13	<b>20/18/14</b>	20/18/14	20/18/14

FLUID DEGRADATION		method	limit/base	current	history1	history2
Acid Number (AN)	mg KOH/g	ASTM D8045	0.4	<b>0.40</b>	0.36	0.39

# OIL ANALYSIS REPORT

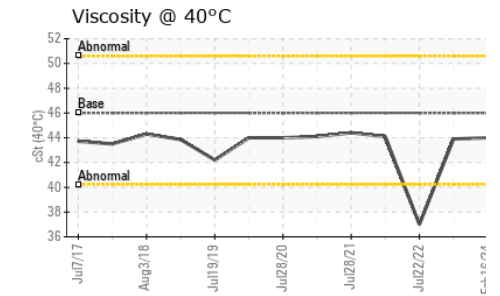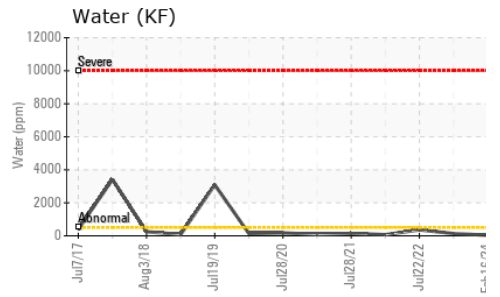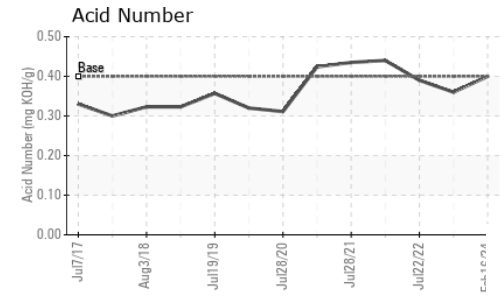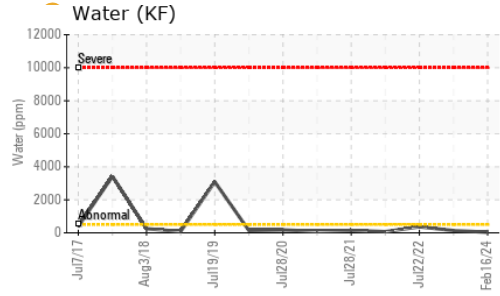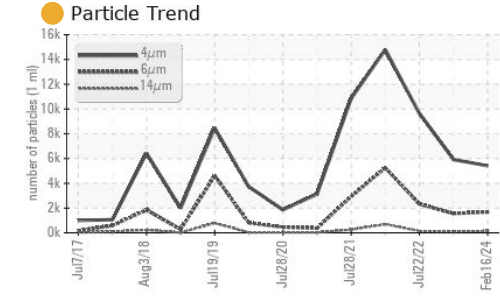




VISUAL	method	limit/base	current	history1	history2
White Metal	scalar	*Visual	NONE	NONE	NONE
Yellow Metal	scalar	*Visual	NONE	NONE	NONE
Precipitate	scalar	*Visual	NONE	NONE	NONE
Silt	scalar	*Visual	NONE	NONE	NONE
Debris	scalar	*Visual	NONE	LIGHT	NONE
Sand/Dirt	scalar	*Visual	NONE	NONE	NONE
Appearance	scalar	*Visual	NORML	NORML	NORML
Odor	scalar	*Visual	NORML	NORML	NORML
Emulsified Water	scalar	*Visual	>0.05	NEG	NEG
Free Water	scalar	*Visual		NEG	NEG

FLUID PROPERTIES	method	limit/base	current	history1	history2
Visc @ 40°C	cSt	ASTM D445 46	44.0	43.9	37.0

**SAMPLE IMAGES**

method	limit/base	current	history1	history2
Color				
Bottom				

**GRAPHS**

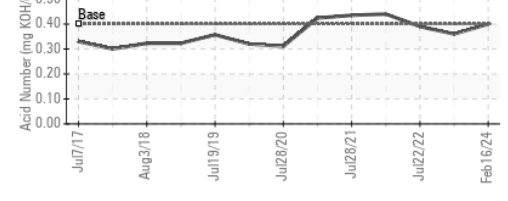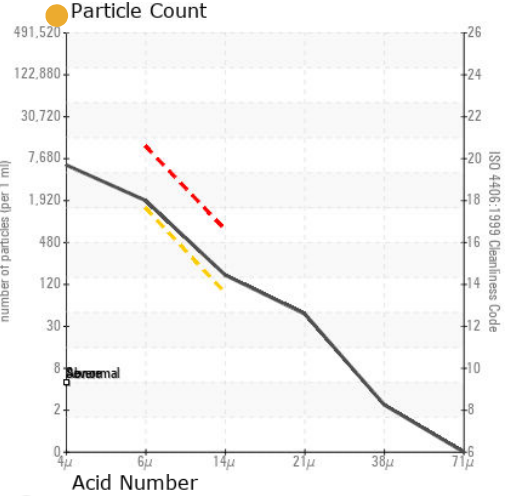

**Laboratory** : WearCheck USA - 501 Madison Ave., Cary, NC 27513  
**Sample No.** : KC1217690  
**Lab Number** : 06121586  
**Unique Number** : 10930419  
**Test Package** : IND 2

**Received** : 18 Mar 2024  
**Tested** : 19 Mar 2024  
**Diagnosed** : 21 Mar 2024 - Jonathan Hester

**GREEN MANUFACTURING**  
 9650 PACKARD RD  
 MORENCI, MI  
 US 49256  
 Contact:

To discuss this sample report, contact Customer Service at 1-800-237-1369.  
 \* - Denotes test methods that are outside of the ISO 17025 scope of accreditation.  
 Statements of conformity to specifications are based on the simple acceptance decision rule (JCGM 106:2012)