




OIL ANALYSIS REPORT

Sample Rating Trend

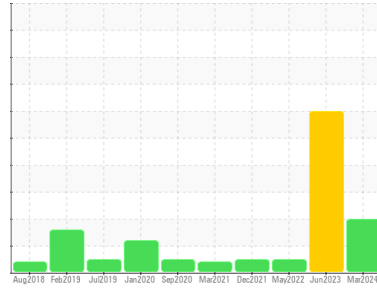

Machine Id
KAESER AS 30 6142903 (S/N 1053)

Component
Compressor
Fluid
KAESER SIGMA (OEM) M-460 (--- GAL)

DIAGNOSIS

Recommendation
Oil and filter change at the time of sampling has been noted. Resample at the next service interval to monitor.

Wear
All component wear rates are normal.

Contamination
There is a high amount of particulates present in the oil.

Fluid Condition
The AN level is acceptable for this fluid. The condition of the oil is suitable for further service.

SAMPLE INFORMATION

	method	limit/base	current	history1	history2
Sample Number	Client Info		KCPA13269	KCPA003479	KC104277
Sample Date	Client Info		08 Mar 2024	15 Jun 2023	25 May 2022
Machine Age	hrs	Client Info	10642	10205	9416
Oil Age	hrs	Client Info	437	0	900
Oil Changed	Client Info		Changed	N/A	Changed
Sample Status			ABNORMAL	ABNORMAL	NORMAL

WEAR METALS

	method	limit/base	current	history1	history2
Iron	ppm	ASTM D5185m >50	0	0	0
Chromium	ppm	ASTM D5185m >10	<1	0	0
Nickel	ppm	ASTM D5185m >3	0	0	0
Titanium	ppm	ASTM D5185m >3	0	0	0
Silver	ppm	ASTM D5185m >2	0	0	<1
Aluminum	ppm	ASTM D5185m >10	0	0	<1
Lead	ppm	ASTM D5185m >10	0	<1	0
Copper	ppm	ASTM D5185m >50	5	10	1
Tin	ppm	ASTM D5185m >10	<1	<1	<1
Antimony	ppm	ASTM D5185m	---	---	---
Vanadium	ppm	ASTM D5185m	0	0	0
Cadmium	ppm	ASTM D5185m	0	0	0

ADDITIVES

	method	limit/base	current	history1	history2
Boron	ppm	ASTM D5185m 0	0	0	<1
Barium	ppm	ASTM D5185m 90	0	2	31
Molybdenum	ppm	ASTM D5185m 0	0	0	0
Manganese	ppm	ASTM D5185m	<1	0	0
Magnesium	ppm	ASTM D5185m 100	48	39	78
Calcium	ppm	ASTM D5185m 0	0	<1	2
Phosphorus	ppm	ASTM D5185m 0	0	2	3
Zinc	ppm	ASTM D5185m 0	19	10	2
Sulfur	ppm	ASTM D5185m 23500	23790	21448	17540

CONTAMINANTS

	method	limit/base	current	history1	history2
Silicon	ppm	ASTM D5185m >25	0	0	0
Sodium	ppm	ASTM D5185m	21	3	14
Potassium	ppm	ASTM D5185m >20	3	2	<1
Water	%	ASTM D6304 >0.05	0.012	▲ 0.150	0.033
ppm Water	ppm	ASTM D6304 >500	128	▲ 1500	339.5






FLUID CLEANLINESS

	method	limit/base	current	history1	history2
Particles >4µm	ASTM D7647		13973	8896	4354
Particles >6µm	ASTM D7647	>1300	▲ 4138	▲ 2162	671
Particles >14µm	ASTM D7647	>80	▲ 366	▲ 171	35
Particles >21µm	ASTM D7647	>20	▲ 121	▲ 37	11
Particles >38µm	ASTM D7647	>4	▲ 7	1	1
Particles >71µm	ASTM D7647	>3	0	0	0
Oil Cleanliness	ISO 4406 (c)	>--/17/13	▲ 21/19/16	▲ 20/18/15	19/17/12

FLUID DEGRADATION

	method	limit/base	current	history1	history2
Acid Number (AN)	mg KOH/g	ASTM D8045 1.0	0.28	0.30	0.36

OIL ANALYSIS REPORT

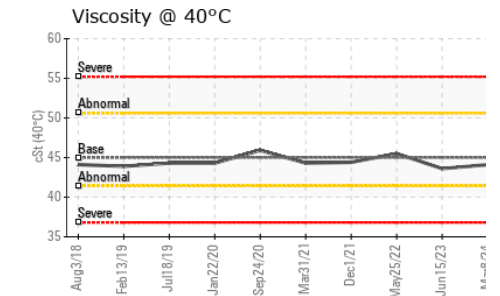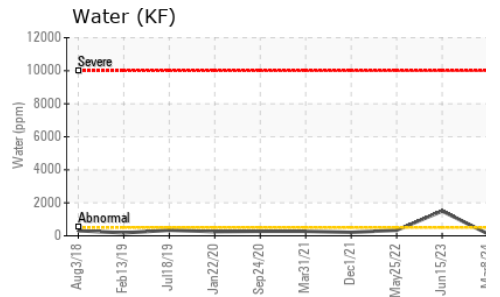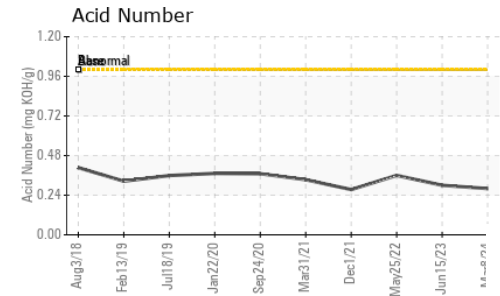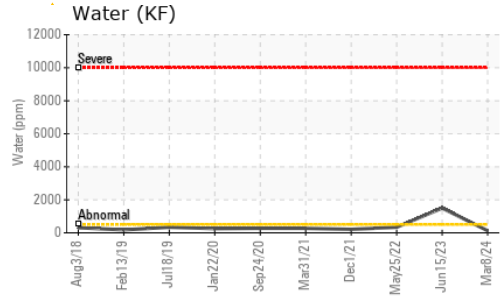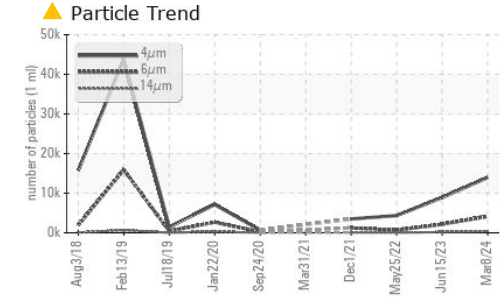





PARAMETER	method	limit/base	current	history1	history2
White Metal	scalar	*Visual	NONE	NONE	NONE
Yellow Metal	scalar	*Visual	NONE	NONE	NONE
Precipitate	scalar	*Visual	NONE	NONE	NONE
Silt	scalar	*Visual	NONE	NONE	NONE
Debris	scalar	*Visual	NONE	▲ MODER	NONE
Sand/Dirt	scalar	*Visual	NONE	NONE	NONE
Appearance	scalar	*Visual	NORML	● HAZY	NORML
Odor	scalar	*Visual	NORML	NORML	NORML
Emulsified Water	scalar	*Visual	>0.05	▲ 0.2%	NEG
Free Water	scalar	*Visual		▲ 1.0	NEG

FLUID PROPERTIES	method	limit/base	current	history1	history2
Visc @ 40°C	cSt	ASTM D445	45	44.1	43.6

SAMPLE IMAGES

method	limit/base	current	history1	history2
Color				
Bottom				

GRAPHS

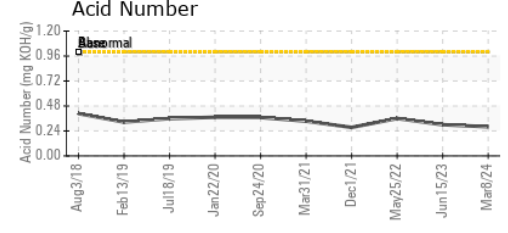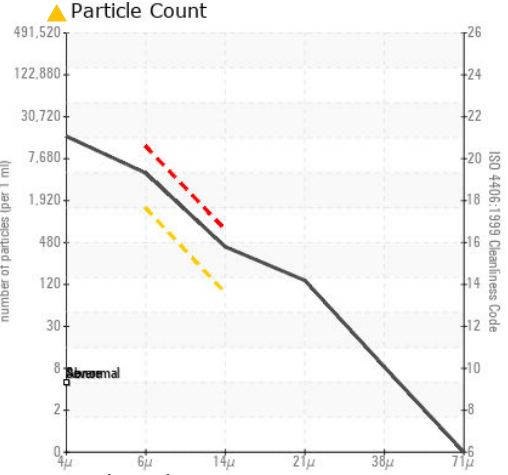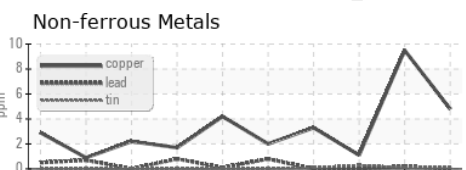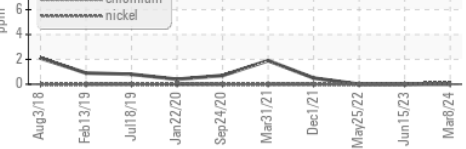

Laboratory : WearCheck USA - 501 Madison Ave., Cary, NC 27513
Sample No. : KCPA13269
Lab Number : 06121597
Unique Number : 10930430
Test Package : IND 2 (Additional Tests: KF, PrtCount)

SOUTHWEST PLASTIC BINDING
 13878 PARKS STEED DR
 EARTH CITY, MO
 US 63045

Received : 18 Mar 2024
Tested : 19 Mar 2024
Diagnosed : 21 Mar 2024 - Jonathan Hester
 Contact: SANDY KRISHER
 sandy.krisher@swbindinglaminating.com
 T:
 F: