




OIL ANALYSIS REPORT

Sample Rating Trend

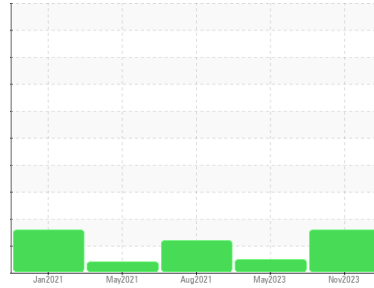

ISO



Machine Id
6207972 (S/N 1006)

Component
Compressor

Fluid
ACI 150FG (--- GAL)

DIAGNOSIS

Recommendation

No corrective action is recommended at this time. Resample at the next service interval to monitor.

Wear

All component wear rates are normal.

Contamination

There is a moderate amount of particulates present in the oil.

Fluid Condition

The AN level is acceptable for this fluid. The condition of the oil is suitable for further service.

SAMPLE INFORMATION

	method	limit/base	current	history1	history2
Sample Number	Client Info		KC124787	KC112007	KC99863
Sample Date	Client Info		10 Nov 2023	19 May 2023	11 Aug 2021
Machine Age	hrs	Client Info	2300	2300	2299
Oil Age	hrs	Client Info	0	0	0
Oil Changed	Client Info		N/A	Not Changd	Not Changd
Sample Status			ATTENTION	NORMAL	ABNORMAL

WEAR METALS

	method	limit/base	current	history1	history2
Iron	ppm	ASTM D5185m >50	0	0	1
Chromium	ppm	ASTM D5185m >10	0	0	0
Nickel	ppm	ASTM D5185m >3	0	0	<1
Titanium	ppm	ASTM D5185m >3	0	0	0
Silver	ppm	ASTM D5185m >2	0	0	0
Aluminum	ppm	ASTM D5185m >10	0	0	0
Lead	ppm	ASTM D5185m >10	0	0	0
Copper	ppm	ASTM D5185m >50	0	0	<1
Tin	ppm	ASTM D5185m >10	0	0	0
Antimony	ppm	ASTM D5185m	---	---	0
Vanadium	ppm	ASTM D5185m	0	0	0
Cadmium	ppm	ASTM D5185m	0	0	0

ADDITIVES

	method	limit/base	current	history1	history2
Boron	ppm	ASTM D5185m	0	0	1
Barium	ppm	ASTM D5185m	2	0	<1
Molybdenum	ppm	ASTM D5185m	0	0	0
Manganese	ppm	ASTM D5185m	0	0	<1
Magnesium	ppm	ASTM D5185m	2	2	8
Calcium	ppm	ASTM D5185m	1	0	0
Phosphorus	ppm	ASTM D5185m	442	538	453
Zinc	ppm	ASTM D5185m	9	0	0

CONTAMINANTS

	method	limit/base	current	history1	history2
Silicon	ppm	ASTM D5185m >25	<1	1	0
Sodium	ppm	ASTM D5185m	0	1	1
Potassium	ppm	ASTM D5185m >20	0	1	<1
Water	%	ASTM D6304 >0.05	0.002	0.002	0.005
ppm Water	ppm	ASTM D6304 >500	19	18.5	52.2






FLUID CLEANLINESS

	method	limit/base	current	history1	history2
Particles >4µm	ASTM D7647		5491	5216	8984
Particles >6µm	ASTM D7647	>1300	1481	1138	2305
Particles >14µm	ASTM D7647	>80	98	58	230
Particles >21µm	ASTM D7647	>20	27	13	49
Particles >38µm	ASTM D7647	>4	1	1	4
Particles >71µm	ASTM D7647	>3	0	1	0
Oil Cleanliness	ISO 4406 (c)	>--/17/13	20/18/14	20/17/13	18/15

FLUID DEGRADATION

	method	limit/base	current	history1	history2
Acid Number (AN)	mg KOH/g	ASTM D8045	1.60	1.53	1.233


OIL ANALYSIS REPORT

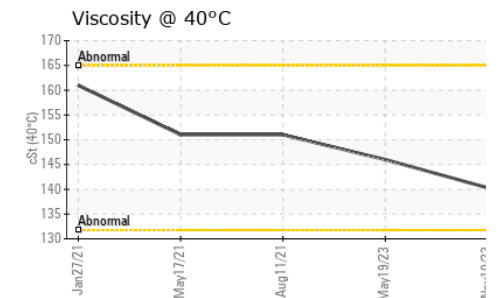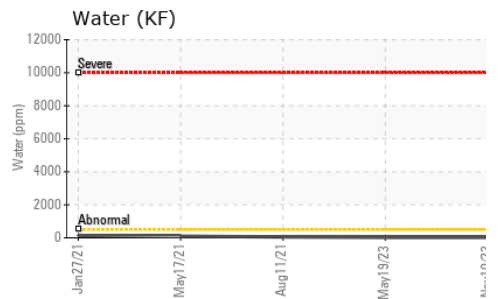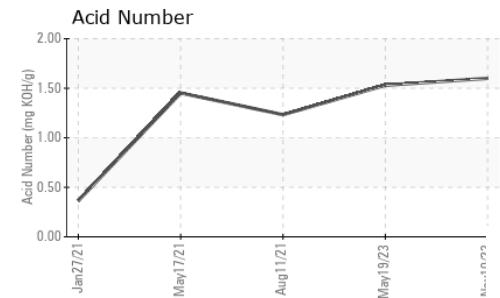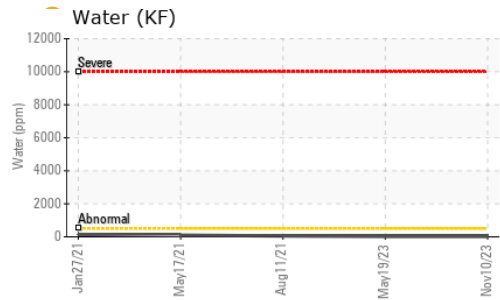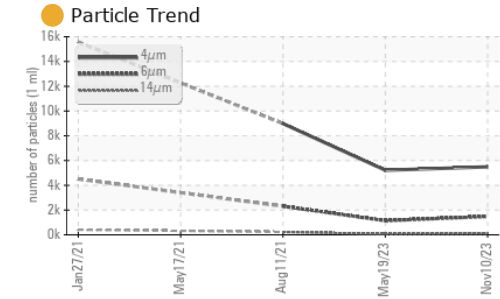






PARAMETER	method	limit/base	current	history1	history2
White Metal	scalar	*Visual	NONE	NONE	NONE
Yellow Metal	scalar	*Visual	NONE	NONE	NONE
Precipitate	scalar	*Visual	NONE	NONE	NONE
Silt	scalar	*Visual	NONE	NONE	NONE
Debris	scalar	*Visual	NONE	NONE	NONE
Sand/Dirt	scalar	*Visual	NONE	NONE	NONE
Appearance	scalar	*Visual	NORML	NORML	NORML
Odor	scalar	*Visual	NORML	NORML	NORML
Emulsified Water	scalar	*Visual	>0.05	NEG	NEG
Free Water	scalar	*Visual		NEG	NEG

FLUID PROPERTIES	method	limit/base	current	history1	history2
Visc @ 40°C	cSt	ASTM D445	140.3	146	151

SAMPLE IMAGES	method	limit/base	current	history1	history2
---------------	--------	------------	---------	----------	----------

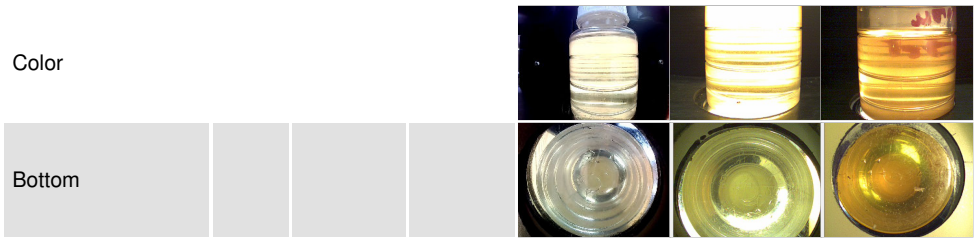

GRAPHS

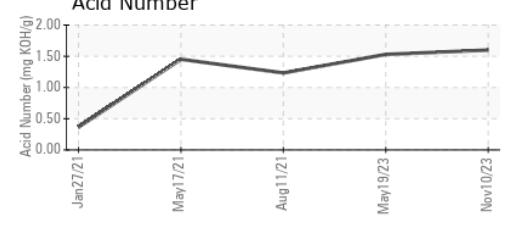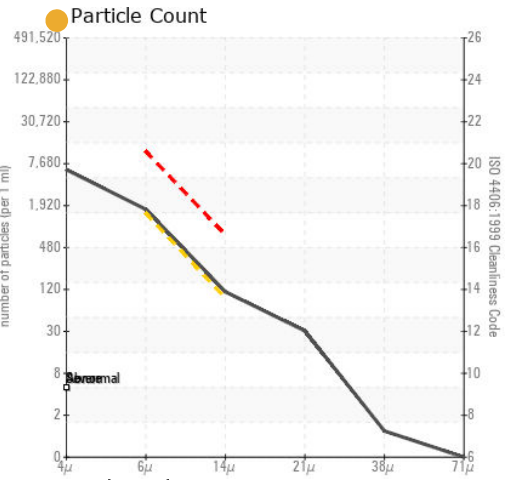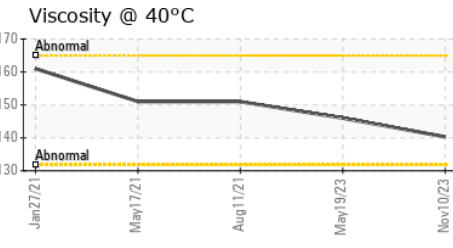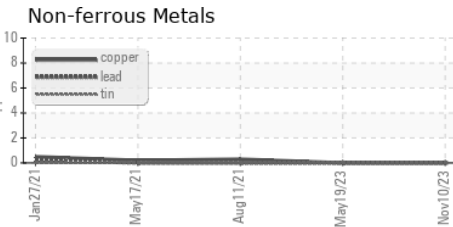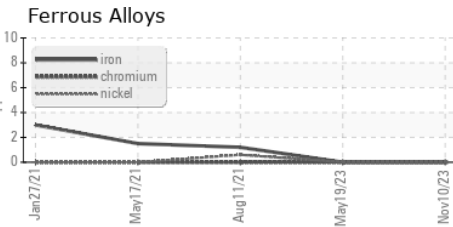

Laboratory : WearCheck USA - 501 Madison Ave., Cary, NC 27513
Sample No. : KC124787
Lab Number : 06121610
Unique Number : 10930443
Test Package : IND 2
Received : 18 Mar 2024
Tested : 21 Mar 2024
Diagnosed : 21 Mar 2024 - Doug Bogart

PREFORM TECHNOLOGIES
 11362 S AIRFIELD RD
 SWANTON, OH
 US 43558
 Contact: N NEINLOVE
 N.NEINLOVE@PREFORMTECHNOLOGIES.COM
 T:
 F:

Certificate L2367
 To discuss this sample report, contact Customer Service at 1-800-237-1369.
 * - Denotes test methods that are outside of the ISO 17025 scope of accreditation.
 Statements of conformity to specifications are based on the simple acceptance decision rule (JCGM 106:2012)