


# OIL ANALYSIS REPORT

Sample Rating Trend



**WATER**

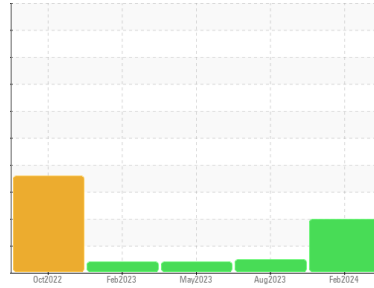

Machine Id  
**KAESER 8073567**

Component  
**Compressor**  
Fluid  
**KAESER SIGMA (OEM) S-460 (--- GAL)**

## DIAGNOSIS

### ▲ Recommendation

The filter change at the time of sampling has been noted. We advise that you stop the unit and follow the water drain-off procedure for this component. We recommend an early resample in 500 hours to monitor this condition. We were unable to perform a particle count due to a high concentration of particles present in this sample.

### Wear

All component wear rates are normal.

### ▲ Contamination

Moderate concentration of visible dirt/debris present in the oil. There is a light concentration of water present in the oil.

### Fluid Condition

The AN level is acceptable for this fluid. The condition of the oil is suitable for further service.

## SAMPLE INFORMATION

method	limit/base	current	history1	history2
Sample Number	Client Info	<b>KC121746</b>	KC06005636	KC111744
Sample Date	Client Info	<b>15 Feb 2024</b>	02 Aug 2023	03 May 2023
Machine Age	hrs	<b>8417</b>	6399	5579
Oil Age	hrs	<b>0</b>	0	3487
Oil Changed	Client Info	<b>N/A</b>	N/A	Not Changd
Sample Status		<b>ABNORMAL</b>	NORMAL	ABNORMAL

## WEAR METALS

method	limit/base	current	history1	history2	
Iron	ppm	ASTM D5185m >50	<b>0</b>	0	1
Chromium	ppm	ASTM D5185m >10	<b>0</b>	0	0
Nickel	ppm	ASTM D5185m >3	<b>0</b>	0	0
Titanium	ppm	ASTM D5185m >3	<b>0</b>	0	0
Silver	ppm	ASTM D5185m >2	<b>0</b>	0	0
Aluminum	ppm	ASTM D5185m >10	<b>2</b>	0	0
Lead	ppm	ASTM D5185m >10	<b>0</b>	0	0
Copper	ppm	ASTM D5185m >50	<b>6</b>	12	10
Tin	ppm	ASTM D5185m >10	<b>0</b>	0	0
Vanadium	ppm	ASTM D5185m	<b>0</b>	0	0
Cadmium	ppm	ASTM D5185m	<b>0</b>	0	0

## ADDITIVES

method	limit/base	current	history1	history2	
Boron	ppm	ASTM D5185m	<b>0</b>	0	0
Barium	ppm	ASTM D5185m 90	<b>0</b>	0	0
Molybdenum	ppm	ASTM D5185m	<b>0</b>	0	0
Manganese	ppm	ASTM D5185m	<b>0</b>	0	0
Magnesium	ppm	ASTM D5185m 90	<b>0</b>	0	0
Calcium	ppm	ASTM D5185m 2	<b>0</b>	0	0
Phosphorus	ppm	ASTM D5185m	<b>5</b>	0	4
Zinc	ppm	ASTM D5185m	<b>18</b>	0	<1

## CONTAMINANTS

method	limit/base	current	history1	history2	
Silicon	ppm	ASTM D5185m >25	<b>&lt;1</b>	<1	<1
Sodium	ppm	ASTM D5185m	<b>0</b>	1	1
Potassium	ppm	ASTM D5185m >20	<b>0</b>	2	<1
Water	%	ASTM D6304 >0.05	<b>▲ 0.121</b>	0.009	0.005
ppm Water	ppm	ASTM D6304 >500	<b>▲ 1210</b>	91.3	56.8




## FLUID CLEANLINESS

method	limit/base	current	history1	history2
Particles >4µm	ASTM D7647	---	179	---
Particles >6µm	ASTM D7647 >1300	---	77	---
Particles >14µm	ASTM D7647 >80	---	15	---
Particles >21µm	ASTM D7647 >20	---	6	---
Particles >38µm	ASTM D7647 >4	---	0	---
Particles >71µm	ASTM D7647 >3	---	0	---
Oil Cleanliness	ISO 4406 (c) >--/17/13	---	15/13/11	---

## FLUID DEGRADATION

method	limit/base	current	history1	history2	
Acid Number (AN)	mg KOH/g	ASTM D8045 0.4	<b>0.44</b>	0.36	0.40


# OIL ANALYSIS REPORT

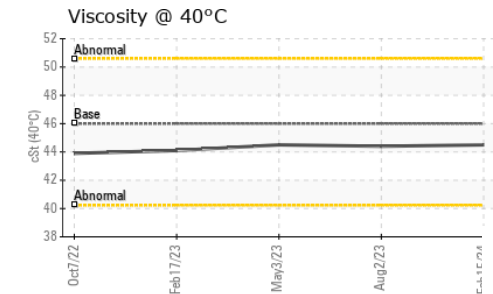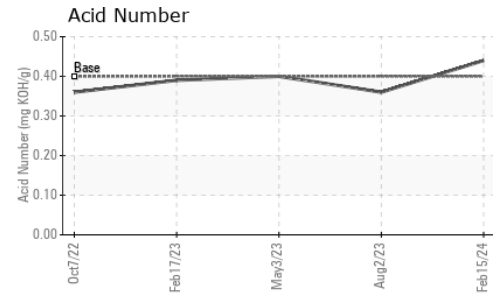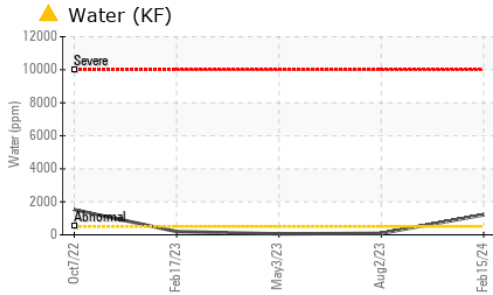





VISUAL	method	limit/base	current	history1	history2
White Metal	scalar	*Visual	NONE	NONE	NONE
Yellow Metal	scalar	*Visual	NONE	NONE	NONE
Precipitate	scalar	*Visual	NONE	NONE	NONE
Silt	scalar	*Visual	NONE	NONE	NONE
Debris	scalar	*Visual	NONE	▲ MODER	▲ MODER
Sand/Dirt	scalar	*Visual	NONE	NONE	NONE
Appearance	scalar	*Visual	NORML	NORML	NORML
Odor	scalar	*Visual	NORML	NORML	NORML
Emulsified Water	scalar	*Visual	>0.05	0.2%	NEG
Free Water	scalar	*Visual		NEG	NEG

FLUID PROPERTIES	method	limit/base	current	history1	history2
Visc @ 40°C	cSt	ASTM D445 46	44.5	44.4	44.5

SAMPLE IMAGES	method	limit/base	current	history1	history2
---------------	--------	------------	---------	----------	----------

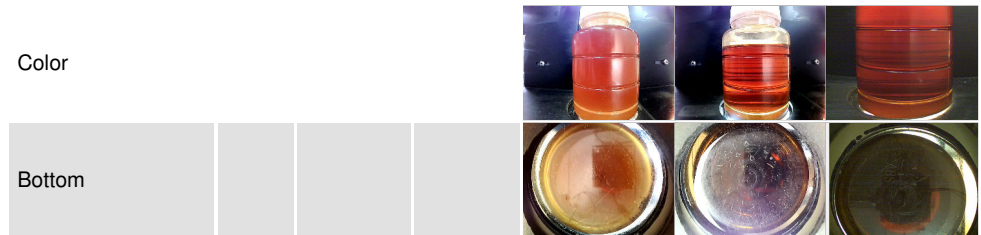

## GRAPHS

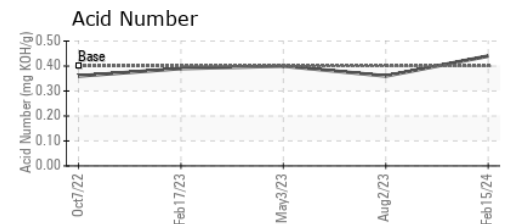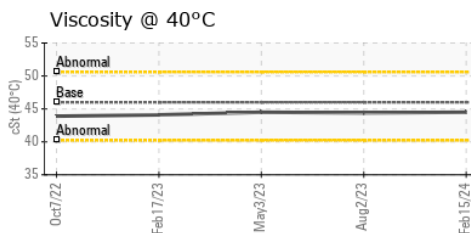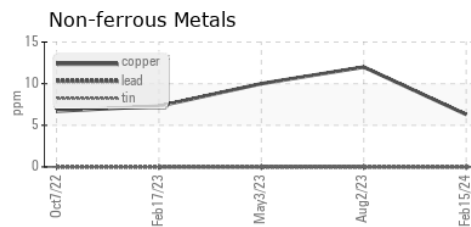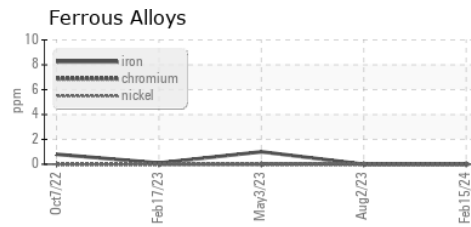

Certificate L2367

**Laboratory** : WearCheck USA - 501 Madison Ave., Cary, NC 27513  
**Sample No.** : KC121746  
**Lab Number** : 06121611  
**Unique Number** : 10930444  
**Test Package** : IND 2  
**Received** : 18 Mar 2024  
**Tested** : 21 Mar 2024  
**Diagnosed** : 21 Mar 2024 - Doug Bogart

**REINO LINEN**  
 119 S MAIN ST  
 GIBSONBURG, OH  
 US 43431

Contact: Service Manager  
 JOBERHAUS@REINOLINEN.COM

To discuss this sample report, contact Customer Service at 1-800-237-1369.

\* - Denotes test methods that are outside of the ISO 17025 scope of accreditation.

Statements of conformity to specifications are based on the simple acceptance decision rule (JCGM 106:2012)

T:  
F: