




OIL ANALYSIS REPORT

Sample Rating Trend

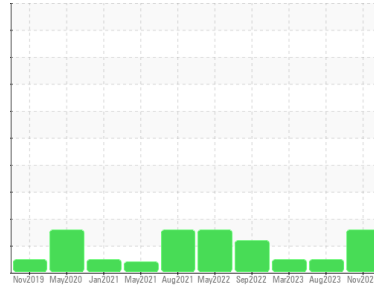

Machine Id
6539711 (S/N 1237)

Component
Compressor
Fluid
ACI 150FG (--- GAL)

DIAGNOSIS

Recommendation

No corrective action is recommended at this time. The filter change at the time of sampling has been noted. Resample at the next service interval to monitor.

Wear

All component wear rates are normal.

Contamination

There is a high amount of particulates present in the oil.

Fluid Condition

The AN level is acceptable for this fluid. The condition of the oil is suitable for further service.

SAMPLE INFORMATION

method	limit/base	current	history1	history2
Sample Number	Client Info	KC124790	KC125425	KC105616
Sample Date	Client Info	10 Nov 2023	12 Aug 2023	03 Mar 2023
Machine Age	hrs	23974	23584	22551
Oil Age	hrs	0	0	4566
Oil Changed	Client Info	N/A	N/A	Not Chngd
Sample Status		ABNORMAL	NORMAL	NORMAL

WEAR METALS

method	limit/base	current	history1	history2	
Iron	ppm	ASTM D5185m >50	15	13	3
Chromium	ppm	ASTM D5185m >10	0	0	<1
Nickel	ppm	ASTM D5185m >3	0	0	<1
Titanium	ppm	ASTM D5185m >3	0	0	0
Silver	ppm	ASTM D5185m >2	0	0	0
Aluminum	ppm	ASTM D5185m >10	0	<1	<1
Lead	ppm	ASTM D5185m >10	0	0	<1
Copper	ppm	ASTM D5185m >50	1	2	4
Tin	ppm	ASTM D5185m >10	0	0	<1
Vanadium	ppm	ASTM D5185m	0	0	0
Cadmium	ppm	ASTM D5185m	0	0	0

ADDITIVES

method	limit/base	current	history1	history2	
Boron	ppm	ASTM D5185m	0	0	0
Barium	ppm	ASTM D5185m	0	0	0
Molybdenum	ppm	ASTM D5185m	0	0	0
Manganese	ppm	ASTM D5185m	0	<1	<1
Magnesium	ppm	ASTM D5185m	1	0	12
Calcium	ppm	ASTM D5185m	0	0	0
Phosphorus	ppm	ASTM D5185m	402	407	78
Zinc	ppm	ASTM D5185m	61	42	36

CONTAMINANTS

method	limit/base	current	history1	history2	
Silicon	ppm	ASTM D5185m >25	0	<1	<1
Sodium	ppm	ASTM D5185m	0	<1	2
Potassium	ppm	ASTM D5185m >20	0	1	<1
Water	%	ASTM D6304 >0.05	0.011	0.013	0.006
ppm Water	ppm	ASTM D6304 >500	114	132.6	63.9






FLUID CLEANLINESS

method	limit/base	current	history1	history2
Particles >4µm	ASTM D7647	49814	3258	---
Particles >6µm	ASTM D7647 >1300	▲ 11597	980	---
Particles >14µm	ASTM D7647 >80	▲ 396	75	---
Particles >21µm	ASTM D7647 >20	▲ 82	12	---
Particles >38µm	ASTM D7647 >4	4	0	---
Particles >71µm	ASTM D7647 >3	1	0	---
Oil Cleanliness	ISO 4406 (c) >--/17/13	▲ 23/21/16	19/17/13	---

FLUID DEGRADATION

method	limit/base	current	history1	history2	
Acid Number (AN)	mg KOH/g	ASTM D8045	1.46	1.22	0.42

OIL ANALYSIS REPORT

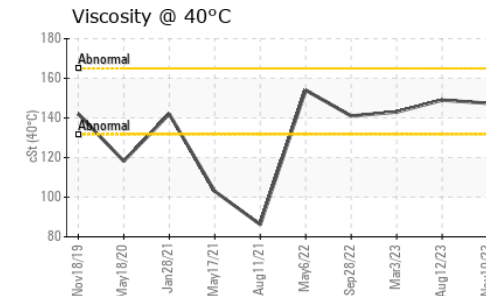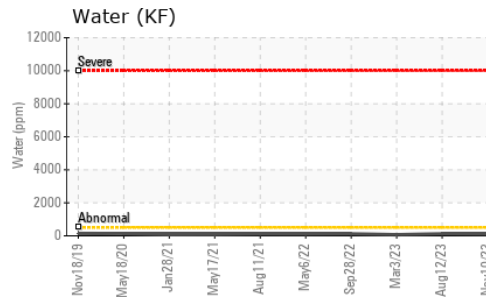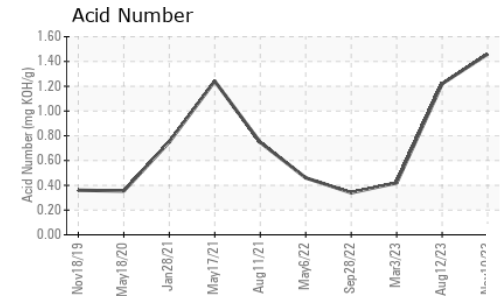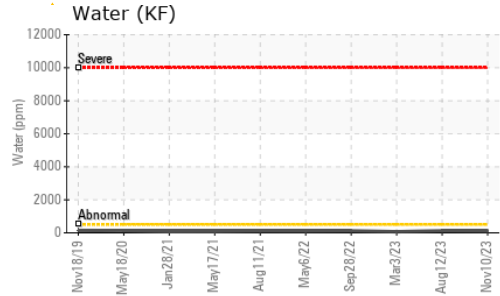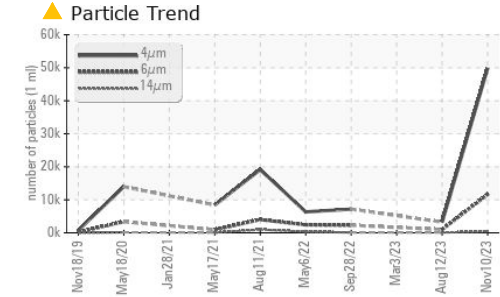






VISUAL	method	limit/base	current	history1	history2
White Metal	scalar	*Visual	NONE	NONE	MODER
Yellow Metal	scalar	*Visual	NONE	NONE	NONE
Precipitate	scalar	*Visual	NONE	NONE	NONE
Silt	scalar	*Visual	NONE	NONE	NONE
Debris	scalar	*Visual	NONE	NONE	NONE
Sand/Dirt	scalar	*Visual	NONE	NONE	NONE
Appearance	scalar	*Visual	NORML	NORML	NORML
Odor	scalar	*Visual	NORML	NORML	NORML
Emulsified Water	scalar	*Visual	>0.05	NEG	NEG
Free Water	scalar	*Visual		NEG	NEG

FLUID PROPERTIES	method	limit/base	current	history1	history2
Visc @ 40°C	cSt	ASTM D445	147.4	149	143

SAMPLE IMAGES

method	limit/base	current	history1	history2
Color				
Bottom				

GRAPHS

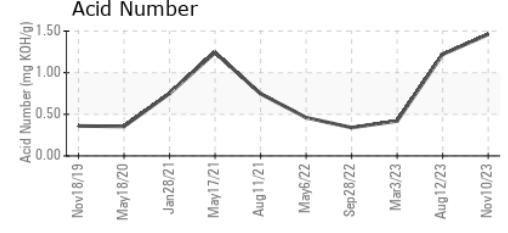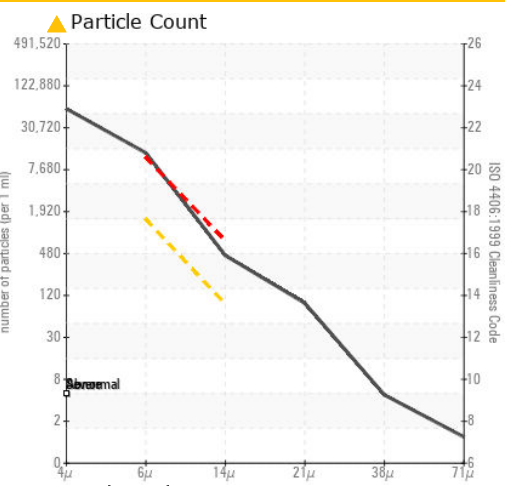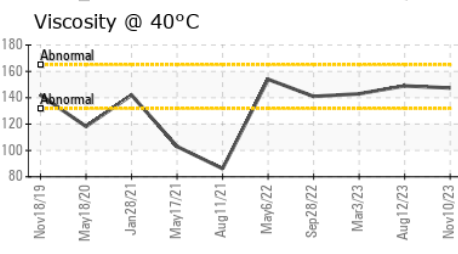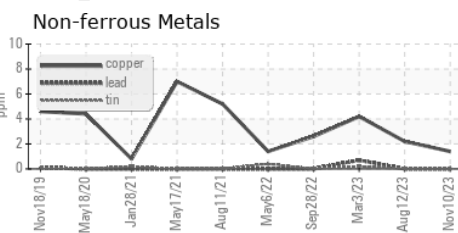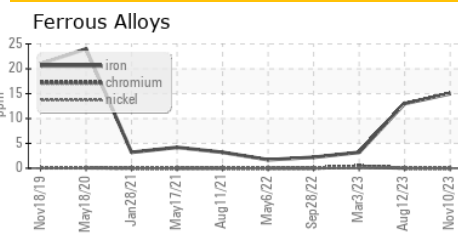

Laboratory : WearCheck USA - 501 Madison Ave., Cary, NC 27513
Sample No. : KC124790
Lab Number : 06121613
Unique Number : 10930446
Test Package : IND 2
Received : 18 Mar 2024
Tested : 21 Mar 2024
Diagnosed : 21 Mar 2024 - Doug Bogart

PREFORM TECHNOLOGIES
 11362 S AIRFIELD RD
 SWANTON, OH
 US 43558
 Contact: N NEINLOVE
 N.NEINLOVE@PREFORMTECHNOLOGIES.COM
 T:
 F:

Certificate L2367
 To discuss this sample report, contact Customer Service at 1-800-237-1369.
 * - Denotes test methods that are outside of the ISO 17025 scope of accreditation.
 Statements of conformity to specifications are based on the simple acceptance decision rule (JCGM 106:2012)