




OIL ANALYSIS REPORT

Sample Rating Trend

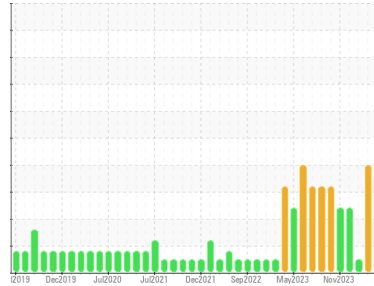

DIRT



Area
IRIG [6606319]
 Machine Id
IRIG-PRM-PMUD-0302 - 2MP IRIG-PRM-PMUD-0302 #2 MUD PUMP
 Component
Pump
 Fluid
MOBIL SHC 632 (--- GAL)

DIAGNOSIS

Recommendation

We advise that you check all areas where dirt can enter the system. We recommend you service the filters on this component if applicable. Resample at the next service interval to monitor.

Wear

All component wear rates are normal.

Contamination

There is a high amount of particulates present in the oil. Elemental levels of silicon (Si) and aluminum (Al) indicate alumina-silicate (coarse dirt) ingress.

Fluid Condition

The AN level is acceptable for this fluid. The condition of the oil is suitable for further service.

SAMPLE INFORMATION

method	limit/base	current	history1	history2
Sample Number	Client Info	HLC0003077	HLC0003018	HLC0003019
Sample Date	Client Info	20 Feb 2024	05 Feb 2024	01 Jan 2024
Machine Age	hrs	19109	19006	18882
Oil Age	hrs	0	0	0
Oil Changed	Client Info	Filtered	N/A	Filtered
Sample Status		ABNORMAL	ABNORMAL	NORMAL

CONTAMINATION

method	limit/base	current	history1	history2
Water	WC Method >.1	NEG	NEG	NEG

WEAR METALS

method	limit/base	current	history1	history2
Iron	ppm ASTM D5185m >90	30	58	2
Chromium	ppm ASTM D5185m >5	1	3	0
Nickel	ppm ASTM D5185m >5	0	0	0
Titanium	ppm ASTM D5185m >3	1	3	0
Silver	ppm ASTM D5185m >3	0	0	0
Aluminum	ppm ASTM D5185m >7	23	48	<1
Lead	ppm ASTM D5185m >12	0	0	0
Copper	ppm ASTM D5185m >30	4	7	0
Tin	ppm ASTM D5185m >9	<1	<1	0
Vanadium	ppm ASTM D5185m	0	0	0
Cadmium	ppm ASTM D5185m	0	0	0

ADDITIVES

method	limit/base	current	history1	history2
Boron	ppm ASTM D5185m	0	0	0
Barium	ppm ASTM D5185m	11	25	0
Molybdenum	ppm ASTM D5185m	0	0	0
Manganese	ppm ASTM D5185m	<1	<1	0
Magnesium	ppm ASTM D5185m	6	5	0
Calcium	ppm ASTM D5185m	17	24	0
Phosphorus	ppm ASTM D5185m	438	414	495
Zinc	ppm ASTM D5185m	2	0	0
Sulfur	ppm ASTM D5185m	120	108	0

CONTAMINANTS

method	limit/base	current	history1	history2
Silicon	ppm ASTM D5185m >60	▲ 64	▲ 119	27
Sodium	ppm ASTM D5185m	24	49	2
Potassium	ppm ASTM D5185m >20	23	44	<1

FLUID CLEANLINESS


method	limit/base	current	history1	history2
Particles >4µm	ASTM D7647 >320000	212407	298950	30105
Particles >6µm	ASTM D7647 >40000	▲ 132883	▲ 142248	2386
Particles >14µm	ASTM D7647 >640	▲ 1737	598	25
Particles >21µm	ASTM D7647 >160	33	58	6
Particles >38µm	ASTM D7647 >40	2	0	1
Particles >71µm	ASTM D7647 >10	2	0	1
Oil Cleanliness	ISO 4406 (c) >25/22/16	▲ 25/24/18	▲ 25/24/16	22/18/12

FLUID DEGRADATION


method	limit/base	current	history1	history2
Acid Number (AN)	mg KOH/g ASTM D8045	0.30	0.34	0.62

OIL ANALYSIS REPORT


▲ Particle Trend

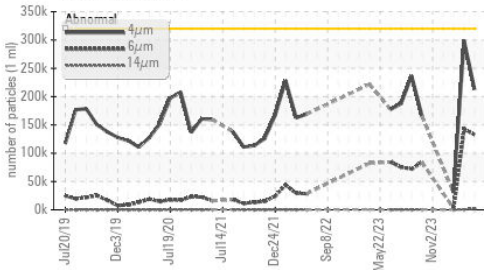


▲ Silicon (ppm)

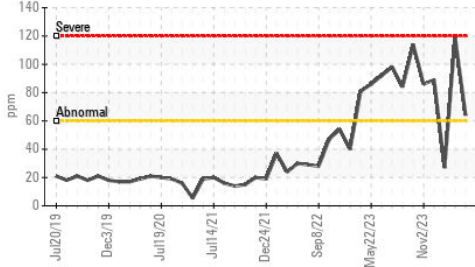


● Aluminum (ppm)

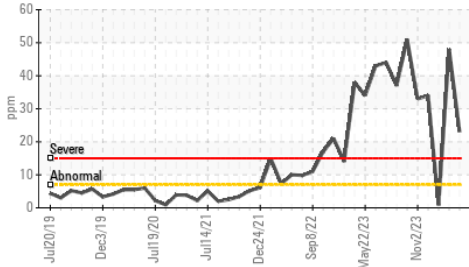

● Aluminum (ppm)

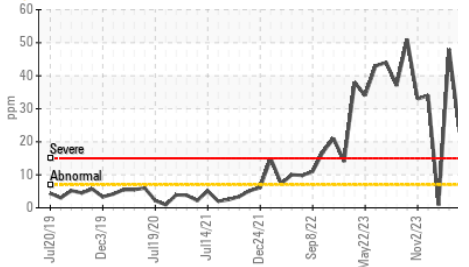


Acid Number

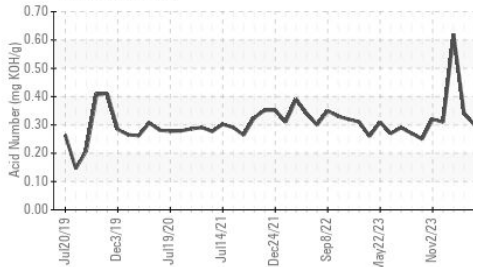






VISUAL	method	limit/base	current	history1	history2
White Metal	scalar	*Visual	NONE	NONE	NONE
Yellow Metal	scalar	*Visual	NONE	NONE	NONE
Precipitate	scalar	*Visual	NONE	NONE	NONE
Silt	scalar	*Visual	NONE	NONE	NONE
Debris	scalar	*Visual	NONE	LIGHT	NONE
Sand/Dirt	scalar	*Visual	NONE	NONE	NONE
Appearance	scalar	*Visual	NORML	HAZY	NORML
Odor	scalar	*Visual	NORML	NORML	NORML
Emulsified Water	scalar	*Visual	>.1	NEG	NEG
Free Water	scalar	*Visual		NEG	NEG

FLUID PROPERTIES	method	limit/base	current	history1	history2
Visc @ 40°C	cSt	ASTM D445	325.8	491	486

SAMPLE IMAGES	method	limit/base	current	history1	history2
---------------	--------	------------	---------	----------	----------

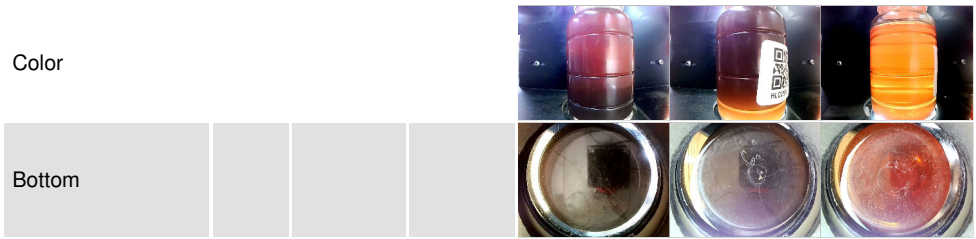

GRAPHS

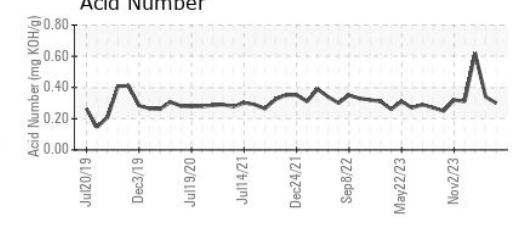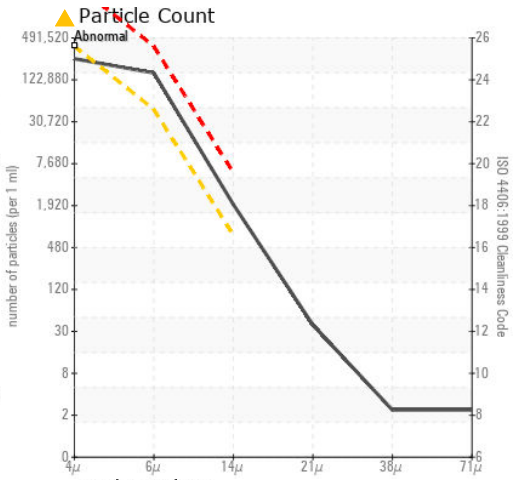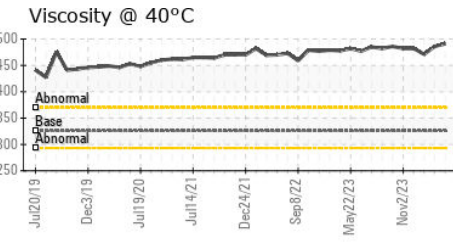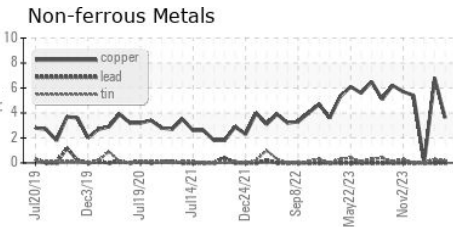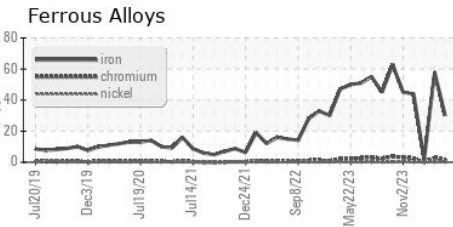

Laboratory : WearCheck USA - 501 Madison Ave., Cary, NC 27513
Sample No. : HLC0003077
Lab Number : 06121645
Unique Number : 10930478
Test Package : IND 2 (Additional Tests: PrtCount)

HILCORP EXPLORATION ALASKA - MILNE POINT
 1000 MILNE POINT RD
 PRUDOE BAY, AK
 US 99734

Received : 18 Mar 2024
Tested : 25 Mar 2024
Diagnosed : 25 Mar 2024 - Jonathan Hester
 Contact: Evan Reilly
 evan.reilly@hilcorp.com
 T: (907)670-3231
 F: x: