


# OIL ANALYSIS REPORT

Sample Rating Trend



ISO

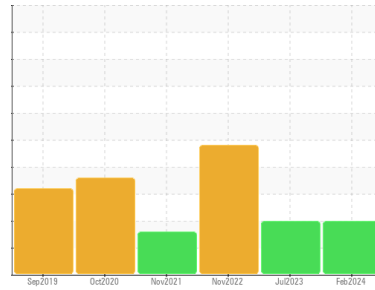

Machine Id  
**KAESER ASD 25 6097754 (S/N 1214)**

Component  
**Compressor**

Fluid  
**KAESER SIGMA (OEM) S-460 (--- GAL)**

## DIAGNOSIS

### ▲ Recommendation

No corrective action is recommended at this time. The filter change at the time of sampling has been noted. Resample at the next service interval to monitor.

### Wear

All component wear rates are normal.

### ▲ Contamination

There is a high amount of particulates present in the oil.

### Fluid Condition

The AN level is acceptable for this fluid. The condition of the oil is suitable for further service.

## SAMPLE INFORMATION

	method	limit/base	current	history1	history2
Sample Number	Client Info		<b>KC06122319</b>	KC05897463	KC05741526
Sample Date	Client Info		<b>08 Feb 2024</b>	03 Jul 2023	12 Nov 2022
Machine Age	hrs	Client Info	<b>36838</b>	31566	26696
Oil Age	hrs	Client Info	<b>0</b>	0	0
Oil Changed	Client Info		<b>N/A</b>	N/A	N/A
Sample Status			<b>ABNORMAL</b>	ABNORMAL	ABNORMAL

## WEAR METALS

	method	limit/base	current	history1	history2
Iron	ppm	ASTM D5185m >50	<b>0</b>	0	0
Chromium	ppm	ASTM D5185m >10	<b>0</b>	0	0
Nickel	ppm	ASTM D5185m >3	<b>0</b>	0	0
Titanium	ppm	ASTM D5185m >3	<b>0</b>	<1	0
Silver	ppm	ASTM D5185m >2	<b>0</b>	0	0
Aluminum	ppm	ASTM D5185m >10	<b>0</b>	<1	0
Lead	ppm	ASTM D5185m >10	<b>0</b>	0	0
Copper	ppm	ASTM D5185m >50	<b>14</b>	13	12
Tin	ppm	ASTM D5185m >10	<b>0</b>	0	0
Antimony	ppm	ASTM D5185m	<b>---</b>	---	---
Vanadium	ppm	ASTM D5185m	<b>0</b>	<1	0
Cadmium	ppm	ASTM D5185m	<b>0</b>	0	0

## ADDITIVES

	method	limit/base	current	history1	history2
Boron	ppm	ASTM D5185m	<b>0</b>	0	0
Barium	ppm	ASTM D5185m 90	<b>0</b>	0	0
Molybdenum	ppm	ASTM D5185m	<b>0</b>	0	0
Manganese	ppm	ASTM D5185m	<b>0</b>	0	0
Magnesium	ppm	ASTM D5185m 90	<b>0</b>	3	<1
Calcium	ppm	ASTM D5185m 2	<b>0</b>	0	0
Phosphorus	ppm	ASTM D5185m	<b>0</b>	<1	18
Zinc	ppm	ASTM D5185m	<b>69</b>	61	0

## CONTAMINANTS

	method	limit/base	current	history1	history2
Silicon	ppm	ASTM D5185m >25	<b>0</b>	<1	<1
Sodium	ppm	ASTM D5185m	<b>0</b>	2	<1
Potassium	ppm	ASTM D5185m >20	<b>0</b>	4	0
Water	%	ASTM D6304 >0.05	<b>0.003</b>	0.018	▲ 0.092
ppm Water	ppm	ASTM D6304 >500	<b>35</b>	185.1	▲ 920






## FLUID CLEANLINESS

	method	limit/base	current	history1	history2
Particles >4µm	ASTM D7647		<b>9177</b>	15398	2007
Particles >6µm	ASTM D7647	>1300	▲ <b>3865</b>	▲ 8113	1094
Particles >14µm	ASTM D7647	>80	▲ <b>584</b>	▲ 1835	▲ 186
Particles >21µm	ASTM D7647	>20	▲ <b>198</b>	▲ 709	▲ 63
Particles >38µm	ASTM D7647	>4	▲ <b>16</b>	▲ 57	▲ 10
Particles >71µm	ASTM D7647	>3	<b>0</b>	2	1
Oil Cleanliness	ISO 4406 (c)	>--/17/13	▲ <b>20/19/16</b>	▲ 21/20/18	▲ 18/17/15

## FLUID DEGRADATION

	method	limit/base	current	history1	history2
Acid Number (AN)	mg KOH/g	ASTM D8045 0.4	<b>0.47</b>	0.42	0.38

# OIL ANALYSIS REPORT

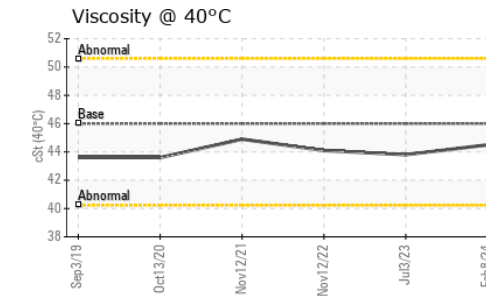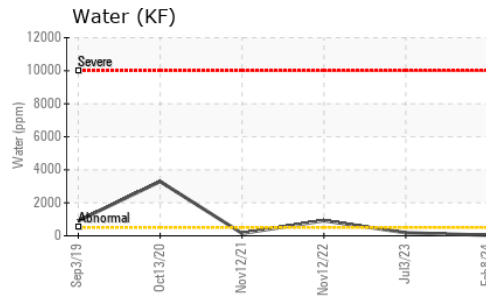
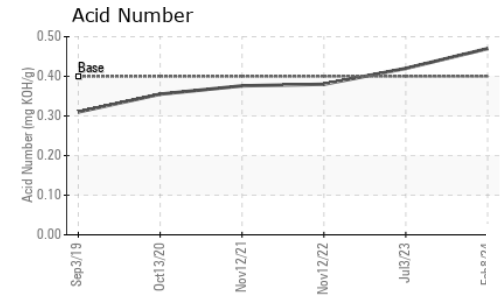
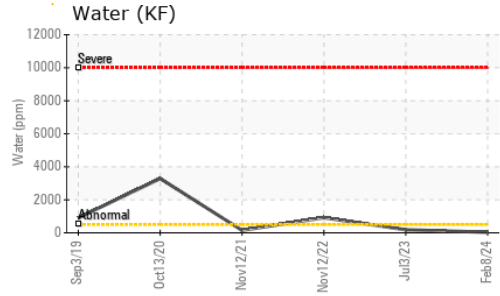
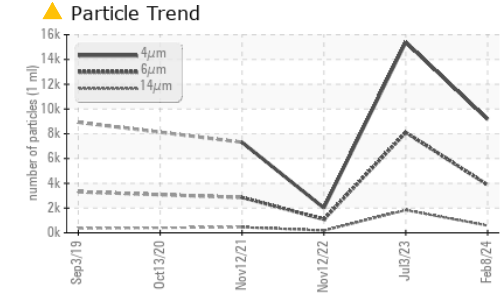


VISUAL	method	limit/base	current	history1	history2
White Metal	scalar	*Visual	NONE	NONE	NONE
Yellow Metal	scalar	*Visual	NONE	NONE	NONE
Precipitate	scalar	*Visual	NONE	NONE	NONE
Silt	scalar	*Visual	NONE	NONE	NONE
Debris	scalar	*Visual	NONE	NONE	NONE
Sand/Dirt	scalar	*Visual	NONE	NONE	NONE
Appearance	scalar	*Visual	NORML	NORML	NORML
Odor	scalar	*Visual	NORML	NORML	NORML
Emulsified Water	scalar	*Visual	>0.05	NEG	0.2%
Free Water	scalar	*Visual		NEG	▲ 1.0

FLUID PROPERTIES	method	limit/base	current	history1	history2
Visc @ 40°C	cSt	ASTM D445	46	44.5	43.8

SAMPLE IMAGES	method	limit/base	current	history1	history2
Color					
Bottom					

## GRAPHS

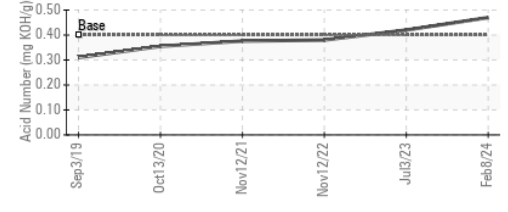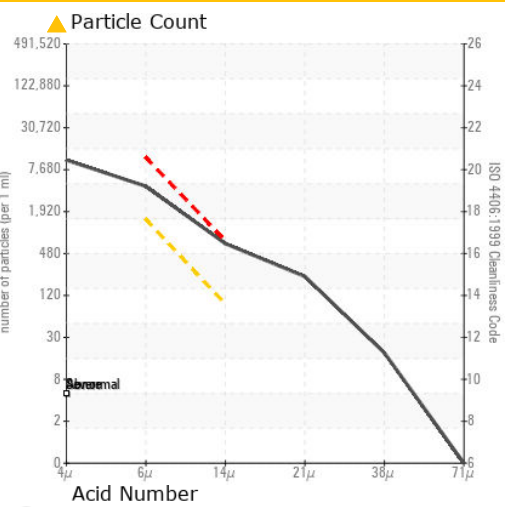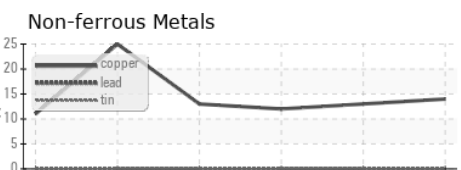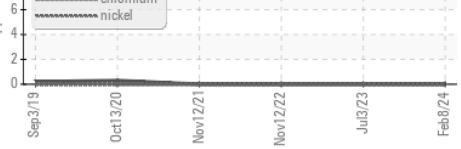

**Laboratory** : WearCheck USA - 501 Madison Ave., Cary, NC 27513  
**Sample No.** : KC06122319  
**Lab Number** : 06122319  
**Unique Number** : 10936470  
**Test Package** : IND 2  
**Received** : 19 Mar 2024  
**Tested** : 20 Mar 2024  
**Diagnosed** : 21 Mar 2024 - Don Baldrige

**BITZER**  
 4031 CHAMBLEE RD  
 OAKWOOD, GA  
 US 30566  
 Contact: Service Manager

To discuss this sample report, contact Customer Service at 1-800-237-1369.  
 \* - Denotes test methods that are outside of the ISO 17025 scope of accreditation.  
 Statements of conformity to specifications are based on the simple acceptance decision rule (JCGM 106:2012)

T:  
F: