KAESER COMPRESSORS
Built for a lifetime.

OIL ANALYSIS REPORT

Sample Rating Trend

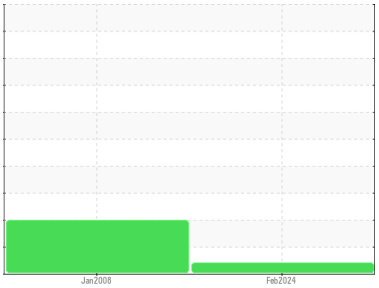

VIS DEBRIS

Machine Id
KAESER ASD 40S 2362414 (S/N 1062)
Component
Compressor
Fluid
KAESER SIGMA (OEM) S-680 (--- GAL)

DIAGNOSIS

Recommendation
No corrective action is recommended at this time. The filter change at the time of sampling has been noted. Resample at the next service interval to monitor. We were unable to perform a particle count due to a high concentration of particles present in this sample.

Wear
All component wear rates are normal.

Contamination
Moderate concentration of visible dirt/debris present in the oil.

Fluid Condition
The AN level is acceptable for this fluid. The condition of the oil is suitable for further service.

SAMPLE INFORMATION		method	limit/base	current	history1	history2
Sample Number		Client Info		**KC06122336**	KC12160	---
Sample Date		Client Info		**26 Feb 2024**	11 Jan 2008	---
Machine Age	hrs	Client Info		**62887**	6587	---
Oil Age	hrs	Client Info		**0**	8000	---
Oil Changed		Client Info		**N/A**	N/A	---
Sample Status				**ABNORMAL**	ABNORMAL	---

WEAR METALS		method	limit/base	current	history1	history2
Iron	ppm	ASTM D5185m	>50	**0**	1	---
Chromium	ppm	ASTM D5185m	>10	**0**	0	---
Nickel	ppm	ASTM D5185m	>3	**0**	0	---
Titanium	ppm	ASTM D5185m	>3	**0**	0	---
Silver	ppm	ASTM D5185m	>2	**0**	0	---
Aluminum	ppm	ASTM D5185m	>10	**<1**	<1	---
Lead	ppm	ASTM D5185m	>10	**0**	0	---
Copper	ppm	ASTM D5185m	>50	**23**	11	---
Tin	ppm	ASTM D5185m	>10	**<1**	0	---
Antimony	ppm	ASTM D5185m		**---**	0	---
Vanadium	ppm	ASTM D5185m		**0**	0	---
Cadmium	ppm	ASTM D5185m		**0**	0	---

ADDITIVES		method	limit/base	current	history1	history2
Boron	ppm	ASTM D5185m		**0**	0	---
Barium	ppm	ASTM D5185m		**0**	0	---
Molybdenum	ppm	ASTM D5185m		**0**	0	---
Manganese	ppm	ASTM D5185m		**0**	<1	---
Magnesium	ppm	ASTM D5185m		**0**	26	---
Calcium	ppm	ASTM D5185m		**0**	0	---
Phosphorus	ppm	ASTM D5185m		**0**	3	---
Zinc	ppm	ASTM D5185m		**0**	26	---

CONTAMINANTS		method	limit/base	current	history1	history2
Silicon	ppm	ASTM D5185m	>25	**0**	0	---
Sodium	ppm	ASTM D5185m		**0**	32	---
Potassium	ppm	ASTM D5185m	>20	**0**	0	---
Water	%	ASTM D6304	>0.05	**0.008**	0.002	---
ppm Water	ppm	ASTM D6304	>500	**81**	---	---

FLUID CLEANLINESS	method	limit/base	current	history1	history2
Particles >4µm	ASTM D7647		**---**	358988	---
Particles >6µm	ASTM D7647	>1300	**---**	▲ 195556	---
Particles >14µm	ASTM D7647	>80	**---**	▲ 33318	---
Particles >21µm	ASTM D7647	>20	**---**	▲ 11243	---
Particles >38µm	ASTM D7647	>4	**---**	▲ 1736	---
Particles >71µm	ASTM D7647	>3	**---**	▲ 179	---
Oil Cleanliness	ISO 4406 (c)	>--/17/13	**---**	▲ 25/22	---

FLUID DEGRADATION		method	limit/base	current	history1	history2
Acid Number (AN)	mg KOH/g	ASTM D8045	0.25	**0.58**	0.388	---

KAESER COMPRESSORS
Built for a lifetime.

OIL ANALYSIS REPORT

Water (KF)

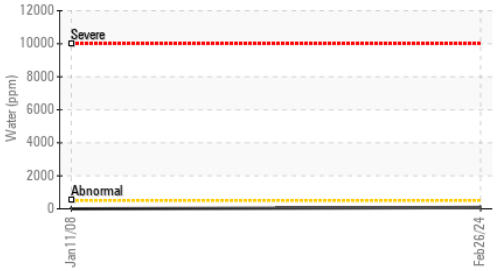

Water (KF)

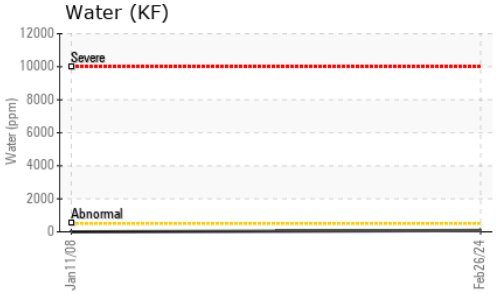

Viscosity @ 40°C

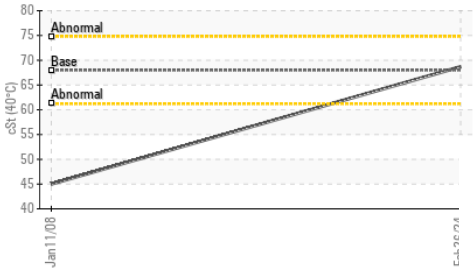

VISUAL		method	limit/base	current	history1	history2
White Metal	scalar	*Visual	NONE	**NONE**	NONE	---
Yellow Metal	scalar	*Visual	NONE	**NONE**	NONE	---
Precipitate	scalar	*Visual	NONE	**NONE**	NONE	---
Silt	scalar	*Visual	NONE	**NONE**	NONE	---
Debris	scalar	*Visual	NONE	▲ **MODER**	LIGHT	---
Sand/Dirt	scalar	*Visual	NONE	**NONE**	NONE	---
Appearance	scalar	*Visual	NORML	**NORML**	NORML	---
Odor	scalar	*Visual	NORML	**NORML**	NORML	---
Emulsified Water	scalar	*Visual	>0.05	**NEG**	NEG	---
Free Water	scalar	*Visual		**NEG**	NEG	---

FLUID PROPERTIES		method	limit/base	current	history1	history2
Visc @ 40°C	cSt	ASTM D445	68	**68.7**	45.00	---

SAMPLE IMAGES	method	limit/base	current	history1	history2
Color				*no image*	*no image*
Bottom				*no image*	*no image*

GRAPHS

Ferrous Alloys

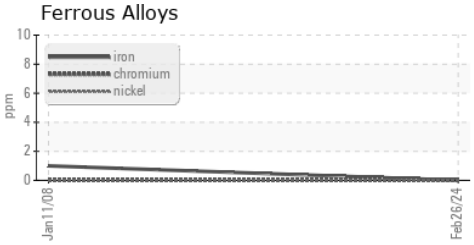

Non-ferrous Metals

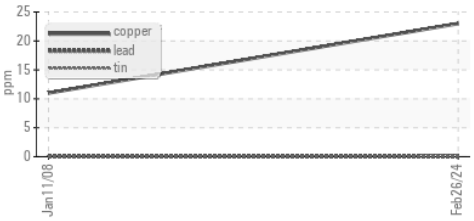

Viscosity @ 40°C

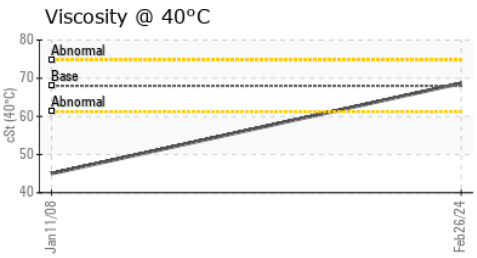

Acid Number

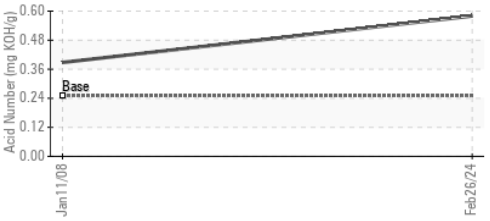

Certificate L2367

Laboratory : WearCheck USA - 501 Madison Ave., Cary, NC 27513
Sample No. : KC06122336
Lab Number : 06122336
Unique Number : 10936487
Test Package : IND 2

Received : 19 Mar 2024
Tested : 21 Mar 2024
Diagnosed : 21 Mar 2024 - Don Baldridge

CARRY ON TRAILER
LAVONIA, GA
US 30553
Contact: SERVICE MANAGER
T:
F:

To discuss this sample report, contact Customer Service at 1-800-237-1369.
** - Denotes test methods that are outside of the ISO 17025 scope of accreditation.*
Statements of conformity to specifications are based on the simple acceptance decision rule (JCGM 106:2012)