




OIL ANALYSIS REPORT

Sample Rating Trend

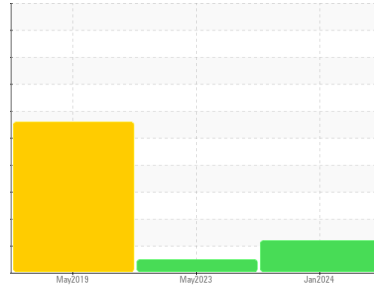

ISO



Machine Id
KAESER SK 15 6637926 (S/N 1031)

Component
Compressor
Fluid
KAESER SIGMA (OEM) S-460 (--- GAL)

DIAGNOSIS

Recommendation

No corrective action is recommended at this time. The filter change at the time of sampling has been noted. Resample at the next service interval to monitor.

Wear

All component wear rates are normal.

Contamination

There is a moderate amount of particulates present in the oil.

Fluid Condition

The AN level is acceptable for this fluid. The condition of the oil is suitable for further service.

SAMPLE INFORMATION

	method	limit/base	current	history1	history2
Sample Number	Client Info		KC100890	KC111250	KC77717
Sample Date	Client Info		15 Jan 2024	01 May 2023	07 May 2019
Machine Age	hrs	Client Info	19184	16829	646
Oil Age	hrs	Client Info	0	0	0
Oil Changed	Client Info		Not Chngd	Changed	Changed
Sample Status			ATTENTION	NORMAL	ABNORMAL

WEAR METALS

	method	limit/base	current	history1	history2
Iron	ppm	ASTM D5185m >50	0	0	2
Chromium	ppm	ASTM D5185m >10	0	0	0
Nickel	ppm	ASTM D5185m >3	0	0	0
Titanium	ppm	ASTM D5185m >3	0	0	0
Silver	ppm	ASTM D5185m >2	0	0	0
Aluminum	ppm	ASTM D5185m >10	<1	0	<1
Lead	ppm	ASTM D5185m >10	0	0	<1
Copper	ppm	ASTM D5185m >50	0	11	2
Tin	ppm	ASTM D5185m >10	<1	0	0
Antimony	ppm	ASTM D5185m	---	---	0
Vanadium	ppm	ASTM D5185m	0	0	0
Cadmium	ppm	ASTM D5185m	0	0	0

ADDITIVES

	method	limit/base	current	history1	history2
Boron	ppm	ASTM D5185m	0	0	<1
Barium	ppm	ASTM D5185m 90	0	2	8
Molybdenum	ppm	ASTM D5185m	0	0	0
Manganese	ppm	ASTM D5185m	0	0	<1
Magnesium	ppm	ASTM D5185m 90	0	<1	58
Calcium	ppm	ASTM D5185m 2	0	0	4
Phosphorus	ppm	ASTM D5185m	0	129	4
Zinc	ppm	ASTM D5185m	0	22	5

CONTAMINANTS

	method	limit/base	current	history1	history2
Silicon	ppm	ASTM D5185m >25	0	0	1
Sodium	ppm	ASTM D5185m	0	0	4
Potassium	ppm	ASTM D5185m >20	0	<1	<1
Water	%	ASTM D6304 >0.05	0.011	0.004	▲ 0.521
ppm Water	ppm	ASTM D6304 >500	116	43.8	▲ 5210






FLUID CLEANLINESS

	method	limit/base	current	history1	history2
Particles >4µm	ASTM D7647		3918	---	2794
Particles >6µm	ASTM D7647 >1300		949	---	● 1522
Particles >14µm	ASTM D7647 >80		● 89	---	▲ 259
Particles >21µm	ASTM D7647 >20		● 31	---	▲ 87
Particles >38µm	ASTM D7647 >4		1	---	▲ 13
Particles >71µm	ASTM D7647 >3		0	---	1
Oil Cleanliness	ISO 4406 (c) >--/17/13		● 19/17/14	---	▲ 18/15

FLUID DEGRADATION

	method	limit/base	current	history1	history2
Acid Number (AN)	mg KOH/g	ASTM D8045 0.4	0.23	0.29	0.360


OIL ANALYSIS REPORT

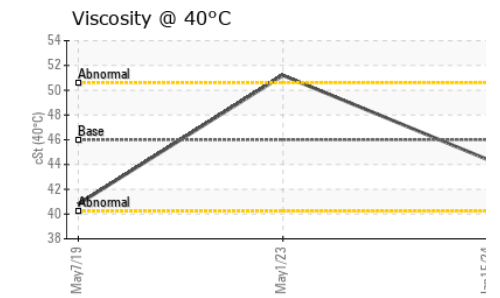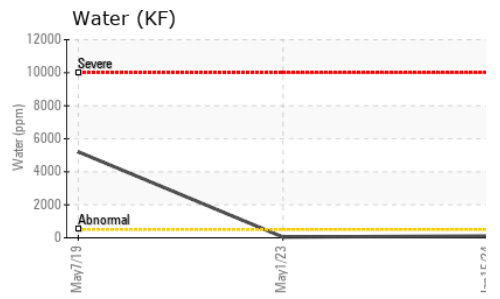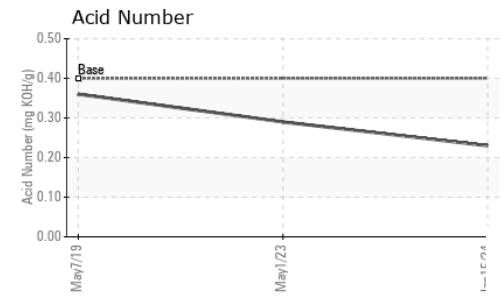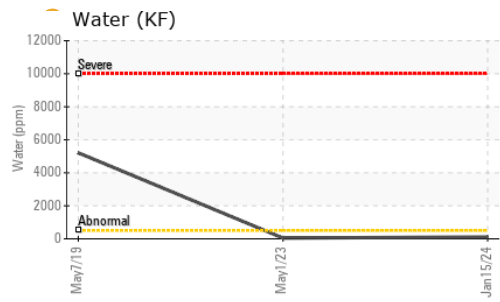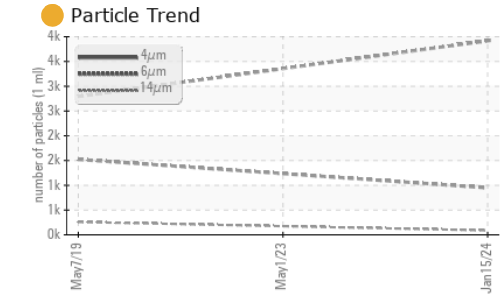





VISUAL	method	limit/base	current	history1	history2
White Metal	scalar	*Visual	NONE	NONE	MODER
Yellow Metal	scalar	*Visual	NONE	NONE	NONE
Precipitate	scalar	*Visual	NONE	NONE	NONE
Silt	scalar	*Visual	NONE	NONE	NONE
Debris	scalar	*Visual	NONE	NONE	NONE
Sand/Dirt	scalar	*Visual	NONE	NONE	NONE
Appearance	scalar	*Visual	NORML	NORML	HAZY
Odor	scalar	*Visual	NORML	NORML	NORML
Emulsified Water	scalar	*Visual	>0.05	NEG	0.2%
Free Water	scalar	*Visual		NEG	2.0

FLUID PROPERTIES	method	limit/base	current	history1	history2
Visc @ 40°C	cSt	ASTM D445	46	44.4	51.2

SAMPLE IMAGES	method	limit/base	current	history1	history2
---------------	--------	------------	---------	----------	----------

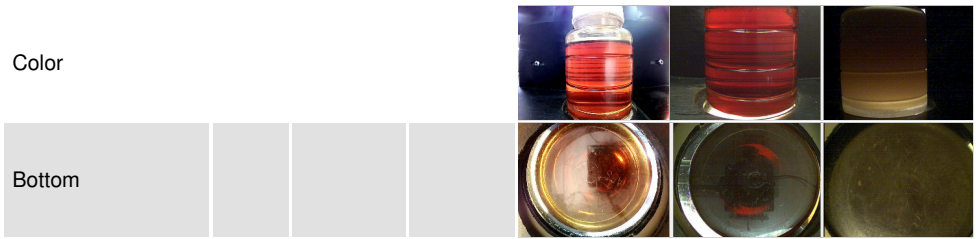

GRAPHS

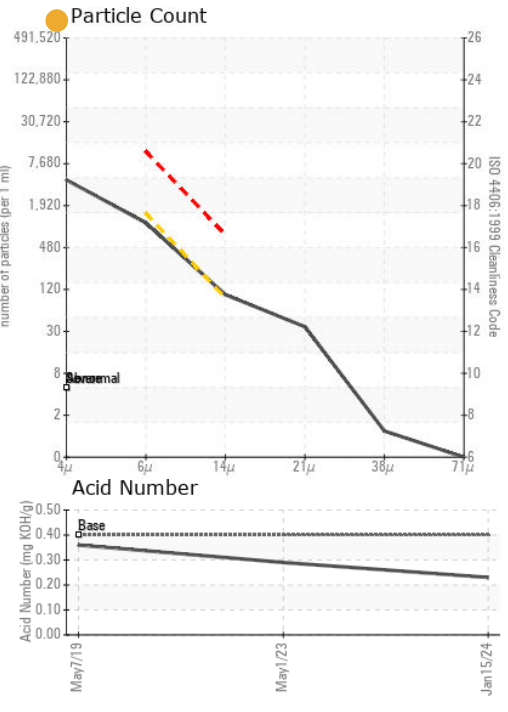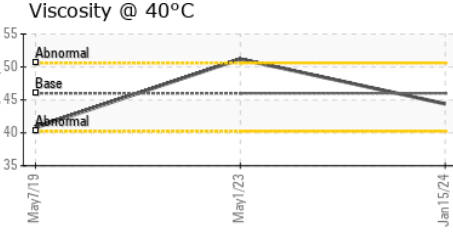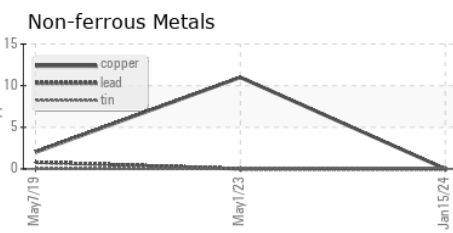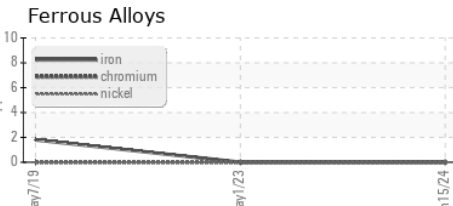

Laboratory : WearCheck USA - 501 Madison Ave., Cary, NC 27513
Sample No. : KC100890
Lab Number : 06122342
Unique Number : 10936493
Test Package : IND 2

AUTONATION CHEVROLET BODY SHOP
 5757 LAKE WORTH RD
 GREENACRES, FL
 US 33463
 Contact: Service Manager

To discuss this sample report, contact Customer Service at 1-800-237-1369.
 * - Denotes test methods that are outside of the ISO 17025 scope of accreditation.
 Statements of conformity to specifications are based on the simple acceptance decision rule (JCGM 106:2012)