



# OIL ANALYSIS REPORT

Area  
**JBS 258**  
 Machine Id  
**GARDNER DENVER S004569 - SRK (S/N 5004569)**  
 Component  
**Compressor**

Sample Rating Trend

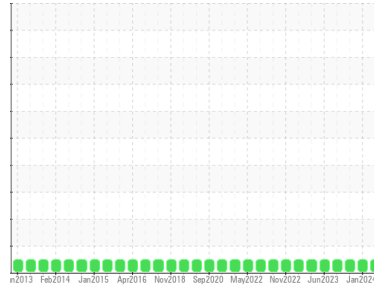

## DIAGNOSIS

- Recommendation**  
 Resample at the next service interval to monitor.
- Wear**  
 All component wear rates are normal.
- Contamination**  
 There is no indication of any contamination in the oil.
- Fluid Condition**  
 The AN level is acceptable for this fluid. The condition of the oil is suitable for further service.

## SAMPLE INFORMATION

	method	limit/base	current	history1	history2
Sample Number	Client Info		<b>UCH06122490</b>	UCH06069590	UCH06006426
Sample Date	Client Info		<b>08 Mar 2024</b>	18 Jan 2024	06 Nov 2023
Machine Age	hrs	Client Info	<b>24345</b>	23333	27328
Oil Age	hrs	Client Info	<b>1013</b>	999	7669
Oil Changed	Client Info		<b>N/A</b>	N/A	N/A
Sample Status			<b>NORMAL</b>	NORMAL	NORMAL

## CONTAMINATION

	method	limit/base	current	history1	history2
Water	WC Method	>0.1	<b>NEG</b>	NEG	NEG

## WEAR METALS

	method	limit/base	current	history1	history2
Iron	ppm	ASTM D5185m >50	<b>0</b>	0	0
Chromium	ppm	ASTM D5185m >10	<b>0</b>	0	0
Nickel	ppm	ASTM D5185m	<b>0</b>	0	0
Titanium	ppm	ASTM D5185m	<b>0</b>	0	0
Silver	ppm	ASTM D5185m	<b>0</b>	0	0
Aluminum	ppm	ASTM D5185m >25	<b>0</b>	0	0
Lead	ppm	ASTM D5185m >25	<b>0</b>	0	0
Copper	ppm	ASTM D5185m >50	<b>0</b>	<1	<1
Tin	ppm	ASTM D5185m >15	<b>0</b>	<1	0
Vanadium	ppm	ASTM D5185m	<b>0</b>	0	0
Cadmium	ppm	ASTM D5185m	<b>0</b>	0	0

## ADDITIVES

	method	limit/base	current	history1	history2
Boron	ppm	ASTM D5185m 0.0	<b>0</b>	0	0
Barium	ppm	ASTM D5185m 0.0	<b>0</b>	0	0
Molybdenum	ppm	ASTM D5185m 0	<b>0</b>	0	0
Manganese	ppm	ASTM D5185m 0	<b>0</b>	<1	0
Magnesium	ppm	ASTM D5185m 0.0	<b>0</b>	0	0
Calcium	ppm	ASTM D5185m 0.0	<b>0</b>	1	0
Phosphorus	ppm	ASTM D5185m 966	<b>156</b>	177	106
Zinc	ppm	ASTM D5185m 0	<b>0</b>	2	0
Sulfur	ppm	ASTM D5185m 1309	<b>1758</b>	1602	1203


## CONTAMINANTS

	method	limit/base	current	history1	history2
Silicon	ppm	ASTM D5185m >25	<b>1</b>	3	2
Sodium	ppm	ASTM D5185m	<b>0</b>	<1	1
Potassium	ppm	ASTM D5185m >20	<b>0</b>	0	0

## FLUID DEGRADATION

	method	limit/base	current	history1	history2
Acid Number (AN)	mg KOH/g	ASTM D8045 0.172	<b>0.14</b>	0.13	0.15


# OIL ANALYSIS REPORT

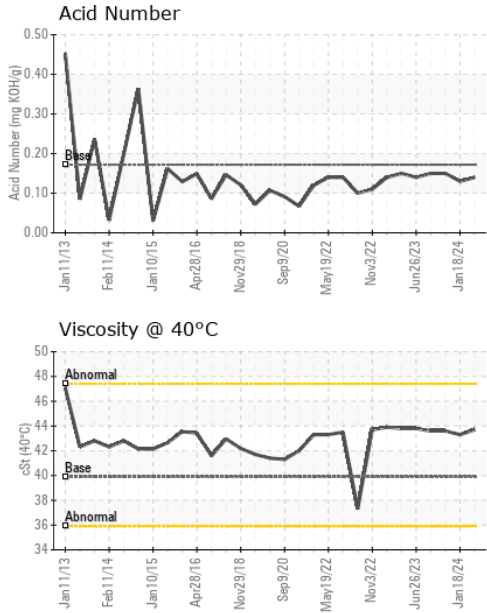





VISUAL	method	limit/base	current	history1	history2
White Metal	scalar	*Visual	NONE	NONE	NONE
Yellow Metal	scalar	*Visual	NONE	NONE	NONE
Precipitate	scalar	*Visual	NONE	NONE	NONE
Silt	scalar	*Visual	NONE	NONE	NONE
Debris	scalar	*Visual	NONE	NONE	NONE
Sand/Dirt	scalar	*Visual	NONE	NONE	NONE
Appearance	scalar	*Visual	NORML	NORML	NORML
Odor	scalar	*Visual	NORML	NORML	NORML
Emulsified Water	scalar	*Visual	>0.1	NEG	NEG
Free Water	scalar	*Visual		NEG	NEG

FLUID PROPERTIES	method	limit/base	current	history1	history2	
Visc @ 40°C	cSt	ASTM D445	39.9	<b>43.7</b>	43.3	43.6

SAMPLE IMAGES	method	limit/base	current	history1	history2
---------------	--------	------------	---------	----------	----------

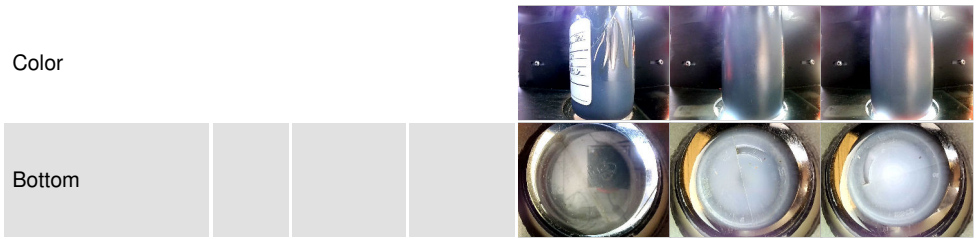

## GRAPHS

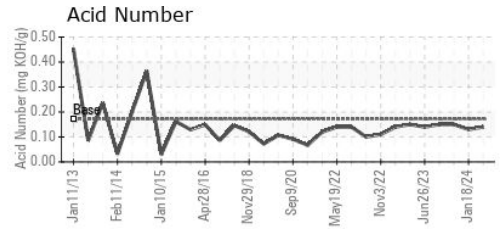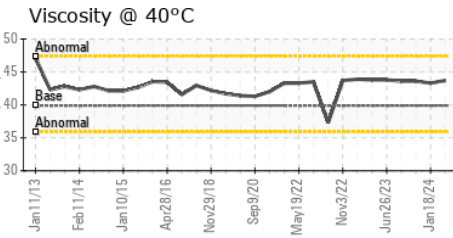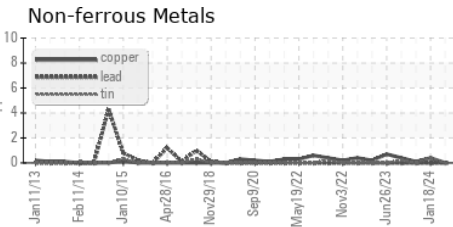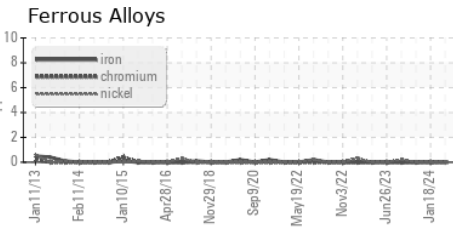

**Laboratory** : WearCheck USA - 501 Madison Ave., Cary, NC 27513  
**Sample No.** : UCH06122490 **Received** : 19 Mar 2024  
**Lab Number** : **06122490** **Tested** : 20 Mar 2024  
**Unique Number** : 10936641 **Diagnosed** : 21 Mar 2024 - Sean Felton  
**Test Package** : IND 2

**JOHN BOUCHARD & SONS**  
 1024 HARRISON ST.  
 NASHVILLE, TN  
 US 37203  
 Contact: STEVE SANDERS  
 Steve.sanders@jbouchard.com  
 T:  
 F: (865)544-1400

To discuss this sample report, contact Customer Service at 1-800-237-1369.  
 \* - Denotes test methods that are outside of the ISO 17025 scope of accreditation.  
 Statements of conformity to specifications are based on the simple acceptance decision rule (JCGM 106:2012)