




FUEL REPORT

Sample Rating Trend

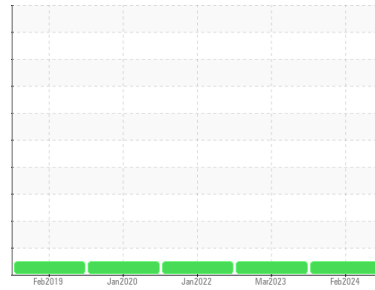

NORMAL



Area

[PMIAS3286763]

Machine Id

KATOLIGHT SED200FPJ4T3 152714-1007

Component

Diesel Fuel

Fluid

No.2 DIESEL FUEL (LOW-SULPHUR) (--- GAL)

DIAGNOSIS

Recommendation

All laboratory tests indicate that this sample meets specifications for No.2 low-sulfur diesel fuel.

Corrosion

All metal levels are normal indicating no corrosion in the system.

Contaminants

The water content is negligible. There is no bacteria or fungus (yeast and/or mold) indicated in the sample. There is no indication of any contamination in the fuel.

Fuel Condition

Sulfur value derived by ASTM D5453 method for ULSD validation.

SAMPLE INFORMATION		method	limit/base	current	history1	history2
Sample Number	Client Info			DC0034690	DC0025193	DC0014839
Sample Date	Client Info			23 Feb 2024	21 Mar 2023	12 Jan 2022
Machine Age	mths	Client Info		359	350	0
Sample Status				NORMAL	NORMAL	NORMAL

PHYSICAL PROPERTIES		method	limit/base	current	history1	history2
ASTM Color	scalar	*ASTM D1500		L4.0	L4.0	---
Visc @ 40°C	cSt	ASTM D445	3.0	2.44	2.46	2.46

SULFUR CONTENT		method	limit/base	current	history1	history2
Sulfur	ppm	ASTM D5185m	250	196	168	204
Sulfur (UVF)	ppm	ASTM D5453		191	195	---

IGNITION QUALITY		method	limit/base	current	history1	history2
API Gravity		ASTM D7777	37.7	36.4	---	---



CONTAMINANTS		method	limit/base	current	history1	history2
Silicon	ppm	ASTM D5185m	<1.0	0	<1	0
Sodium	ppm	ASTM D5185m	<0.1	<1	0	0
Potassium	ppm	ASTM D5185m	<0.1	0	<1	0
Water	%	ASTM D6304	<0.05	0.001	0.004	0.003
ppm Water	ppm	ASTM D6304	<500	11	46.8	28.2
% Gasoline	%	*In-House	<0.50	0.0	0.0	---
% Biodiesel	%	*In-House	<20.0	0.0	0.0	---

FLUID CLEANLINESS		method	limit/base	current	history1	history2
Particles >4µm		ASTM D7647	>2500	---	3135	---
Particles >6µm		ASTM D7647	>640	---	1276	---
Particles >14µm		ASTM D7647	>80	---	185	---
Particles >21µm		ASTM D7647	>20	---	48	---
Particles >38µm		ASTM D7647	>4	---	5	---
Particles >71µm		ASTM D7647	>3	---	1	---
Oil Cleanliness		ISO 4406 (c)	>18/16/13	---	19/17/15	---

HEAVY METALS		method	limit/base	current	history1	history2
Aluminum	ppm	ASTM D5185m	<0.1	0	0	0
Nickel	ppm	ASTM D5185m	<0.1	0	0	0
Lead	ppm	ASTM D5185m	<0.1	0	0	0
Vanadium	ppm	ASTM D5185m	<0.1	0	0	0
Iron	ppm	ASTM D5185m	<0.1	0	0	0
Calcium	ppm	ASTM D5185m	<0.1	0	0	0
Magnesium	ppm	ASTM D5185m	<0.1	0	<1	<1
Phosphorus	ppm	ASTM D5185m	<0.1	0	9	1
Zinc	ppm	ASTM D5185m	<0.1	0	0	0




FUEL REPORT

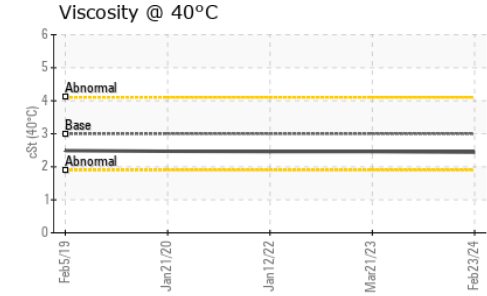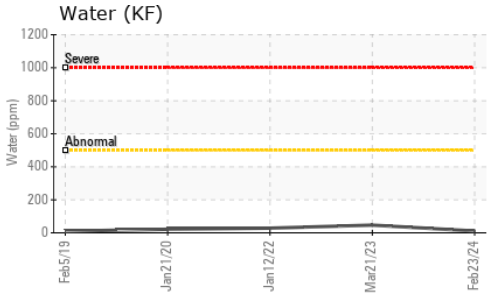

SAMPLE IMAGES	method	limit/base	current	history1	history2
Color					
Bottom					

GRAPHS

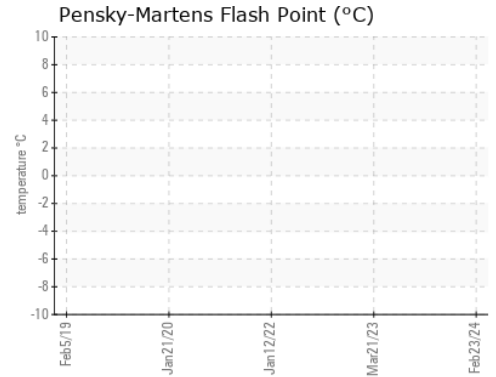

Certificate L2367

Laboratory : WearCheck USA - 501 Madison Ave., Cary, NC 27513

Sample No. : DC0034690

Lab Number : 06122860

Unique Number : 10937011

Test Package : DF-5 (Additional Tests: API, Cetane, Fuel, Screen)

Received : 19 Mar 2024

Tested : 07 Apr 2024

Diagnosed : 07 Apr 2024 - Doug Bogart

KELLY GENERATOR & EQUIPMENT INC

1955 DALE LN

OWINGS, MD

US 20736

Contact: LESLIE SNURR

LSNURR@KGE.COM

T: (410)257-5225

F: (410)257-5227

To discuss this sample report, contact Customer Service at 1-800-237-1369.

* - Denotes test methods that are outside of the ISO 17025 scope of accreditation.

Statements of conformity to specifications are based on the simple acceptance decision rule (JCGM 106:2012)