




# OIL ANALYSIS REPORT

Sample Rating Trend

**NORMAL**

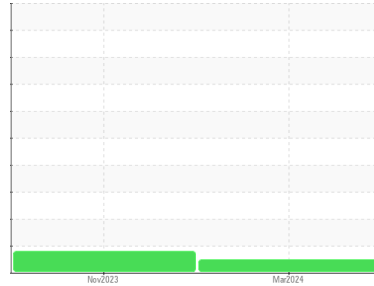

Area  
**EL SAUZ [200007686]**  
 Machine Id  
**N09WEA90084 (S/N W-123153)**  
 Component  
**Wind Turbine Gearbox**  
 Fluid  
**FUCHS RENOLIN UNISYN CLP 320 (--- LTR)**

## DIAGNOSIS

### Recommendation

Resample at the next service interval to monitor.

### Wear

All component wear rates are normal.

### Contamination

There is no indication of any contamination in the oil. The amount and size of particulates present in the system are acceptable.

### Fluid Condition

The AN level is acceptable for this fluid. The condition of the oil is acceptable for the time in service.

## SAMPLE INFORMATION

	method	limit/base	current	history1	history2
Sample Number	Client Info		<b>NX015073</b>	NX014593	---
Sample Date	Client Info		<b>12 Mar 2024</b>	08 Nov 2023	---
Machine Age	hrs	Client Info	<b>0</b>	0	---
Oil Age	hrs	Client Info	<b>0</b>	0	---
Oil Changed	Client Info		<b>N/A</b>	N/A	---
Sample Status			<b>NORMAL</b>	ATTENTION	---

## WEAR METALS

	method	limit/base	current	history1	history2
PQ	ASTM D8184	>40	<b>15</b>	16	---
Iron	ppm	ASTM D5185m	>55	<b>5</b>	32
Chromium	ppm	ASTM D5185m	>2	<b>0</b>	<1
Nickel	ppm	ASTM D5185m	>2	<b>0</b>	0
Titanium	ppm	ASTM D5185m	>10	<b>0</b>	0
Silver	ppm	ASTM D5185m		<b>0</b>	0
Aluminum	ppm	ASTM D5185m	>15	<b>0</b>	1
Lead	ppm	ASTM D5185m	>3	<b>1</b>	0
Copper	ppm	ASTM D5185m	>7	<b>0</b>	<1
Tin	ppm	ASTM D5185m	>3	<b>0</b>	0
Vanadium	ppm	ASTM D5185m		<b>0</b>	0
Cadmium	ppm	ASTM D5185m		<b>0</b>	0

## ADDITIVES

	method	limit/base	current	history1	history2
Boron	ppm	ASTM D5185m		<b>2</b>	2
Barium	ppm	ASTM D5185m		<b>0</b>	3
Molybdenum	ppm	ASTM D5185m		<b>0</b>	0
Manganese	ppm	ASTM D5185m		<b>&lt;1</b>	0
Magnesium	ppm	ASTM D5185m		<b>0</b>	<1
Calcium	ppm	ASTM D5185m		<b>13</b>	21
Phosphorus	ppm	ASTM D5185m		<b>209</b>	232
Zinc	ppm	ASTM D5185m		<b>0</b>	0
Sulfur	ppm	ASTM D5185m		<b>6034</b>	5235

## CONTAMINANTS

	method	limit/base	current	history1	history2
Silicon	ppm	ASTM D5185m	>35	<b>3</b>	6
Sodium	ppm	ASTM D5185m		<b>0</b>	<1
Potassium	ppm	ASTM D5185m	>20	<b>0</b>	<1
Water	%	ASTM D6304	>0.02	<b>0.006</b>	0.006
ppm Water	ppm	ASTM D6304	>200	<b>63</b>	68

## FLUID CLEANLINESS






	method	limit/base	current	history1	history2
Particles >4µm	ASTM D7647		<b>764</b>	3779	---
Particles >6µm	ASTM D7647	>320	<b>217</b>	419	---
Particles >14µm	ASTM D7647	>40	<b>10</b>	35	---
Particles >21µm	ASTM D7647	>10	<b>2</b>	9	---
Particles >38µm	ASTM D7647	>3	<b>1</b>	1	---
Particles >71µm	ASTM D7647	>3	<b>0</b>	1	---
Oil Cleanliness	ISO 4406 (c)	>--/15/12	<b>17/15/10</b>	19/16/12	---

## FLUID DEGRADATION

	method	limit/base	current	history1	history2
Acid Number (AN)	mg KOH/g	ASTM D8045	0.6	<b>0.36</b>	0.36




# OIL ANALYSIS REPORT

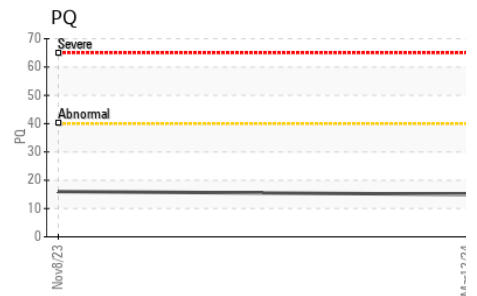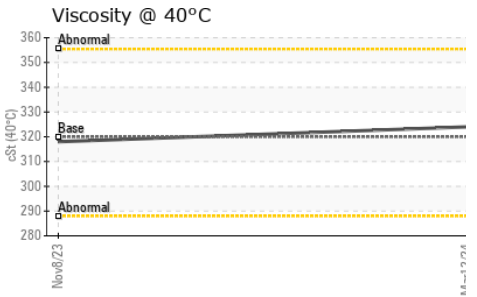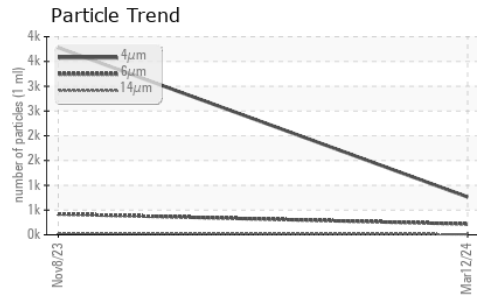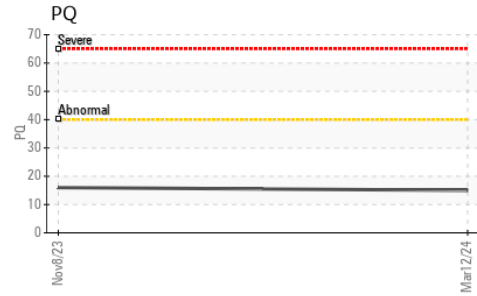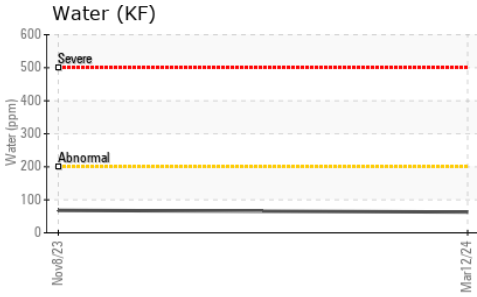






VISUAL	method	limit/base	current	history1	history2
White Metal	scalar	*Visual	NONE	NONE	---
Yellow Metal	scalar	*Visual	NONE	NONE	---
Precipitate	scalar	*Visual	NONE	NONE	---
Silt	scalar	*Visual	NONE	NONE	---
Debris	scalar	*Visual	NONE	NONE	---
Sand/Dirt	scalar	*Visual	NONE	NONE	---
Appearance	scalar	*Visual	NORML	NORML	---
Odor	scalar	*Visual	NORML	NORML	---
Emulsified Water	scalar	*Visual	>0.02	NEG	---
Free Water	scalar	*Visual		NEG	---

FLUID PROPERTIES	method	limit/base	current	history1	history2
Visc @ 40°C	cSt	ASTM D445	320	324	318

SAMPLE IMAGES	method	limit/base	current	history1	history2
---------------	--------	------------	---------	----------	----------

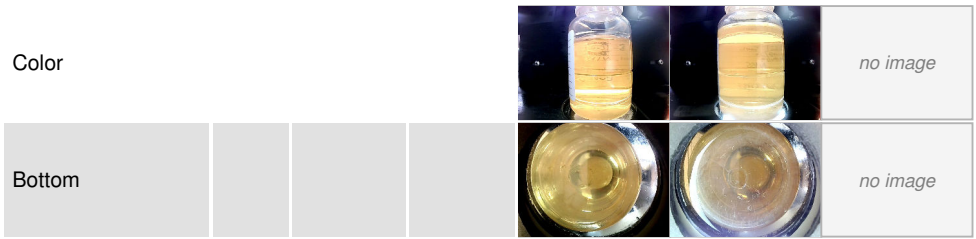

## GRAPHS

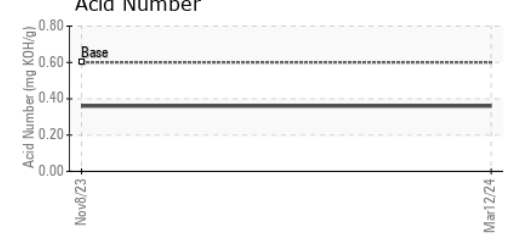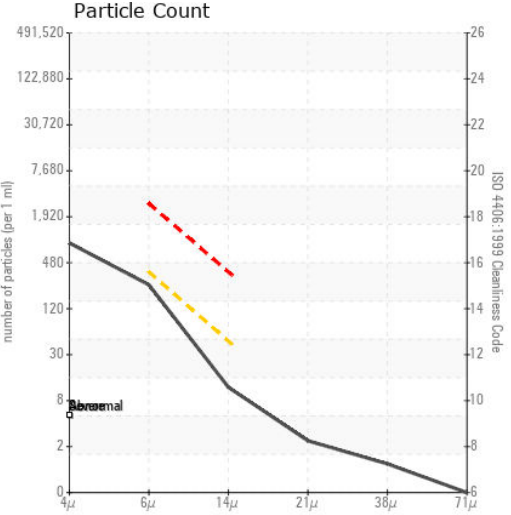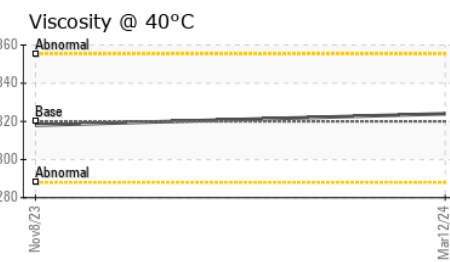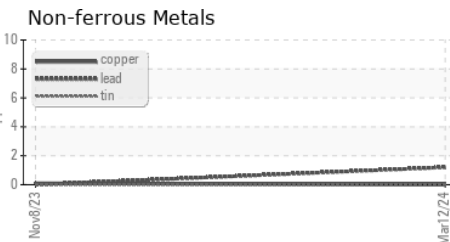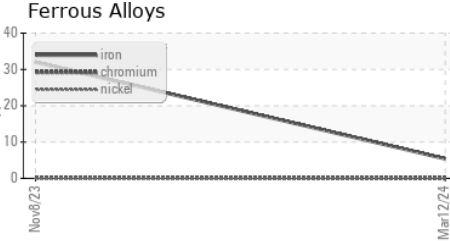

Certificate L2367

Laboratory : WearCheck USA - 501 Madison Ave., Cary, NC 27513  
 Sample No. : NX015073  
 Lab Number : 06123078  
 Unique Number : 10937229  
 Test Package : IND 2 ( Additional Tests: KF, PQ, PrtCount )

**NORDEX USA - Chicago**  
 300 SOUTH WACKER DRIVE, SUITE 1500  
 CHICAGO, IL  
 US 60606  
 Contact: DEVIN LINEHAN  
 DLinehan@nordex-online.com  
 T: (312)386-4124  
 F: (312)386-7102

To discuss this sample report, contact Customer Service at 1-800-237-1369.

\* - Denotes test methods that are outside of the ISO 17025 scope of accreditation.

Statements of conformity to specifications are based on the simple acceptance decision rule (JCGM 106:2012)