




OIL ANALYSIS REPORT

Sample Rating Trend

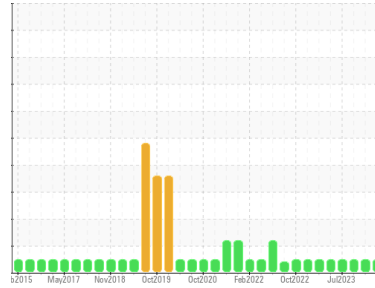

NORMAL



Machine Id
GARDNER DENVER RS GARDNER DENVER AC 3 (S/N S337610)

Component
Air Compressor

Fluid
USPI MAX FG AIR 46 (--- GAL)

DIAGNOSIS

Recommendation

Resample at the next service interval to monitor.

Wear

All component wear rates are normal.

Contamination

There is no indication of any contamination in the oil. The amount and size of particulates present in the system are acceptable.

Fluid Condition

The AN level is acceptable for this fluid. The condition of the oil is suitable for further service.

SAMPLE INFORMATION

| method | limit/base | current | history1 | history2 | |
|---------------|-------------|--------------------|--------------|-------------|-------|
| Sample Number | Client Info | USPM36869 | USPM31684 | USP0001739 | |
| Sample Date | Client Info | 14 Mar 2024 | 21 Dec 2023 | 28 Sep 2023 | |
| Machine Age | hrs | Client Info | 39456 | 0 | 31345 |
| Oil Age | hrs | Client Info | 6221 | 0 | 0 |
| Oil Changed | Client Info | N/A | N/A | N/A | |
| Sample Status | | NORMAL | NORMAL | NORMAL | |

WEAR METALS

| method | limit/base | current | history1 | history2 | | |
|----------|------------|-------------|----------|--------------|----|----|
| Iron | ppm | ASTM D5185m | >50 | 5 | 0 | 2 |
| Chromium | ppm | ASTM D5185m | >4 | <1 | 0 | 0 |
| Nickel | ppm | ASTM D5185m | >4 | 0 | 0 | 0 |
| Titanium | ppm | ASTM D5185m | | 0 | 0 | 0 |
| Silver | ppm | ASTM D5185m | | 0 | 0 | 0 |
| Aluminum | ppm | ASTM D5185m | >10 | <1 | 0 | 1 |
| Lead | ppm | ASTM D5185m | >20 | 0 | 0 | 0 |
| Copper | ppm | ASTM D5185m | >40 | 1 | <1 | <1 |
| Tin | ppm | ASTM D5185m | >5 | 0 | 0 | 0 |
| Vanadium | ppm | ASTM D5185m | | 0 | 0 | 0 |
| Cadmium | ppm | ASTM D5185m | | 0 | 0 | 0 |

ADDITIVES

| method | limit/base | current | history1 | history2 | | |
|------------|------------|-------------|----------|--------------|-----|-----|
| Boron | ppm | ASTM D5185m | 0 | 0 | 0 | 0 |
| Barium | ppm | ASTM D5185m | 0 | 0 | 0 | 0 |
| Molybdenum | ppm | ASTM D5185m | 0 | 3 | 0 | 0 |
| Manganese | ppm | ASTM D5185m | | <1 | 0 | 0 |
| Magnesium | ppm | ASTM D5185m | 0 | 2 | 0 | <1 |
| Calcium | ppm | ASTM D5185m | 0 | <1 | 0 | 0 |
| Phosphorus | ppm | ASTM D5185m | 0 | 152 | 161 | 243 |
| Zinc | ppm | ASTM D5185m | 0 | 387 | 389 | 395 |
| Sulfur | ppm | ASTM D5185m | 0 | 207 | 210 | 341 |

CONTAMINANTS

| method | limit/base | current | history1 | history2 | | |
|-----------|------------|-------------|----------|--------------|-------|-------|
| Silicon | ppm | ASTM D5185m | >25 | 0 | 0 | 0 |
| Sodium | ppm | ASTM D5185m | | 20 | 10 | 8 |
| Potassium | ppm | ASTM D5185m | >20 | 0 | 0 | 2 |
| Water | % | ASTM D6304 | >0.6 | 0.010 | 0.013 | 0.008 |
| ppm Water | ppm | ASTM D6304 | >6000 | 108 | 130 | 84.1 |

FLUID CLEANLINESS






| method | limit/base | current | history1 | history2 | |
|-----------------|--------------|-----------|----------------|----------|----------|
| Particles >4µm | ASTM D7647 | >10000 | 219 | 194 | 584 |
| Particles >6µm | ASTM D7647 | >2500 | 53 | 36 | 179 |
| Particles >14µm | ASTM D7647 | >320 | 4 | 5 | 17 |
| Particles >21µm | ASTM D7647 | >80 | 1 | 2 | 6 |
| Particles >38µm | ASTM D7647 | >20 | 0 | 0 | 1 |
| Particles >71µm | ASTM D7647 | >4 | 0 | 0 | 0 |
| Oil Cleanliness | ISO 4406 (c) | >20/18/15 | 15/13/9 | 15/12/10 | 16/15/11 |

FLUID DEGRADATION

| method | limit/base | current | history1 | history2 | | |
|------------------|------------|------------|----------|-------------|------|------|
| Acid Number (AN) | mg KOH/g | ASTM D8045 | 0.16 | 1.35 | 1.04 | 1.03 |




OIL ANALYSIS REPORT

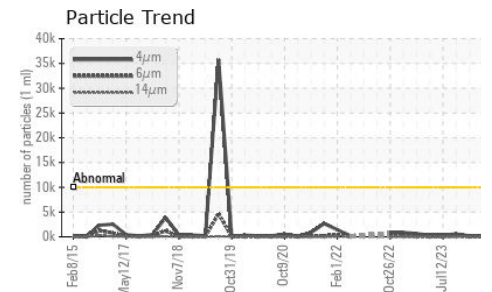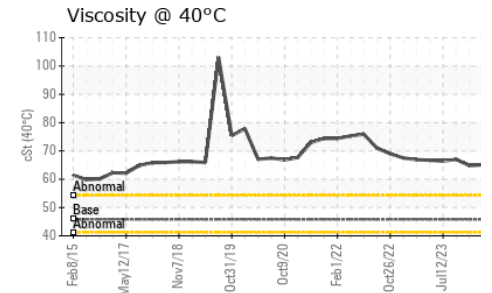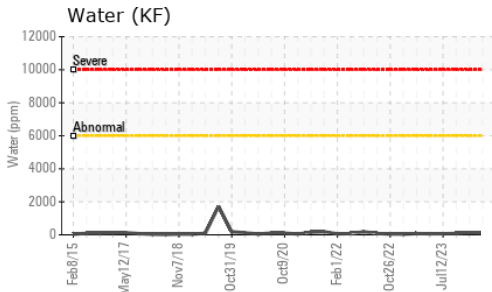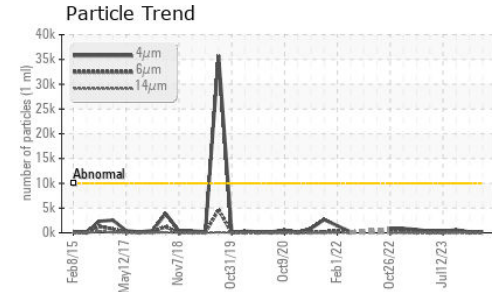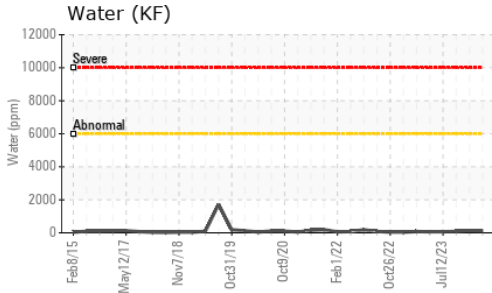





| VISUAL | method | limit/base | current | history1 | history2 |
|------------------|--------|------------|---------|----------|----------|
| White Metal | scalar | *Visual | NONE | NONE | NONE |
| Yellow Metal | scalar | *Visual | NONE | NONE | NONE |
| Precipitate | scalar | *Visual | NONE | NONE | NONE |
| Silt | scalar | *Visual | NONE | NONE | NONE |
| Debris | scalar | *Visual | NONE | NONE | NONE |
| Sand/Dirt | scalar | *Visual | NONE | NONE | NONE |
| Appearance | scalar | *Visual | NORML | NORML | NORML |
| Odor | scalar | *Visual | NORML | NORML | NORML |
| Emulsified Water | scalar | *Visual | >0.6 | NEG | NEG |
| Free Water | scalar | *Visual | | NEG | NEG |

| FLUID PROPERTIES | method | limit/base | current | history1 | history2 |
|------------------|--------|------------|---------|----------|----------|
| Visc @ 40°C | cSt | ASTM D445 | 45.8 | 65.1 | 64.8 |

| SAMPLE IMAGES | method | limit/base | current | history1 | history2 |
|---------------|--------|------------|---------|----------|----------|
|---------------|--------|------------|---------|----------|----------|

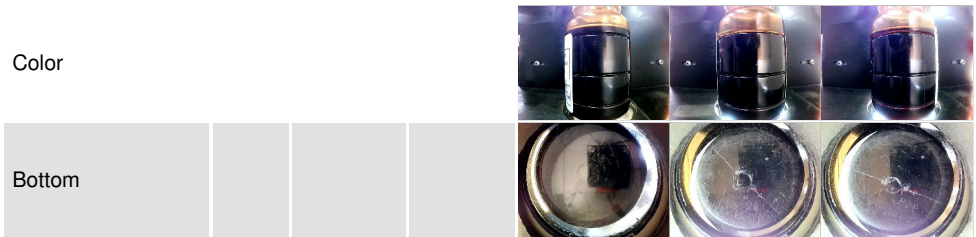

GRAPHS

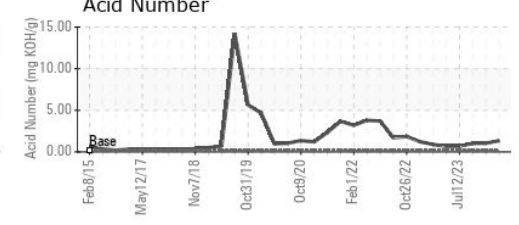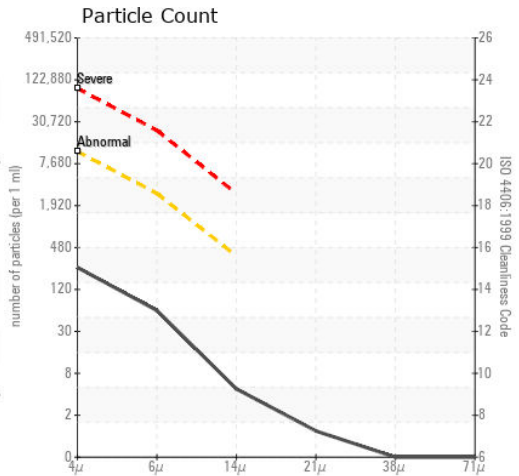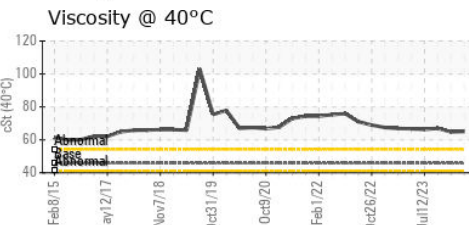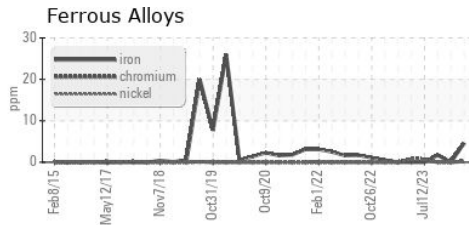

Certificate L2367

Laboratory : WearCheck USA - 501 Madison Ave., Cary, NC 27513
 Sample No. : USPM36869
 Lab Number : 06123149
 Unique Number : 10937300
 Test Package : IND 2
 Received : 19 Mar 2024
 Tested : 20 Mar 2024
 Diagnosed : 21 Mar 2024 - Doug Bogart

TYSON - SEDALIA - USP
 19578 WHITFIELD RD
 SEDALIA, MO
 US 65301
 Contact: BONNIE
 bonnie.weathers@tyson.com

To discuss this sample report, contact Customer Service at 1-800-237-1369.

* - Denotes test methods that are outside of the ISO 17025 scope of accreditation.

Statements of conformity to specifications are based on the simple acceptance decision rule (JCGM 106:2012)

T:
F: