

OIL ANALYSIS REPORT

Sample Rating Trend



Machine Id

GARDNER DENVER FF GD AIR COMP 1 (S/N S370833)

Component

Air Compressor

GARDNER DENVER AEON 9000 SP (--- GAL)

DIAGNOSIS

Recommendation

Resample at the next service interval to monitor.

Wear

All component wear rates are normal.

Contamination

There is no indication of any contamination in the oil. The amount and size of particulates present in the system are acceptable.


Fluid Condition

The oil viscosity is lower than normal. This plus the additive levels indicates the addition of a different brand or type of oil. Confirmed. The AN level is acceptable for this fluid.

L)		n2015 Dec2	017 Feb2019 Jan2020	Dec2020 Mar2022 May202	3 Jan2024	
SAMPLE INFORM	MATION	method	limit/base	current	history1	history2
Sample Number		Client Info		USPM30500	USP248011	USP246768
Sample Date		Client Info		14 Mar 2024	08 Jan 2024	03 Dec 2023
Machine Age	hrs	Client Info		0	89931	0
Oil Age	hrs	Client Info		0	1731	0
Oil Changed		Client Info		N/A	N/A	N/A
Sample Status				ATTENTION	ATTENTION	ATTENTION
WEAR METALS		method	limit/base	current	history1	history2
ron	ppm	ASTM D5185m	>50	3	0	0
Chromium	ppm	ASTM D5185m	>4	<1	0	0
Nickel	ppm	ASTM D5185m	>4	0	0	0
Γitanium	ppm	ASTM D5185m		0	0	0
Silver	ppm	ASTM D5185m		0	0	0
Aluminum	ppm	ASTM D5185m	>10	<1	0	0
_ead	ppm	ASTM D5185m	>20	0	0	0
Copper	ppm	ASTM D5185m	>40	0	<1	<1
Γin	ppm	ASTM D5185m	>5	0	0	0
/anadium	ppm	ASTM D5185m		0	0	0
Cadmium	ppm	ASTM D5185m		0	0	0
ADDITIVES		method	limit/base	current	history1	history2
Boron	ppm	ASTM D5185m	0	0	0	0
Barium	ppm	ASTM D5185m	0	0	0	0
Nolybdenum	ppm	ASTM D5185m	0	3	0	0
Manganese	ppm	ASTM D5185m		<1	<1	<1
/lagnesium	ppm	ASTM D5185m	0	2	<1	0
Calcium	ppm	ASTM D5185m	0	<1	<1	0
Phosphorus	ppm	ASTM D5185m	800	5 4	52	62
Zinc	ppm	ASTM D5185m	0	0	2	0
Sulfur	ppm	ASTM D5185m	0	43	61	7 0
CONTAMINANTS		method	limit/base	current	history1	history2
Silicon	ppm	ASTM D5185m	>25	0	0	0
Sodium	ppm	ASTM D5185m		<1	0	2
Potassium	ppm	ASTM D5185m	>20	0	0	0
Vater	%	ASTM D6304	>0.6	0.004	0.004	0.003
ppm Water	ppm	ASTM D6304	>6000	44	48	33
FLUID CLEANLIN	ESS	method	limit/base	current	history1	history2
Particles >4µm		ASTM D7647	>10000	878	311	186
Particles >6µm		ASTM D7647	>2500	294	61	37
Particles >14μm		ASTM D7647	>320	11	9	3
Particles >21µm		ASTM D7647	>80	2	3	1
Particles >38µm		ASTM D7647	>20	0	0	0
Particles >71µm		ASTM D7647	>4	0	0	0
Oil Cleanliness		ISO 4406 (c)	>20/18/15	17/15/11	15/13/10	15/12/9
FLUID DEGRADA	TION	method	limit/base	current	history1	history2
Acid Number (AN)	mg KOH/g	ASTM D8045	.170	0.20	0.18	0.18



OIL ANALYSIS REPORT

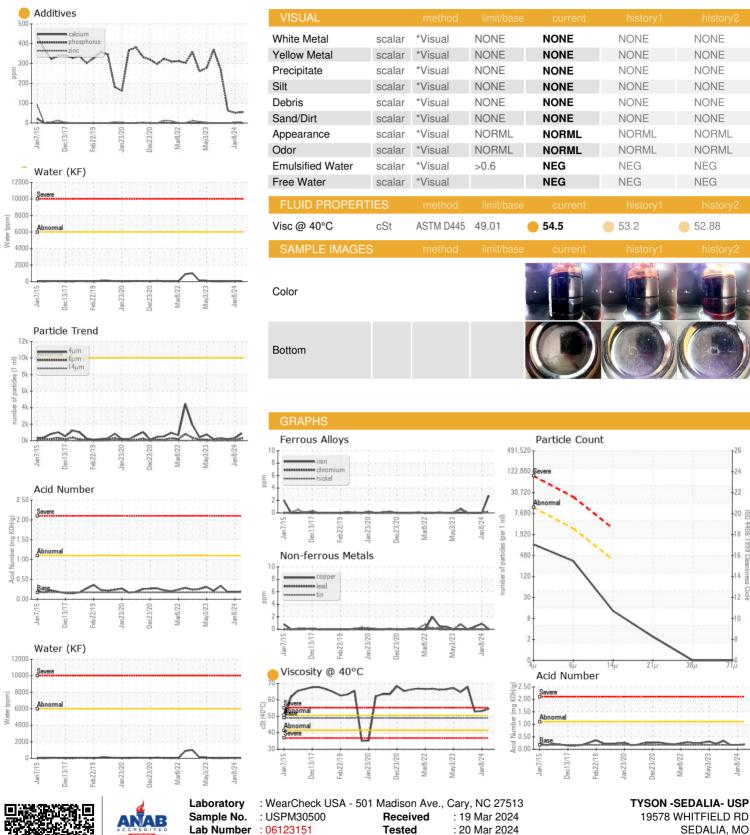



Certificate L2367

Lab Number

Test Package : IND 2

: 06123151 **Unique Number** : 10937302 **Tested** : 20 Mar 2024 Diagnosed

: 21 Mar 2024 - Doug Bogart

Contact: BONNIE bonnie.weathers@tyson.com T:

To discuss this sample report, contact Customer Service at 1-800-237-1369.

* - Denotes test methods that are outside of the ISO 17025 scope of accreditation.

Statements of conformity to specifications are based on the simple acceptance decision rule (JCGM 106:2012)

F:

US 65301