




OIL ANALYSIS REPORT

Sample Rating Trend

NORMAL

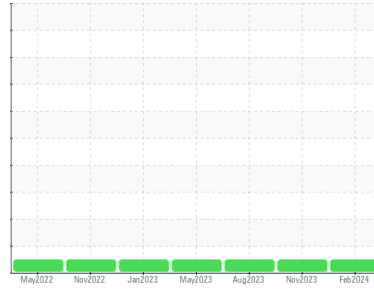

Machine Id GAS COMPRESSOR 1 (S/N 19L88)

Component
Air Compressor
Fluid
MOBIL PEGASUS 805 (--- GAL)

DIAGNOSIS

Recommendation

Resample at the next service interval to monitor.

Wear

All component wear rates are normal.

Contamination

There is no indication of any contamination in the oil. The amount and size of particulates present in the system are acceptable.

Fluid Condition

The AN level is acceptable for this fluid. The condition of the oil is suitable for further service.

SAMPLE INFORMATION

method	limit/base	current	history1	history2
Sample Number	Client Info	USP0006130	USP245452	USP245453
Sample Date	Client Info	29 Feb 2024	02 Nov 2023	07 Aug 2023
Machine Age	hrs	Client Info	0	0
Oil Age	hrs	Client Info	0	0
Oil Changed	Client Info	N/A	N/A	N/A
Sample Status		NORMAL	NORMAL	NORMAL

WEAR METALS

method	limit/base	current	history1	history2	
Iron	ppm	ASTM D5185m >50	4	0	0
Chromium	ppm	ASTM D5185m >4	<1	0	0
Nickel	ppm	ASTM D5185m >4	0	<1	<1
Titanium	ppm	ASTM D5185m	0	0	0
Silver	ppm	ASTM D5185m	0	0	<1
Aluminum	ppm	ASTM D5185m >10	2	2	2
Lead	ppm	ASTM D5185m >20	0	3	2
Copper	ppm	ASTM D5185m >40	<1	<1	<1
Tin	ppm	ASTM D5185m >5	<1	<1	<1
Vanadium	ppm	ASTM D5185m	0	0	0
Cadmium	ppm	ASTM D5185m	0	0	0

ADDITIVES

method	limit/base	current	history1	history2	
Boron	ppm	ASTM D5185m 80	0	0	0
Barium	ppm	ASTM D5185m	0	0	0
Molybdenum	ppm	ASTM D5185m	0	<1	2
Manganese	ppm	ASTM D5185m	<1	<1	0
Magnesium	ppm	ASTM D5185m	10	9	4
Calcium	ppm	ASTM D5185m 1020	1340	1316	1453
Phosphorus	ppm	ASTM D5185m 220	336	312	318
Zinc	ppm	ASTM D5185m 230	339	353	364
Sulfur	ppm	ASTM D5185m 1000	2656	2328	2496

CONTAMINANTS

method	limit/base	current	history1	history2	
Silicon	ppm	ASTM D5185m >25	1	2	1
Sodium	ppm	ASTM D5185m	1	0	0
Potassium	ppm	ASTM D5185m >20	0	<1	<1
Water	%	ASTM D6304 >0.6	0.013	0.011	0.032
ppm Water	ppm	ASTM D6304 >6000	135	119.7	322.7

FLUID CLEANLINESS






method	limit/base	current	history1	history2
Particles >4µm	ASTM D7647 >10000	3617	3550	1263
Particles >6µm	ASTM D7647 >2500	312	497	162
Particles >14µm	ASTM D7647 >320	15	42	11
Particles >21µm	ASTM D7647 >80	4	13	3
Particles >38µm	ASTM D7647 >20	0	0	1
Particles >71µm	ASTM D7647 >4	0	0	0
Oil Cleanliness	ISO 4406 (c) >20/18/15	19/15/11	19/16/13	17/15/11

FLUID DEGRADATION

method	limit/base	current	history1	history2	
Acid Number (AN)	mg KOH/g	ASTM D8045 1.0	0.853	0.317	0.46




OIL ANALYSIS REPORT

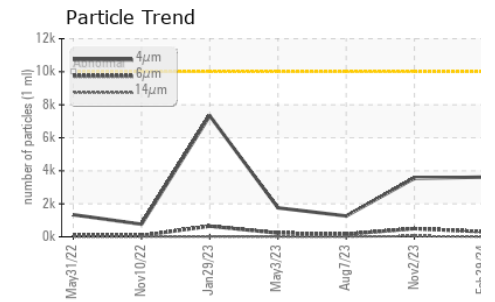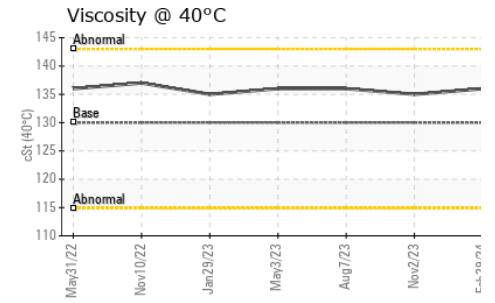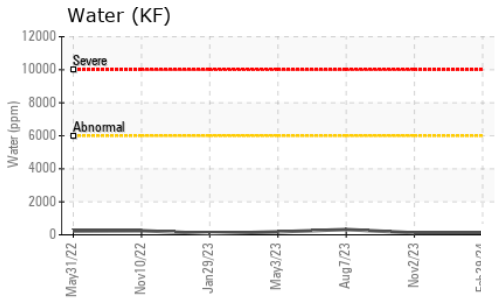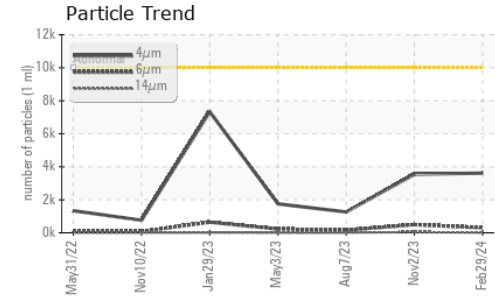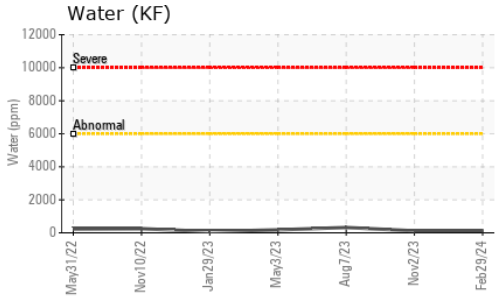





VISUAL	method	limit/base	current	history1	history2
White Metal	scalar	*Visual	NONE	NONE	NONE
Yellow Metal	scalar	*Visual	NONE	NONE	NONE
Precipitate	scalar	*Visual	NONE	NONE	NONE
Silt	scalar	*Visual	NONE	NONE	NONE
Debris	scalar	*Visual	NONE	LIGHT	NONE
Sand/Dirt	scalar	*Visual	NONE	NONE	NONE
Appearance	scalar	*Visual	NORML	NORML	NORML
Odor	scalar	*Visual	NORML	NORML	NORML
Emulsified Water	scalar	*Visual	>0.6	NEG	NEG
Free Water	scalar	*Visual		NEG	NEG

FLUID PROPERTIES	method	limit/base	current	history1	history2
Visc @ 40°C	cSt	ASTM D445	130.0	136	135

SAMPLE IMAGES	method	limit/base	current	history1	history2
---------------	--------	------------	---------	----------	----------

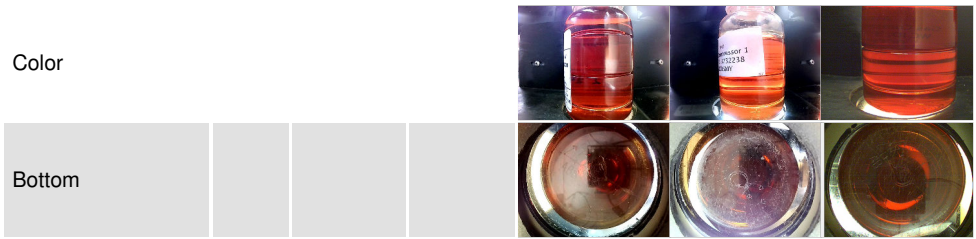

GRAPHS

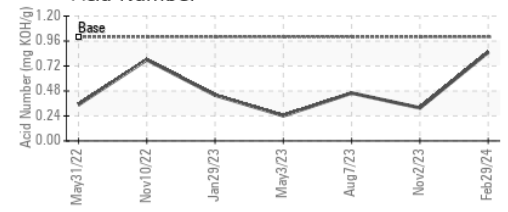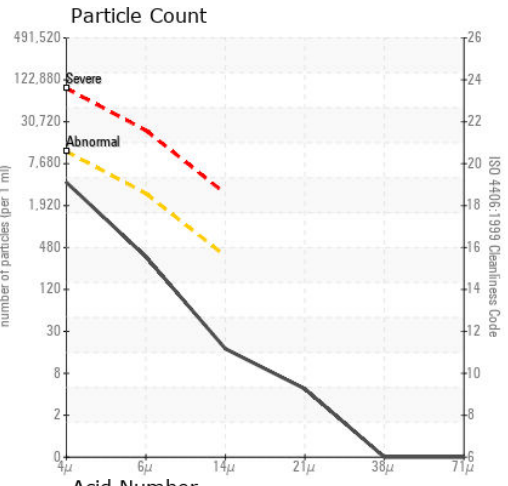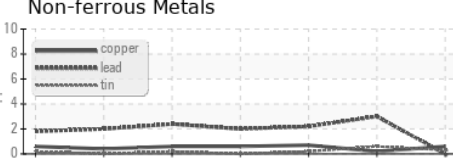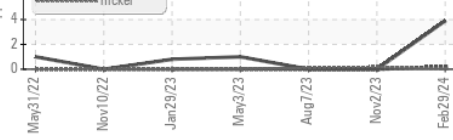

Laboratory : WearCheck USA - 501 Madison Ave., Cary, NC 27513
Sample No. : USP0006130
Lab Number : 06123160
Unique Number : 10937311
Test Package : IND 2
Received : 19 Mar 2024
Tested : 20 Mar 2024
Diagnosed : 21 Mar 2024 - Doug Bogart

NRG ENERGY CENTER - SMYRNA LLC - DCOSMY
 217 ARTISAN DR
 SMYRNA, DE
 US 19977
 Contact: JERRY WIEGAND

To discuss this sample report, contact Customer Service at 1-800-237-1369.
 * - Denotes test methods that are outside of the ISO 17025 scope of accreditation.
 Statements of conformity to specifications are based on the simple acceptance decision rule (JCGM 106:2012)

T: (302)659-0200
 F: (302)659-0600