




# OIL ANALYSIS REPORT

Sample Rating Trend

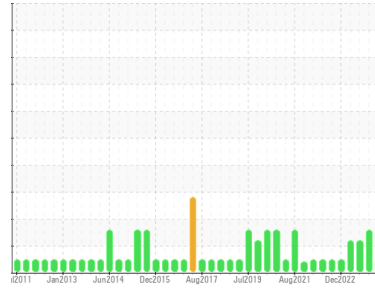

**NORMAL**



Area  
**PROCESS**  
 Machine Id  
**SULLAIR TYSAMAP PR-2 SUL (S/N 254385-001)**  
 Component  
**Refrigeration Compressor**  
 Fluid  
**USPI 1009-68 SC (--- GAL)**

## DIAGNOSIS

### Recommendation

Resample at the next service interval to monitor.

### Wear

All component wear rates are normal.

### Contamination

There is no indication of any contamination in the oil. The amount and size of particulates present in the system are acceptable.

### Fluid Condition

The AN level is acceptable for this fluid. The condition of the oil is suitable for further service.

SAMPLE INFORMATION		method	limit/base	current	history1	history2
Sample Number	Client Info			<b>USP0006109</b>	USP0003561	USP0001037
Sample Date	Client Info			<b>06 Mar 2024</b>	14 Nov 2023	21 Jul 2023
Machine Age	hrs Client Info			<b>25747</b>	23616	20925
Oil Age	hrs Client Info			<b>0</b>	0	0
Oil Changed	Client Info			<b>N/A</b>	N/A	N/A
Sample Status				<b>NORMAL</b>	ABNORMAL	ATTENTION

WEAR METALS		method	limit/base	current	history1	history2
Iron	ppm	ASTM D5185m	>8	<b>4</b>	6	4
Chromium	ppm	ASTM D5185m	>2	<b>&lt;1</b>	0	0
Nickel	ppm	ASTM D5185m		<b>0</b>	0	0
Titanium	ppm	ASTM D5185m		<b>0</b>	0	0
Silver	ppm	ASTM D5185m	>2	<b>0</b>	0	0
Aluminum	ppm	ASTM D5185m	>3	<b>0</b>	0	0
Lead	ppm	ASTM D5185m	>2	<b>0</b>	0	0
Copper	ppm	ASTM D5185m	>8	<b>0</b>	0	0
Tin	ppm	ASTM D5185m	>4	<b>0</b>	0	0
Vanadium	ppm	ASTM D5185m		<b>0</b>	0	0
Cadmium	ppm	ASTM D5185m		<b>0</b>	0	0

ADDITIVES		method	limit/base	current	history1	history2
Boron	ppm	ASTM D5185m		<b>0</b>	0	0
Barium	ppm	ASTM D5185m		<b>0</b>	0	1
Molybdenum	ppm	ASTM D5185m		<b>0</b>	0	0
Manganese	ppm	ASTM D5185m		<b>&lt;1</b>	<1	0
Magnesium	ppm	ASTM D5185m		<b>0</b>	0	<1
Calcium	ppm	ASTM D5185m		<b>&lt;1</b>	1	0
Phosphorus	ppm	ASTM D5185m		<b>0</b>	0	0
Zinc	ppm	ASTM D5185m		<b>0</b>	0	0
Sulfur	ppm	ASTM D5185m	50	<b>0</b>	0	16






CONTAMINANTS		method	limit/base	current	history1	history2
Silicon	ppm	ASTM D5185m	>15	<b>0</b>	0	0
Sodium	ppm	ASTM D5185m		<b>1</b>	0	0
Potassium	ppm	ASTM D5185m	>20	<b>0</b>	0	<1
Water	%	ASTM D6304	>0.01	<b>0.002</b>	0.008	0.002
ppm Water	ppm	ASTM D6304	>100	<b>21</b>	82	24.1

FLUID CLEANLINESS		method	limit/base	current	history1	history2
Particles >4µm		ASTM D7647	>10000	<b>1807</b>	▲ 20246	● 15214
Particles >6µm		ASTM D7647	>2500	<b>478</b>	▲ 7779	● 4369
Particles >14µm		ASTM D7647	>320	<b>19</b>	▲ 480	134
Particles >21µm		ASTM D7647	>80	<b>2</b>	58	15
Particles >38µm		ASTM D7647	>20	<b>0</b>	0	0
Particles >71µm		ASTM D7647	>4	<b>0</b>	0	0
Oil Cleanliness		ISO 4406 (c)	>20/18/15	<b>18/16/11</b>	▲ 22/20/16	● 21/19/14

FLUID DEGRADATION		method	limit/base	current	history1	history2
Acid Number (AN)	mg KOH/g	ASTM D974	0.005	<b>0.014</b>	0.01	0.015




# OIL ANALYSIS REPORT

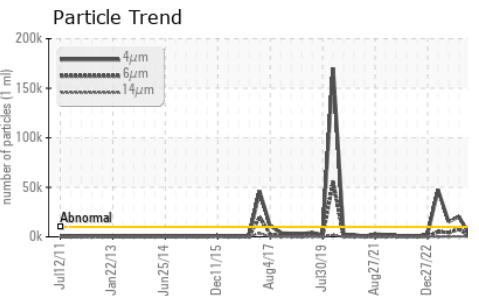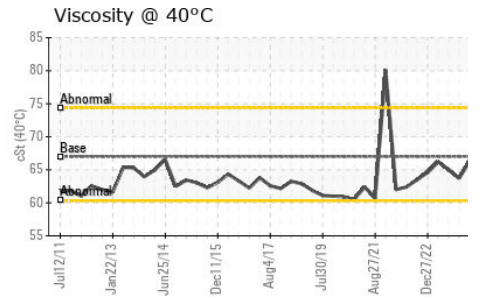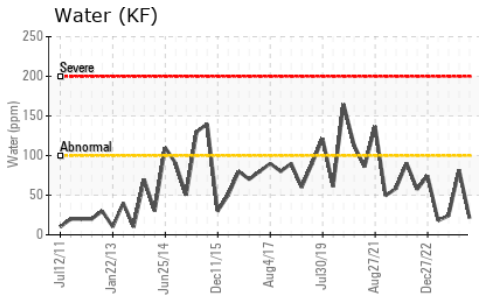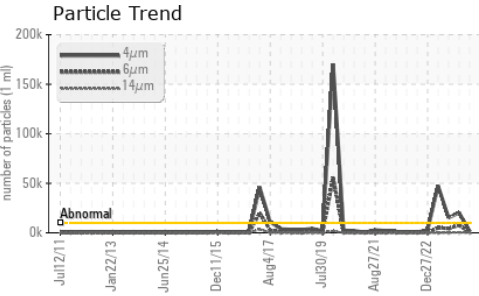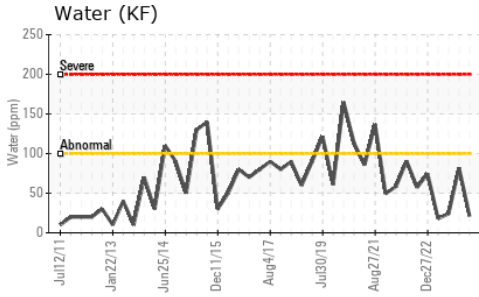






VISUAL	method	limit/base	current	history1	history2
White Metal	scalar	*Visual	NONE	NONE	NONE
Yellow Metal	scalar	*Visual	NONE	NONE	NONE
Precipitate	scalar	*Visual	NONE	NONE	NONE
Silt	scalar	*Visual	NONE	NONE	LIGHT
Debris	scalar	*Visual	NONE	NONE	NONE
Sand/Dirt	scalar	*Visual	NONE	NONE	NONE
Appearance	scalar	*Visual	NORML	NORML	NORML
Odor	scalar	*Visual	NORML	NORML	NORML
Emulsified Water	scalar	*Visual	>0.01	NEG	NEG
Free Water	scalar	*Visual		NEG	NEG

FLUID PROPERTIES	method	limit/base	current	history1	history2
Visc @ 40°C	cSt	ASTM D445	67	66.3	63.7

SAMPLE IMAGES	method	limit/base	current	history1	history2
---------------	--------	------------	---------	----------	----------

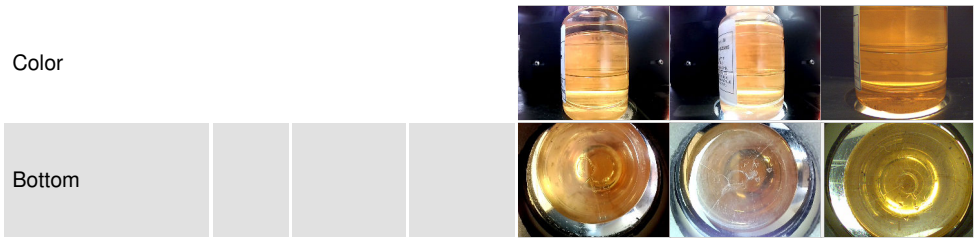

## GRAPHS

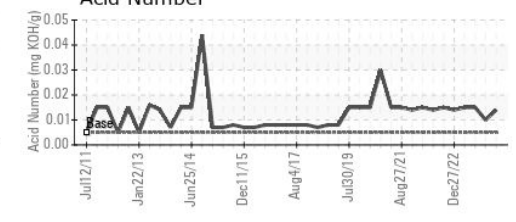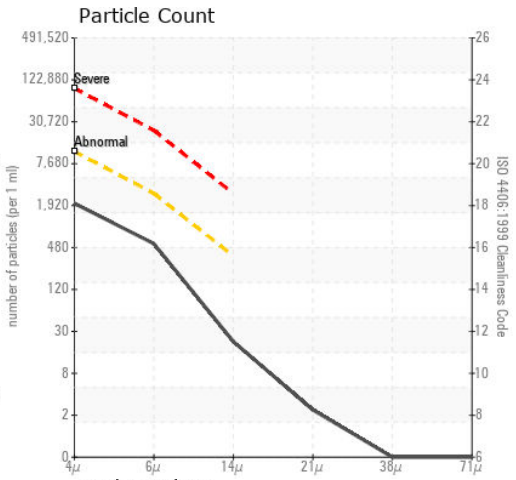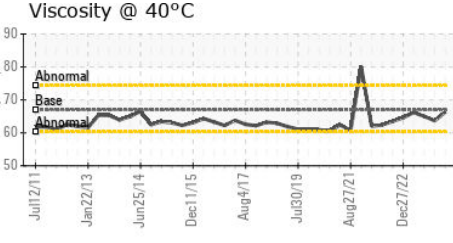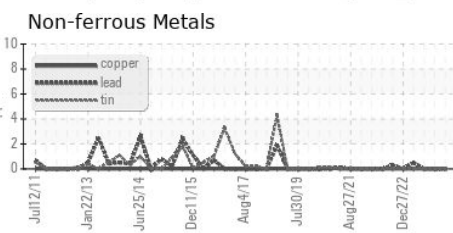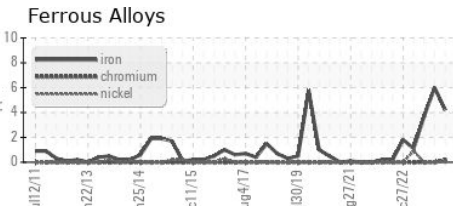

**Laboratory** : WearCheck USA - 501 Madison Ave., Cary, NC 27513  
**Sample No.** : USP0006109  
**Lab Number** : 06123171  
**Unique Number** : 10937322  
**Test Package** : IND 2  
**Received** : 19 Mar 2024  
**Tested** : 20 Mar 2024  
**Diagnosed** : 21 Mar 2024 - Doug Bogart

**TYSON -AMARILLO-USP**  
 AMARILLO, TX  
 US  
 Contact: RANDY INGRAM

To discuss this sample report, contact Customer Service at 1-800-237-1369.  
 \* - Denotes test methods that are outside of the ISO 17025 scope of accreditation.  
 Statements of conformity to specifications are based on the simple acceptance decision rule (JCGM 106:2012)