




OIL ANALYSIS REPORT

Sample Rating Trend

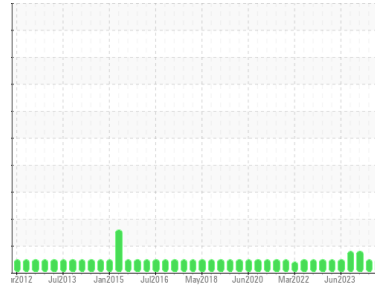

NORMAL



Area
SLAUGHTER
 Machine Id
FES TYSAMAS 7 FES (S/N K523/NB)
 Component
Refrigeration Compressor
 Fluid
USPI 1009-68 SC (--- GAL)

DIAGNOSIS

Recommendation

Resample at the next service interval to monitor.

Wear

All component wear rates are normal.

Contamination

There is no indication of any contamination in the oil. The amount and size of particulates present in the system are acceptable.

Fluid Condition

The AN level is acceptable for this fluid. The condition of the oil is suitable for further service.

SAMPLE INFORMATION

	method	limit/base	current	history1	history2
Sample Number	Client Info		USP0006111	USP0003548	USP0003554
Sample Date	Client Info		05 Mar 2024	15 Nov 2023	14 Nov 2023
Machine Age	hrs	Client Info	14431	11754	11754
Oil Age	hrs	Client Info	0	0	0
Oil Changed	Client Info		N/A	N/A	N/A
Sample Status			NORMAL	NORMAL	ABNORMAL

WEAR METALS

	method	limit/base	current	history1	history2
Iron	ppm	ASTM D5185m >8	8	---	11
Chromium	ppm	ASTM D5185m >2	<1	---	<1
Nickel	ppm	ASTM D5185m	0	---	0
Titanium	ppm	ASTM D5185m	0	---	0
Silver	ppm	ASTM D5185m >2	0	---	0
Aluminum	ppm	ASTM D5185m >3	0	---	1
Lead	ppm	ASTM D5185m >2	0	---	0
Copper	ppm	ASTM D5185m >8	0	---	<1
Tin	ppm	ASTM D5185m >4	0	---	0
Vanadium	ppm	ASTM D5185m	0	---	0
Cadmium	ppm	ASTM D5185m	0	---	0

ADDITIVES

	method	limit/base	current	history1	history2
Boron	ppm	ASTM D5185m	0	---	0
Barium	ppm	ASTM D5185m	0	---	0
Molybdenum	ppm	ASTM D5185m	0	---	0
Manganese	ppm	ASTM D5185m	<1	---	0
Magnesium	ppm	ASTM D5185m	0	---	<1
Calcium	ppm	ASTM D5185m	2	---	2
Phosphorus	ppm	ASTM D5185m	0	---	0
Zinc	ppm	ASTM D5185m	0	---	0
Sulfur	ppm	ASTM D5185m 50	47	---	11

CONTAMINANTS

	method	limit/base	current	history1	history2
Silicon	ppm	ASTM D5185m >15	<1	---	1
Sodium	ppm	ASTM D5185m	1	---	0
Potassium	ppm	ASTM D5185m >20	0	---	<1
Water	%	ASTM D6304 >0.01	0.004	---	0.011
ppm Water	ppm	ASTM D6304 >100	41	---	112






FLUID CLEANLINESS

	method	limit/base	current	history1	history2
Particles >4µm	ASTM D7647		1584	---	91107
Particles >6µm	ASTM D7647	>2500	314	---	▲ 9942
Particles >14µm	ASTM D7647	>320	14	---	285
Particles >21µm	ASTM D7647	>80	4	---	52
Particles >38µm	ASTM D7647	>20	0	---	1
Particles >71µm	ASTM D7647	>4	0	---	0
Oil Cleanliness	ISO 4406 (c)	>--/18/15	18/15/11	---	▲ 24/20/15

FLUID DEGRADATION

	method	limit/base	current	history1	history2
Acid Number (AN)	mg KOH/g	ASTM D974 0.005	0.013	---	0.02


OIL ANALYSIS REPORT

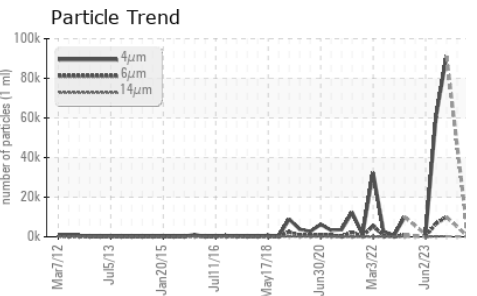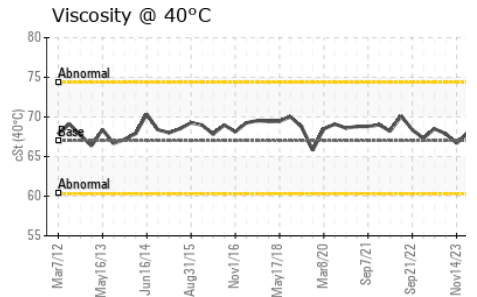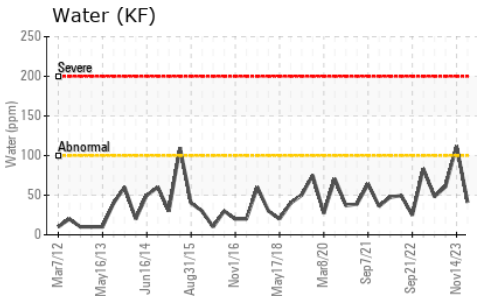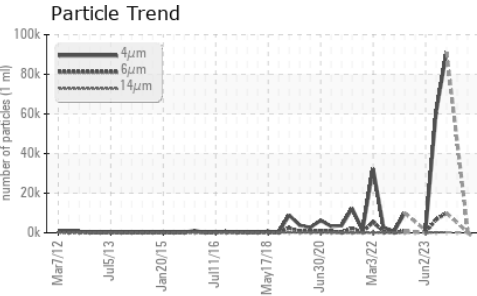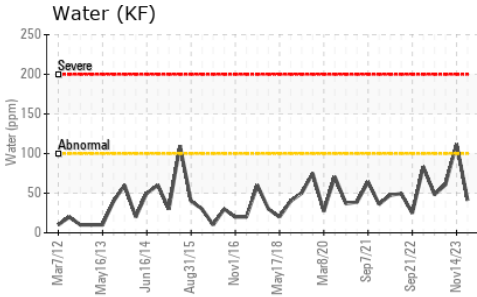






VISUAL	method	limit/base	current	history1	history2	
White Metal	scalar	*Visual	NONE	NONE	---	NONE
Yellow Metal	scalar	*Visual	NONE	NONE	---	NONE
Precipitate	scalar	*Visual	NONE	NONE	---	NONE
Silt	scalar	*Visual	NONE	NONE	---	NONE
Debris	scalar	*Visual	NONE	NONE	---	NONE
Sand/Dirt	scalar	*Visual	NONE	NONE	---	NONE
Appearance	scalar	*Visual	NORML	NORML	---	NORML
Odor	scalar	*Visual	NORML	NORML	---	NORML
Emulsified Water	scalar	*Visual	>0.01	NEG	---	NEG
Free Water	scalar	*Visual		NEG	---	NEG

FLUID PROPERTIES	method	limit/base	current	history1	history2
Visc @ 40°C	cSt	ASTM D445 67	67.9	---	66.7

SAMPLE IMAGES	method	limit/base	current	history1	history2
---------------	--------	------------	---------	----------	----------

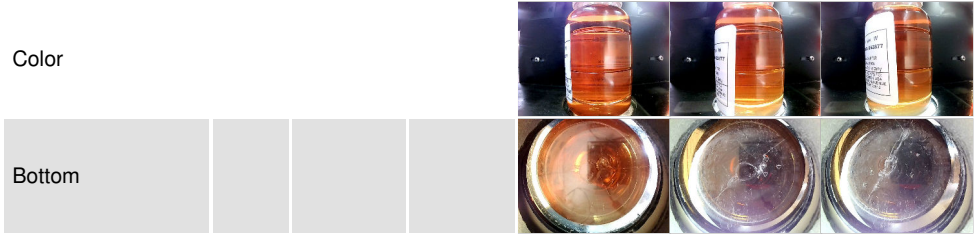

GRAPHS

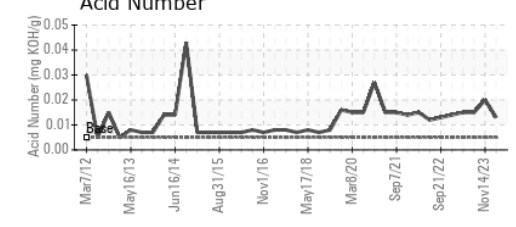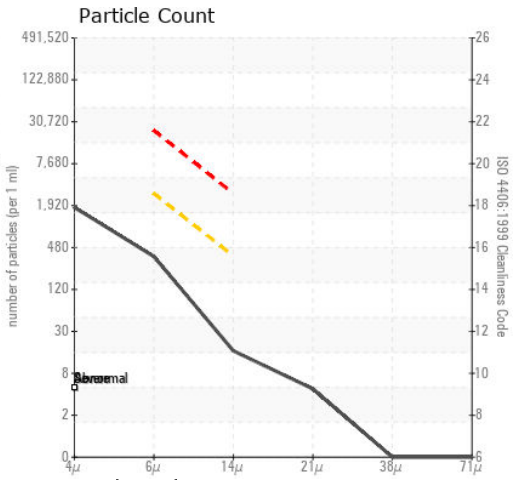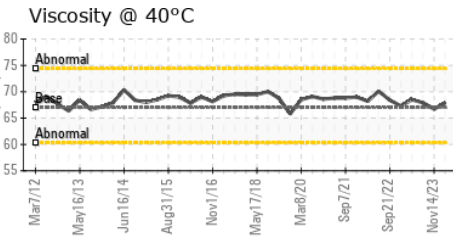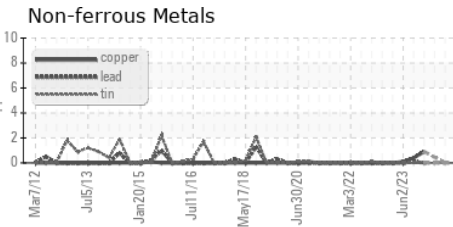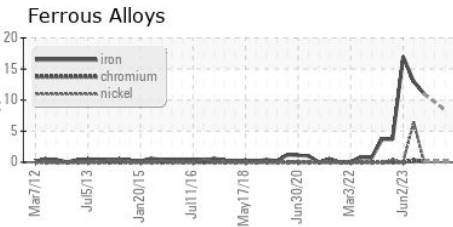

Laboratory : WearCheck USA - 501 Madison Ave., Cary, NC 27513
Sample No. : USP0006111 **Received** : 19 Mar 2024
Lab Number : 06123173 **Tested** : 20 Mar 2024
Unique Number : 10937324 **Diagnosed** : 21 Mar 2024 - Doug Bogart
Test Package : IND 2

TYSON -AMARILLO-USB
 AMARILLO, TX
 US
 Contact: RANDY INGRAM

To discuss this sample report, contact Customer Service at 1-800-237-1369.
 * - Denotes test methods that are outside of the ISO 17025 scope of accreditation.
 Statements of conformity to specifications are based on the simple acceptance decision rule (JCGM 106:2012)

T: (806)355-7732
 F: (806)352-6946