




OIL ANALYSIS REPORT

Sample Rating Trend

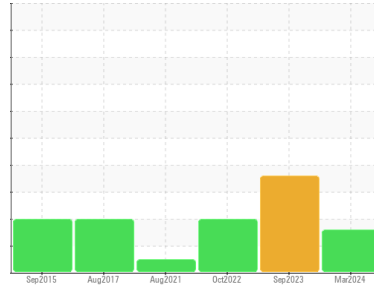

Machine Id
KAESER AS 25T 3478474 (S/N 1492)

Component
Compressor
Fluid
KAESER SIGMA (OEM) S-460 (--- GAL)

DIAGNOSIS

Recommendation

No corrective action is recommended at this time. The filter change at the time of sampling has been noted. Resample at the next service interval to monitor.

Wear

All component wear rates are normal.

Contamination

There is a high amount of particulates present in the oil.

Fluid Condition

The AN level is acceptable for this fluid. The condition of the oil is suitable for further service.

SAMPLE INFORMATION

	method	limit/base	current	history1	history2
Sample Number	Client Info		KCPA015359	KCPA004506	KCP46776D
Sample Date	Client Info		11 Mar 2024	01 Sep 2023	25 Oct 2022
Machine Age	hrs	Client Info	26503	25552	23942
Oil Age	hrs	Client Info	0	0	5000
Oil Changed	Client Info		Not Chngd	N/A	Changed
Sample Status			ABNORMAL	ABNORMAL	ABNORMAL

WEAR METALS

	method	limit/base	current	history1	history2
Iron	ppm	ASTM D5185m >50	3	<1	0
Chromium	ppm	ASTM D5185m >10	<1	0	<1
Nickel	ppm	ASTM D5185m >3	0	0	<1
Titanium	ppm	ASTM D5185m >3	0	0	<1
Silver	ppm	ASTM D5185m >2	0	0	<1
Aluminum	ppm	ASTM D5185m >10	<1	0	0
Lead	ppm	ASTM D5185m >10	0	0	0
Copper	ppm	ASTM D5185m >50	3	2	3
Tin	ppm	ASTM D5185m >10	0	0	<1
Antimony	ppm	ASTM D5185m	---	---	---
Vanadium	ppm	ASTM D5185m	0	0	<1
Cadmium	ppm	ASTM D5185m	0	0	<1

ADDITIVES

	method	limit/base	current	history1	history2
Boron	ppm	ASTM D5185m	0	0	0
Barium	ppm	ASTM D5185m 90	0	0	0
Molybdenum	ppm	ASTM D5185m	3	0	<1
Manganese	ppm	ASTM D5185m	<1	<1	1
Magnesium	ppm	ASTM D5185m 90	34	36	41
Calcium	ppm	ASTM D5185m 2	<1	0	0
Phosphorus	ppm	ASTM D5185m	0	1	<1
Zinc	ppm	ASTM D5185m	15	9	10
Sulfur	ppm	ASTM D5185m	22892	23122	22403

CONTAMINANTS

	method	limit/base	current	history1	history2
Silicon	ppm	ASTM D5185m >25	0	<1	1
Sodium	ppm	ASTM D5185m	12	3	11
Potassium	ppm	ASTM D5185m >20	0	0	1
Water	%	ASTM D6304 >0.05	0.013	▲ 0.309	0.020
ppm Water	ppm	ASTM D6304 >500	134	▲ 3090	204.4






FLUID CLEANLINESS

	method	limit/base	current	history1	history2
Particles >4µm	ASTM D7647		8434	3784	11147
Particles >6µm	ASTM D7647 >1300		▲ 2150	▲ 2062	▲ 5006
Particles >14µm	ASTM D7647 >80		▲ 207	▲ 351	▲ 872
Particles >21µm	ASTM D7647 >20		▲ 62	▲ 118	▲ 186
Particles >38µm	ASTM D7647 >4		4	▲ 18	▲ 7
Particles >71µm	ASTM D7647 >3		0	2	0
Oil Cleanliness	ISO 4406 (c)	>--/17/13	▲ 20/18/15	▲ 19/18/16	▲ 21/20/17

FLUID DEGRADATION

	method	limit/base	current	history1	history2
Acid Number (AN)	mg KOH/g	ASTM D8045 0.4	0.33	0.37	0.32


OIL ANALYSIS REPORT

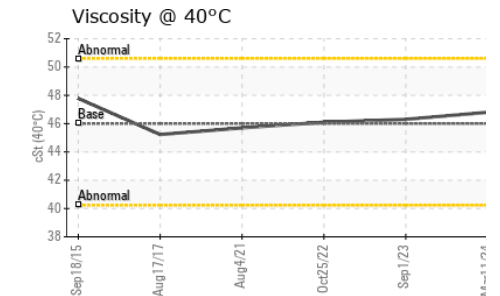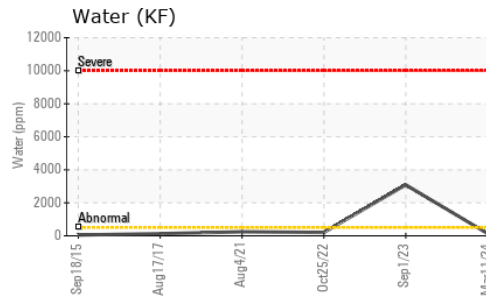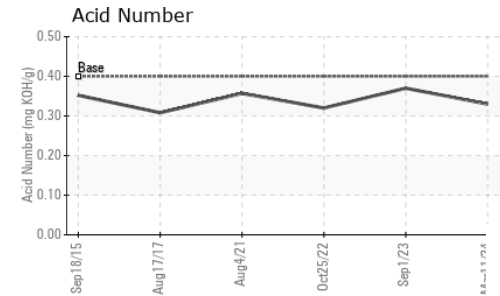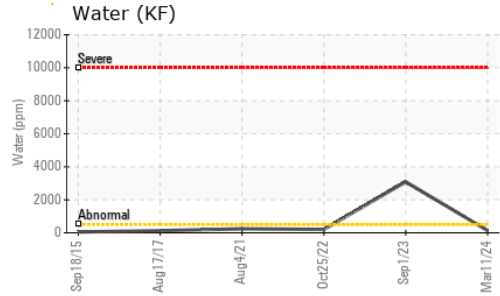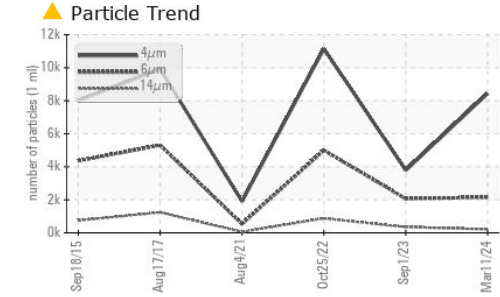





VISUAL	method	limit/base	current	history1	history2
White Metal	scalar	*Visual	NONE	NONE	MODER
Yellow Metal	scalar	*Visual	NONE	NONE	NONE
Precipitate	scalar	*Visual	NONE	NONE	NONE
Silt	scalar	*Visual	NONE	NONE	NONE
Debris	scalar	*Visual	NONE	NONE	NONE
Sand/Dirt	scalar	*Visual	NONE	NONE	NONE
Appearance	scalar	*Visual	NORML	NORML	NORML
Odor	scalar	*Visual	NORML	NORML	NORML
Emulsified Water	scalar	*Visual	>0.05	NEG	0.2%
Free Water	scalar	*Visual		NEG	NEG

FLUID PROPERTIES	method	limit/base	current	history1	history2
Visc @ 40°C	cSt	ASTM D445	46	46.8	46.3

SAMPLE IMAGES	method	limit/base	current	history1	history2
---------------	--------	------------	---------	----------	----------

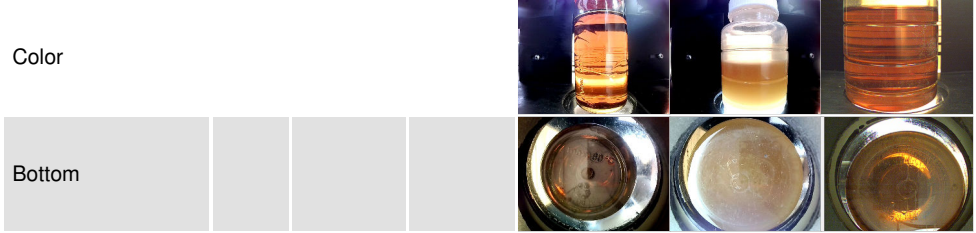

GRAPHS

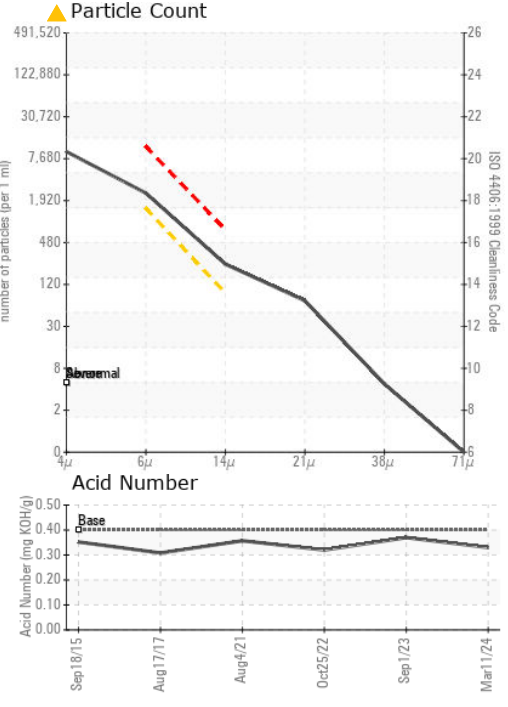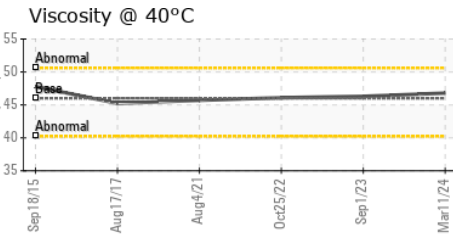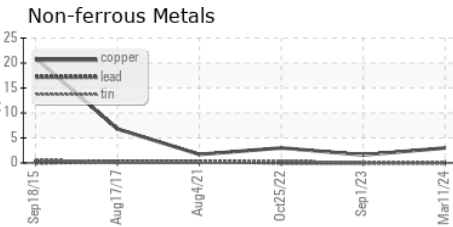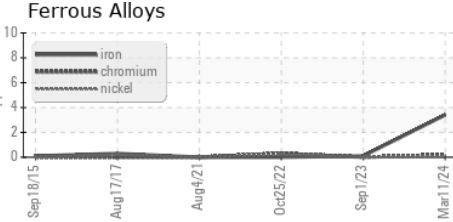

Laboratory : WearCheck USA - 501 Madison Ave., Cary, NC 27513
Sample No. : KCPA015359 **Received** : 19 Mar 2024
Lab Number : 06123183 **Tested** : 20 Mar 2024
Unique Number : 10937334 **Diagnosed** : 21 Mar 2024 - Don Baldrige
Test Package : IND 2 (Additional Tests: KF, PrtCount)

SOUTHLAND IDEALISE OF ALABAMA
 214 10TH ST S
 BIRMINGHAM, AL
 US 35233
 Contact: P. UNDERWOOD
 punderwood@southlandtrucks.com
 T:
 F:

To discuss this sample report, contact Customer Service at 1-800-237-1369.
 * - Denotes test methods that are outside of the ISO 17025 scope of accreditation.
 Statements of conformity to specifications are based on the simple acceptance decision rule (JCGM 106:2012)