


OIL ANALYSIS REPORT

Sample Rating Trend



ISO

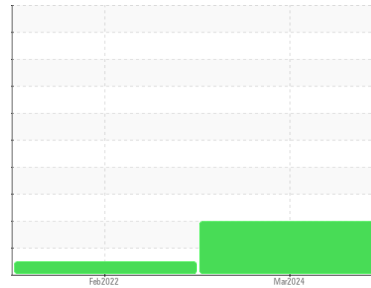

Machine Id
KAESER BSD 50 7278592 (S/N 2230)

Component
Compressor

Fluid
KAESER SIGMA (OEM) FG-460 (--- GAL)

DIAGNOSIS

▲ **Recommendation**

No corrective action is recommended at this time. Oil and filter change at the time of sampling has been noted. Resample at the next service interval to monitor.

Wear

All component wear rates are normal.

▲ **Contamination**

There is a high amount of particulates present in the oil.

Fluid Condition

The AN level is acceptable for this fluid. The condition of the oil is suitable for further service.

SAMPLE INFORMATION method limit/base current history1 history2

Sample Number	Client Info		KCPA013288	KCP40979	---
Sample Date	Client Info		05 Mar 2024	24 Feb 2022	---
Machine Age	hrs	Client Info	18168	4321	---
Oil Age	hrs	Client Info	3657	4321	---
Oil Changed	Client Info		Changed	Changed	---
Sample Status			ABNORMAL	NORMAL	---

WEAR METALS method limit/base current history1 history2

Iron	ppm	ASTM D5185m	>50	3	0	---
Chromium	ppm	ASTM D5185m	>10	<1	0	---
Nickel	ppm	ASTM D5185m	>3	0	0	---
Titanium	ppm	ASTM D5185m	>3	0	0	---
Silver	ppm	ASTM D5185m	>2	0	<1	---
Aluminum	ppm	ASTM D5185m	>10	3	6	---
Lead	ppm	ASTM D5185m	>10	0	0	---
Copper	ppm	ASTM D5185m	>50	1	2	---
Tin	ppm	ASTM D5185m	>10	0	<1	---
Vanadium	ppm	ASTM D5185m		0	0	---
Cadmium	ppm	ASTM D5185m		0	0	---

ADDITIVES method limit/base current history1 history2

Boron	ppm	ASTM D5185m		0	0	---
Barium	ppm	ASTM D5185m		0	0	---
Molybdenum	ppm	ASTM D5185m		3	0	---
Manganese	ppm	ASTM D5185m		<1	0	---
Magnesium	ppm	ASTM D5185m		2	0	---
Calcium	ppm	ASTM D5185m		2	0	---
Phosphorus	ppm	ASTM D5185m	500	32	115	---
Zinc	ppm	ASTM D5185m		0	96	---
Sulfur	ppm	ASTM D5185m		947	3164	---

CONTAMINANTS method limit/base current history1 history2

Silicon	ppm	ASTM D5185m	>25	0	0	---
Sodium	ppm	ASTM D5185m		2	0	---
Potassium	ppm	ASTM D5185m	>20	0	1	---
Water	%	ASTM D6304	>0.05	0.002	0.001	---
ppm Water	ppm	ASTM D6304	>500	16	4.1	---






FLUID CLEANLINESS method limit/base current history1 history2

Particles >4µm	ASTM D7647			15104	1045	---
Particles >6µm	ASTM D7647	>1300		▲ 4095	230	---
Particles >14µm	ASTM D7647	>80		▲ 419	13	---
Particles >21µm	ASTM D7647	>20		▲ 144	2	---
Particles >38µm	ASTM D7647	>4		▲ 7	0	---
Particles >71µm	ASTM D7647	>3		0	0	---
Oil Cleanliness	ISO 4406 (c)	>--/17/13		▲ 21/19/16	15/11	---

FLUID DEGRADATION method limit/base current history1 history2

Acid Number (AN)	mg KOH/g	ASTM D8045	1.5	0.64	0.57	---
------------------	----------	------------	-----	-------------	------	-----


OIL ANALYSIS REPORT

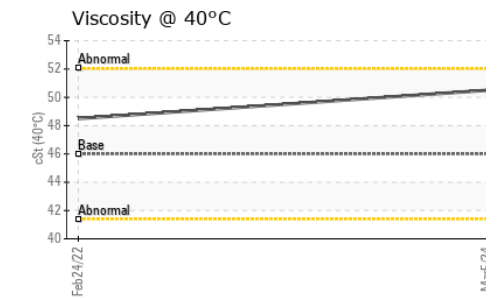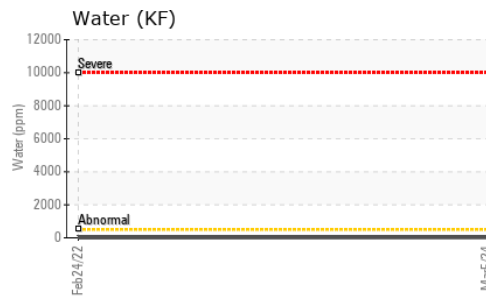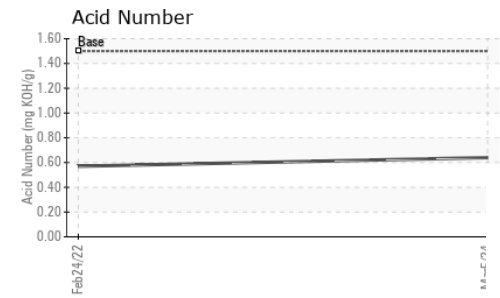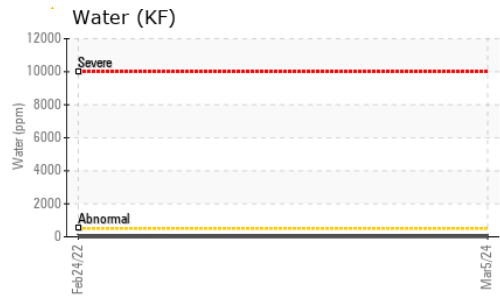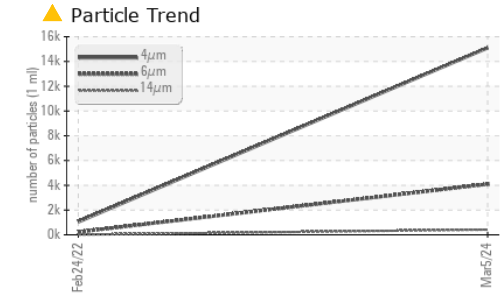






VISUAL	method	limit/base	current	history1	history2
White Metal	scalar	*Visual	NONE	NONE	---
Yellow Metal	scalar	*Visual	NONE	NONE	---
Precipitate	scalar	*Visual	NONE	NONE	---
Silt	scalar	*Visual	NONE	NONE	---
Debris	scalar	*Visual	NONE	NONE	---
Sand/Dirt	scalar	*Visual	NONE	NONE	---
Appearance	scalar	*Visual	NORML	NORML	---
Odor	scalar	*Visual	NORML	NORML	---
Emulsified Water	scalar	*Visual	>0.05	NEG	---
Free Water	scalar	*Visual		NEG	---

FLUID PROPERTIES	method	limit/base	current	history1	history2
Visc @ 40°C	cSt	ASTM D445 46	50.5	48.5	---

SAMPLE IMAGES	method	limit/base	current	history1	history2
---------------	--------	------------	---------	----------	----------

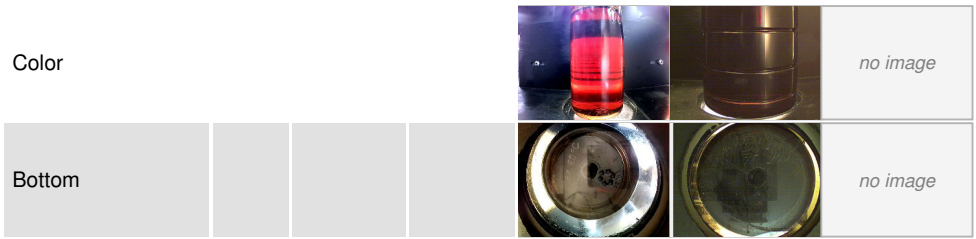

GRAPHS

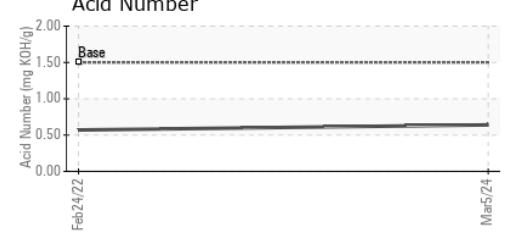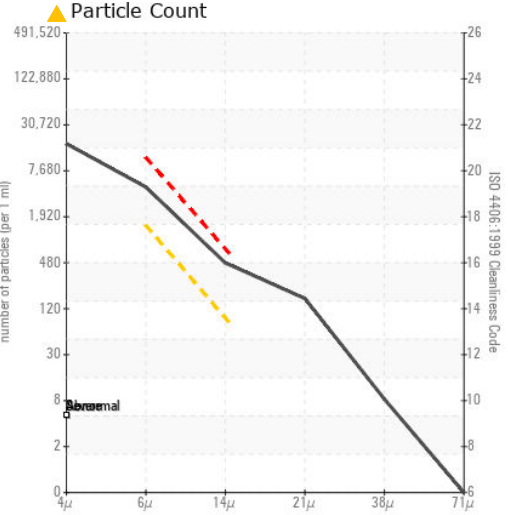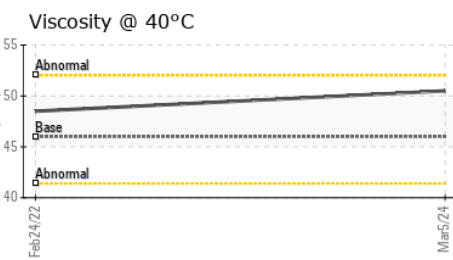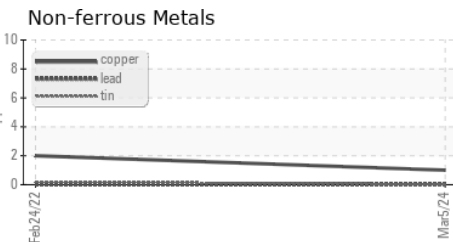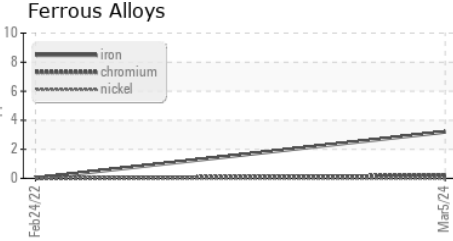

Laboratory : WearCheck USA - 501 Madison Ave., Cary, NC 27513
Sample No. : KCPA013288 **Received** : 19 Mar 2024
Lab Number : 06123204 **Tested** : 20 Mar 2024
Unique Number : 10937355 **Diagnosed** : 21 Mar 2024 - Don Baldrige
Test Package : IND 2 (Additional Tests: KF, PrtCount)

DE WAFELBAKERS LLC
 108 DECLARATION DR
 MCDONOUGH, GA
 US 30253
 Contact: SERVICE MANAGER

To discuss this sample report, contact Customer Service at 1-800-237-1369.
 * - Denotes test methods that are outside of the ISO 17025 scope of accreditation.
 Statements of conformity to specifications are based on the simple acceptance decision rule (JCGM 106:2012)