




# OIL ANALYSIS REPORT

Sample Rating Trend

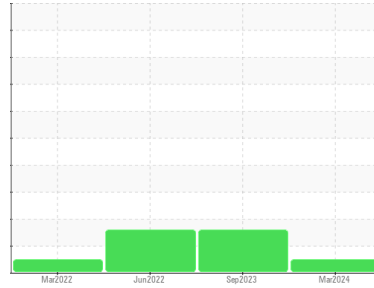

**NORMAL**



Machine Id  
**KAESER CSD 125 7191506 (S/N 1484)**

Component  
**Compressor**

Fluid  
**KAESER SIGMA (OEM) S-460 (--- GAL)**

## DIAGNOSIS

### Recommendation

Resample at the next service interval to monitor.

### Wear

All component wear rates are normal.

### Contamination

The amount and size of particulates present in the system are acceptable. There is no indication of any contamination in the oil.

### Fluid Condition

The AN level is acceptable for this fluid. The condition of the oil is suitable for further service.

SAMPLE INFORMATION		method	limit/base	current	history1	history2
Sample Number	Client Info			<b>KCPA013276</b>	KCPA000799	KCP51925
Sample Date	Client Info			<b>06 Mar 2024</b>	15 Sep 2023	21 Jun 2022
Machine Age	hrs	Client Info		<b>25718</b>	21566	10762
Oil Age	hrs	Client Info		<b>3516</b>	0	2600
Oil Changed	Client Info			<b>Not Chngd</b>	N/A	Not Chngd
Sample Status				<b>NORMAL</b>	ABNORMAL	ABNORMAL

WEAR METALS		method	limit/base	current	history1	history2
Iron	ppm	ASTM D5185m	>50	<b>3</b>	0	<1
Chromium	ppm	ASTM D5185m	>10	<b>&lt;1</b>	0	0
Nickel	ppm	ASTM D5185m	>3	<b>0</b>	0	0
Titanium	ppm	ASTM D5185m	>3	<b>0</b>	0	0
Silver	ppm	ASTM D5185m	>2	<b>0</b>	0	<1
Aluminum	ppm	ASTM D5185m	>10	<b>&lt;1</b>	0	3
Lead	ppm	ASTM D5185m	>10	<b>0</b>	0	0
Copper	ppm	ASTM D5185m	>50	<b>2</b>	6	6
Tin	ppm	ASTM D5185m	>10	<b>0</b>	0	<1
Vanadium	ppm	ASTM D5185m		<b>0</b>	0	0
Cadmium	ppm	ASTM D5185m		<b>0</b>	0	0






ADDITIVES		method	limit/base	current	history1	history2
Boron	ppm	ASTM D5185m		<b>0</b>	0	1
Barium	ppm	ASTM D5185m	90	<b>50</b>	0	0
Molybdenum	ppm	ASTM D5185m		<b>3</b>	0	0
Manganese	ppm	ASTM D5185m		<b>&lt;1</b>	<1	<1
Magnesium	ppm	ASTM D5185m	90	<b>73</b>	14	18
Calcium	ppm	ASTM D5185m	2	<b>6</b>	0	0
Phosphorus	ppm	ASTM D5185m		<b>&lt;1</b>	4	4
Zinc	ppm	ASTM D5185m		<b>0</b>	0	15
Sulfur	ppm	ASTM D5185m		<b>21389</b>	17588	19091

CONTAMINANTS		method	limit/base	current	history1	history2
Silicon	ppm	ASTM D5185m	>25	<b>&lt;1</b>	<1	1
Sodium	ppm	ASTM D5185m		<b>35</b>	6	11
Potassium	ppm	ASTM D5185m	>20	<b>12</b>	3	3
Water	%	ASTM D6304	>0.05	<b>0.019</b>	0.001	0.007
ppm Water	ppm	ASTM D6304	>500	<b>192</b>	3.4	70.4

FLUID CLEANLINESS		method	limit/base	current	history1	history2
Particles >4µm		ASTM D7647		<b>2004</b>	27469	46851
Particles >6µm		ASTM D7647	>1300	<b>560</b>	▲ 5353	▲ 15737
Particles >14µm		ASTM D7647	>80	<b>49</b>	▲ 148	▲ 538
Particles >21µm		ASTM D7647	>20	<b>16</b>	▲ 31	▲ 67
Particles >38µm		ASTM D7647	>4	<b>1</b>	1	2
Particles >71µm		ASTM D7647	>3	<b>0</b>	0	0
Oil Cleanliness		ISO 4406 (c)	>--/17/13	<b>18/16/13</b>	▲ 22/20/14	▲ 23/21/16

FLUID DEGRADATION		method	limit/base	current	history1	history2
Acid Number (AN)	mg KOH/g	ASTM D8045	0.4	<b>0.47</b>	0.39	0.45


# OIL ANALYSIS REPORT

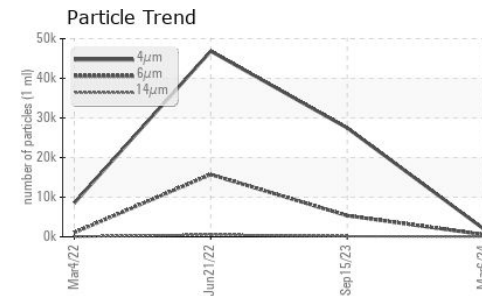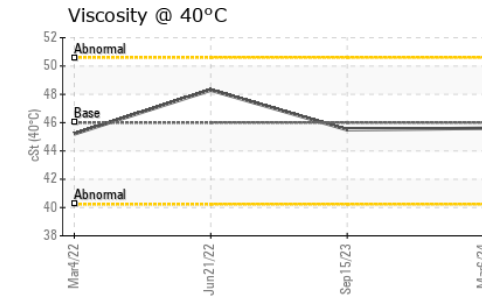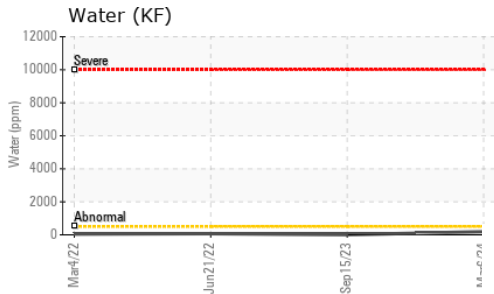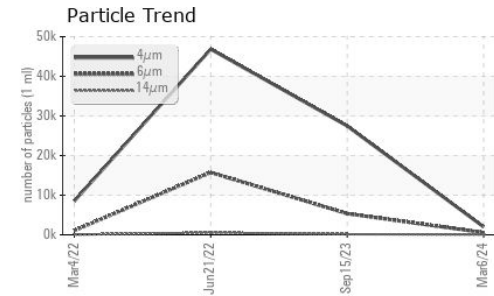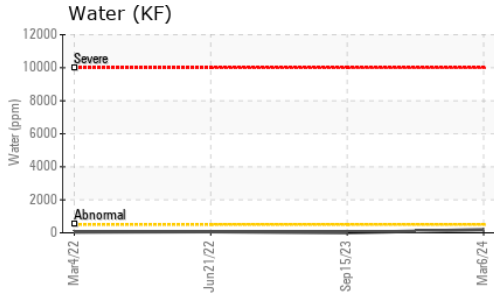






VISUAL	method	limit/base	current	history1	history2
White Metal	scalar	*Visual	NONE	NONE	NONE
Yellow Metal	scalar	*Visual	NONE	NONE	NONE
Precipitate	scalar	*Visual	NONE	NONE	NONE
Silt	scalar	*Visual	NONE	NONE	NONE
Debris	scalar	*Visual	NONE	NONE	LIGHT
Sand/Dirt	scalar	*Visual	NONE	NONE	NONE
Appearance	scalar	*Visual	NORML	NORML	NORML
Odor	scalar	*Visual	NORML	NORML	NORML
Emulsified Water	scalar	*Visual	>0.05	NEG	NEG
Free Water	scalar	*Visual		NEG	NEG

FLUID PROPERTIES	method	limit/base	current	history1	history2
Visc @ 40°C	cSt	ASTM D445 46	45.6	45.5	48.3

SAMPLE IMAGES	method	limit/base	current	history1	history2
---------------	--------	------------	---------	----------	----------

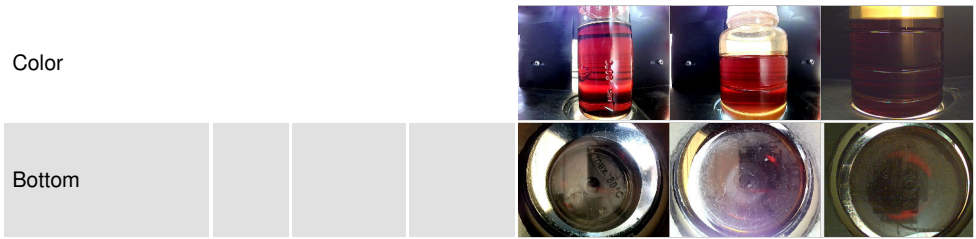

## GRAPHS

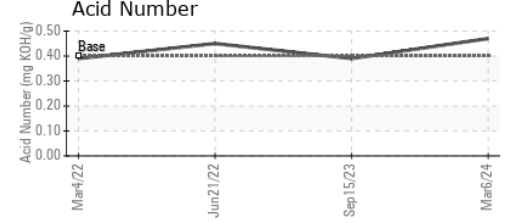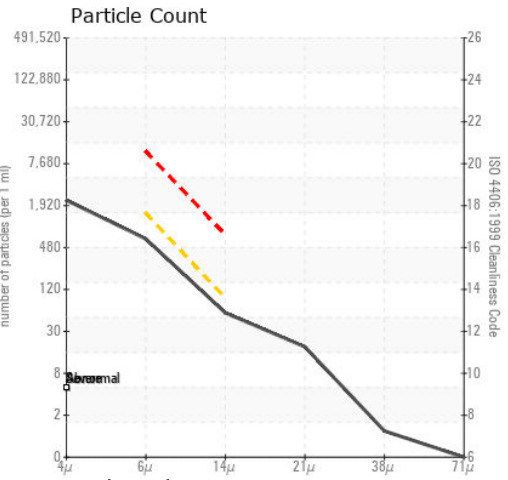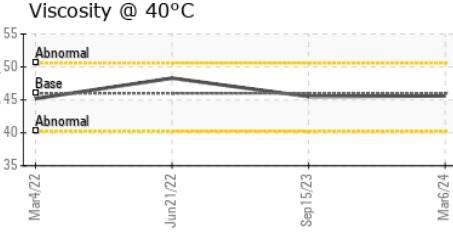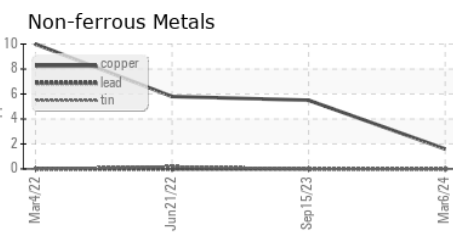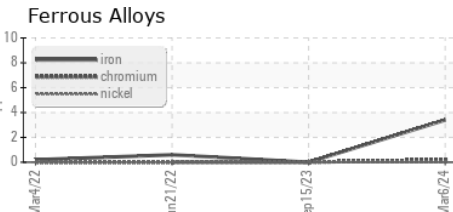

**Laboratory** : WearCheck USA - 501 Madison Ave., Cary, NC 27513  
**Sample No.** : KCPA013276 **Received** : 19 Mar 2024  
**Lab Number** : 06123215 **Tested** : 20 Mar 2024  
**Unique Number** : 10937366 **Diagnosed** : 21 Mar 2024 - Don Baldrige  
**Test Package** : IND 2 ( Additional Tests: KF, PrtCount )

**AXIUM PLASTICS**  
 9005 SMITHS MILL RD  
 NEW ALBANY, OH  
 US 43054  
 Contact: P. LONGIA  
 plongia@axiumplastics.com  
 T:  
 F:

Certificate L2367  
 To discuss this sample report, contact Customer Service at 1-800-237-1369.  
 \* - Denotes test methods that are outside of the ISO 17025 scope of accreditation.  
 Statements of conformity to specifications are based on the simple acceptance decision rule (JCGM 106:2012)