

COOLANT REPORT

THUNDER SPIRIT [200005313]

20WEA84013 - CONVERTER (S/N 72802187631)
Component

Coolant

ISENTHAL VARIDOS 45 (--- QTS)

Sample Rating Trend Maylogz Mad0224



DIAGNOSIS

Recommendation

The fluid is suitable for further service.

Corrosion

All metal levels are normal indicating no corrosion in the cooling system.

Contaminants

There is no indication of any contamination in the coolant.

Coolant Condition

Glycol and nitrite levels are acceptable. The pH level of this fluid is within the acceptable limits.


			May2022	Mar2024		
SAMPLE INFORM	MATION	method	limit/base	current	history1	history2
Sample Number		Client Info		NX014781	NX004396	
Sample Date		Client Info		07 Mar 2024	06 May 2022	
Machine Age	hrs	Client Info		4950	0	
Oil Age	hrs	Client Info		0	0	
Oil Changed		Client Info		N/A	N/A	
Sample Status				NORMAL	NORMAL	
PHYSICAL TEST F	RESULTS	method	limit/base	current	history1	history2
Glycol Type		FT-IR				
Specific Gravity		*ASTM D1298		1.079	1.079	
рН	Scale 0-14	ASTM D1287	8.5	7.87	7.86	
Nitrites	ppm	AP-053:2009	260	1088	560	
Reserve Alkalinity	Scale 0-20	*ASTM D1121				
Percentage Glycol	%	ASTM D3321	45	59.8	59.5	
Freezing Point	°F	ASTM D3321	-24	-56	-56	
Total Dissolved Solids				308.0	317.0	
Carboxylate				n/a	n/a	
CORROSION INH	IBITORS	method	limit/base	current	history1	history2
Silicon	ppm	ASTM D6130	25	14	24	
Phosphorus	ppm	ASTM D6130	140	1483	1141	
Boron	ppm	ASTM D6130	0	252	437	
Molybdenum	ppm	ASTM D6130	1075	10	3	
CORROSION		method	limit/base	current	history1	history2
Iron	ppm	ASTM D6130	>15	2	0	
Aluminum	ppm	ASTM D6130	>10	1	0	
Copper	ppm	ASTM D6130	>10	1	<1	
Lead	ppm	ASTM D6130	>10	<1	0	
Tin	ppm	ASTM D6130	>10	0	0	
Zinc	ppm	ASTM D6130		0	0	
CONTAMINANTS	;	method	limit/base	current	history1	history2
Chlorine	ppm	ASTM D6130		22	0	
CARRIER SALTS		method	limit/base	current	history1	history2
Sodium	ppm	ASTM D6130	1075	406	351	
Potassium	ppm	ASTM D6130	5	4270	2510	
SCALE POTENTI	AL	method	limit/base	current	history1	history2
Calcium	ppm	ASTM D6130		<1	0	
	15/6				-	


ppm ASTM D6130

Magnesium



COOLANT REPORT



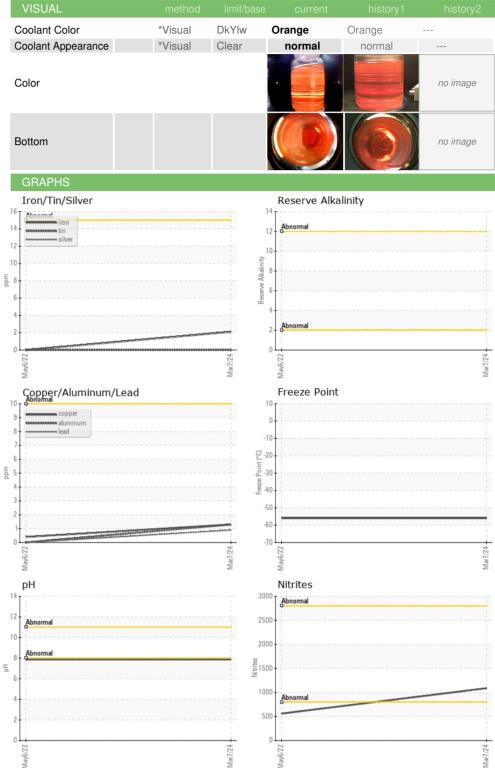



Laboratory Sample No.

Lab Number : 06123277 Unique Number : 10937428

: WearCheck USA - 501 Madison Ave., Cary, NC 27513 : NX014781 Received : 19 Mar 2024

Tested : 20 Mar 2024 Diagnosed

: 22 Mar 2024 - Jonathan Hester

NORDEX USA - Chicago 300 SOUTH WACKER DRIVE, SUITE 1500 CHICAGO, IL

US 60606 Contact: DEVIN LINEHAN

Test Package : COOL- (Additional Tests: BoilingPoint, COOL, GlycolType, ICP) To discuss this sample report, contact Customer Service at 1-800-237-1369.

DLinehan@nordex-online.com T: (312)386-4124

* - Denotes test methods that are outside of the ISO 17025 scope of accreditation. Statements of conformity to specifications are based on the simple acceptance decision rule (JCGM 106:2012)

F: (312)386-7102