



OIL ANALYSIS REPORT

Sample Rating Trend

NORMAL



Area

Plant US1 Greenville

Machine Id


TU06 - Hydraulic

Component

Hydraulic System

Fluid

SHELL TELLUS S2 M 46 (--- GAL)

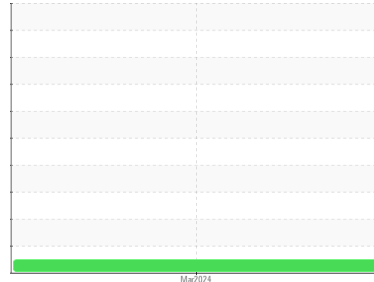

DIAGNOSIS

Recommendation

Resample at the next service interval to monitor.

Wear

All component wear rates are normal.

Contamination

There is no indication of any contamination in the oil. The amount and size of particulates present in the system are acceptable.

Fluid Condition

The AN level is acceptable for this fluid. The condition of the oil is suitable for further service.

SAMPLE INFORMATION

	method	limit/base	current	history1	history2
Sample Number	Client Info		TLC0001514	---	---
Sample Date	Client Info		18 Mar 2024	---	---
Machine Age	hrs	Client Info	0	---	---
Oil Age	hrs	Client Info	0	---	---
Oil Changed	Client Info		N/A	---	---
Sample Status			NORMAL	---	---

WEAR METALS

	method	limit/base	current	history1	history2
Iron	ppm	ASTM D5185m	>20	0	---
Chromium	ppm	ASTM D5185m	>20	0	---
Nickel	ppm	ASTM D5185m	>20	0	---
Titanium	ppm	ASTM D5185m		0	---
Silver	ppm	ASTM D5185m		0	---
Aluminum	ppm	ASTM D5185m	>20	0	---
Lead	ppm	ASTM D5185m	>20	0	---
Copper	ppm	ASTM D5185m	>20	4	---
Tin	ppm	ASTM D5185m	>20	<1	---
Vanadium	ppm	ASTM D5185m		0	---
Cadmium	ppm	ASTM D5185m		0	---

ADDITIVES

	method	limit/base	current	history1	history2
Boron	ppm	ASTM D5185m		0	---
Barium	ppm	ASTM D5185m		0	---
Molybdenum	ppm	ASTM D5185m		0	---
Manganese	ppm	ASTM D5185m		<1	---
Magnesium	ppm	ASTM D5185m		13	---
Calcium	ppm	ASTM D5185m		24	---
Phosphorus	ppm	ASTM D5185m		274	---
Zinc	ppm	ASTM D5185m		317	---
Sulfur	ppm	ASTM D5185m		864	---

CONTAMINANTS

	method	limit/base	current	history1	history2
Silicon	ppm	ASTM D5185m	>15	0	---
Sodium	ppm	ASTM D5185m		<1	---
Potassium	ppm	ASTM D5185m	>20	0	---
Water	%	ASTM D6304	>0.05	NEG	---

FLUID CLEANLINESS





	method	limit/base	current	history1	history2
Particles >4µm	ASTM D7647	>5000	373	---	---
Particles >6µm	ASTM D7647	>1300	123	---	---
Particles >14µm	ASTM D7647	>160	18	---	---
Particles >21µm	ASTM D7647	>40	6	---	---
Particles >38µm	ASTM D7647	>10	1	---	---
Particles >71µm	ASTM D7647	>3	0	---	---
Oil Cleanliness	ISO 4406 (c)	>19/17/14	16/14/11	---	---

FLUID DEGRADATION

	method	limit/base	current	history1	history2
Acid Number (AN)	mg KOH/g	ASTM D8045		0.34	---



OIL ANALYSIS REPORT

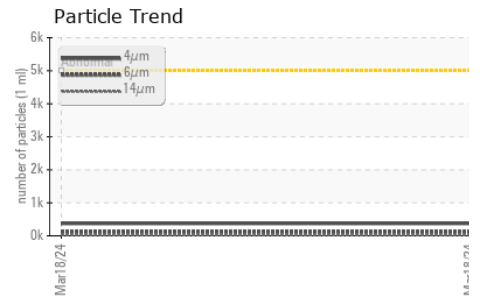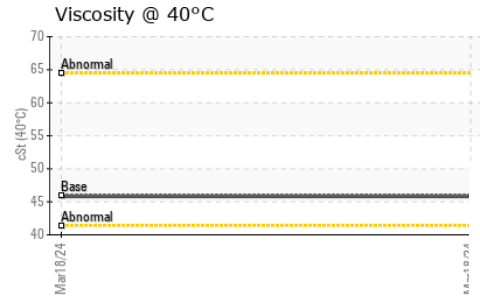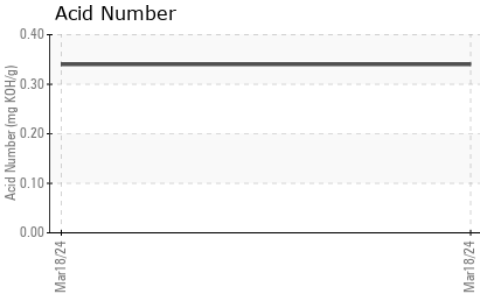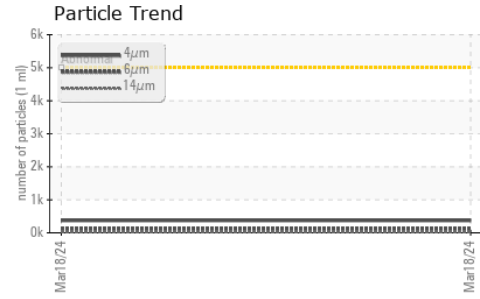






VISUAL	method	limit/base	current	history1	history2
White Metal	scalar	*Visual	NONE	NONE	---
Yellow Metal	scalar	*Visual	NONE	NONE	---
Precipitate	scalar	*Visual	NONE	NONE	---
Silt	scalar	*Visual	NONE	NONE	---
Debris	scalar	*Visual	NONE	NONE	---
Sand/Dirt	scalar	*Visual	NONE	NONE	---
Appearance	scalar	*Visual	NORML	NORML	---
Odor	scalar	*Visual	NORML	NORML	---
Emulsified Water	scalar	*Visual	>0.05	NEG	---
Free Water	scalar	*Visual		NEG	---

FLUID PROPERTIES	method	limit/base	current	history1	history2
Visc @ 40°C	cSt	ASTM D445	46.0	45.8	---

SAMPLE IMAGES	method	limit/base	current	history1	history2
---------------	--------	------------	---------	----------	----------

Color		no image	no image
Bottom		no image	no image

GRAPHS

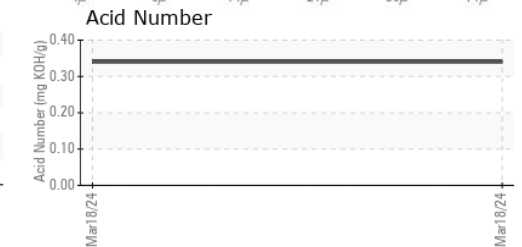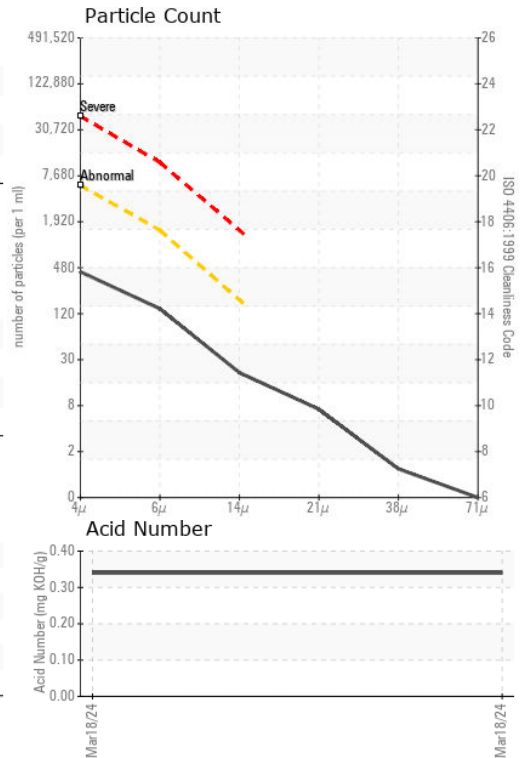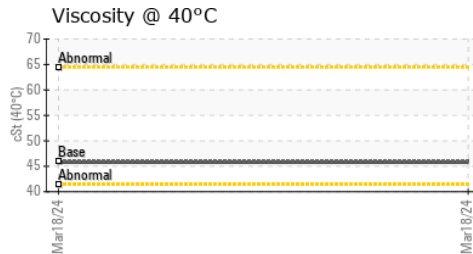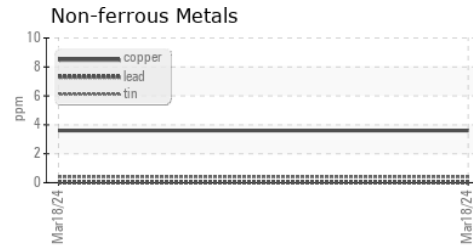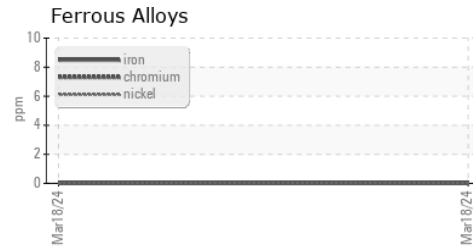

Certificate L2367

Laboratory : WearCheck USA - 501 Madison Ave., Cary, NC 27513
 Sample No. : TLC0001514
 Lab Number : 06123597
 Unique Number : 10937748
 Test Package : PLANT

Received : 20 Mar 2024
 Tested : 25 Mar 2024
 Diagnosed : 25 Mar 2024 - Jonathan Hester

MICHELIN TIRE-GRENVILLE US 1 JN DOCK
 1401 ANTIOCH CHURCH ROAD
 Greenville, SC
 US 29605
 Contact: Nicolas Jackson
 nicolas.jackson@michelin.com
 T: (864)458-1870
 F:

To discuss this sample report, contact Customer Service at 1-800-237-1369.

* - Denotes test methods that are outside of the ISO 17025 scope of accreditation.

Statements of conformity to specifications are based on the simple acceptance decision rule (JCGM 106:2012)