




# OIL ANALYSIS REPORT

Sample Rating Trend

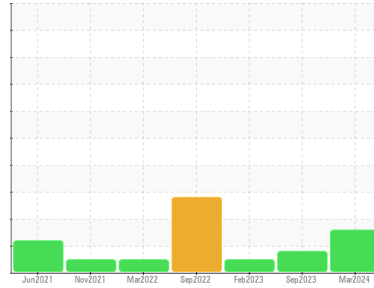

**WEAR**



Machine Id  
**KAESER 7344404**

Component  
**Compressor**

Fluid  
**KAESER SIGMA (OEM) M-460 (--- GAL)**

**DIAGNOSIS**

**Recommendation**

We recommend you service the filters on this component. Resample at the next service interval to monitor. We were unable to perform a particle count due to a high concentration of particles present in this sample.

**Wear**

The iron level is marginal.

**Contamination**

There is a moderate amount of visible silt present in the sample.

**Fluid Condition**

The AN level is acceptable for this fluid. The condition of the oil is suitable for further service.

SAMPLE INFORMATION		method	limit/base	current	history1	history2
Sample Number	Client Info			<b>KC121771</b>	KCPA000763	KCP55929
Sample Date	Client Info			<b>19 Mar 2024</b>	05 Sep 2023	23 Feb 2023
Machine Age	hrs	Client Info		<b>20388</b>	16828	13857
Oil Age	hrs	Client Info		<b>0</b>	0	3000
Oil Changed	Client Info			<b>N/A</b>	N/A	Changed
Sample Status				<b>ABNORMAL</b>	ABNORMAL	NORMAL

WEAR METALS		method	limit/base	current	history1	history2
Iron	ppm	ASTM D5185m	>50	<b>▲ 46</b>	20	0
Chromium	ppm	ASTM D5185m	>10	<b>0</b>	0	0
Nickel	ppm	ASTM D5185m	>3	<b>0</b>	<1	0
Titanium	ppm	ASTM D5185m	>3	<b>0</b>	0	0
Silver	ppm	ASTM D5185m	>2	<b>0</b>	0	0
Aluminum	ppm	ASTM D5185m	>10	<b>&lt;1</b>	0	<1
Lead	ppm	ASTM D5185m	>10	<b>0</b>	<1	0
Copper	ppm	ASTM D5185m	>50	<b>2</b>	2	1
Tin	ppm	ASTM D5185m	>10	<b>&lt;1</b>	<1	0
Vanadium	ppm	ASTM D5185m		<b>0</b>	0	0
Cadmium	ppm	ASTM D5185m		<b>0</b>	0	0





ADDITIVES		method	limit/base	current	history1	history2
Boron	ppm	ASTM D5185m	0	<b>0</b>	0	0
Barium	ppm	ASTM D5185m	90	<b>32</b>	26	60
Molybdenum	ppm	ASTM D5185m	0	<b>0</b>	0	0
Manganese	ppm	ASTM D5185m		<b>1</b>	1	1
Magnesium	ppm	ASTM D5185m	100	<b>79</b>	62	99
Calcium	ppm	ASTM D5185m	0	<b>1</b>	1	2
Phosphorus	ppm	ASTM D5185m	0	<b>4</b>	19	2
Zinc	ppm	ASTM D5185m	0	<b>0</b>	3	27

CONTAMINANTS		method	limit/base	current	history1	history2
Silicon	ppm	ASTM D5185m	>25	<b>&lt;1</b>	1	1
Sodium	ppm	ASTM D5185m		<b>16</b>	18	15
Potassium	ppm	ASTM D5185m	>20	<b>5</b>	5	6
Water	%	ASTM D6304	>0.05	<b>0.015</b>	0.035	0.017
ppm Water	ppm	ASTM D6304	>500	<b>154</b>	352.8	179.8

FLUID CLEANLINESS		method	limit/base	current	history1	history2
Particles >4µm		ASTM D7647		---	43742	4119
Particles >6µm		ASTM D7647	>1300	---	<b>▲ 4129</b>	729
Particles >14µm		ASTM D7647	>80	---	27	24
Particles >21µm		ASTM D7647	>20	---	3	5
Particles >38µm		ASTM D7647	>4	---	0	1
Particles >71µm		ASTM D7647	>3	---	0	0
Oil Cleanliness		ISO 4406 (c)	>--/17/13	---	<b>▲ 23/19/12</b>	19/17/12

FLUID DEGRADATION		method	limit/base	current	history1	history2
Acid Number (AN)	mg KOH/g	ASTM D8045	1.0	<b>0.40</b>	0.35	0.36


# OIL ANALYSIS REPORT

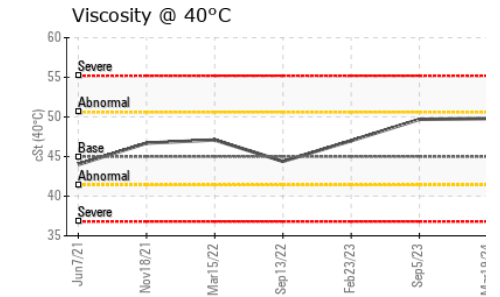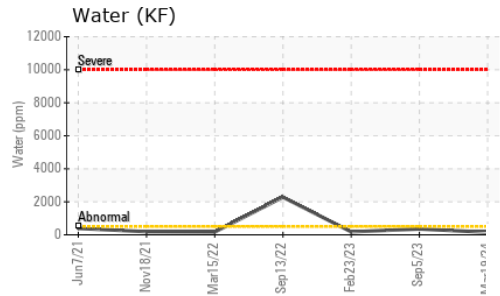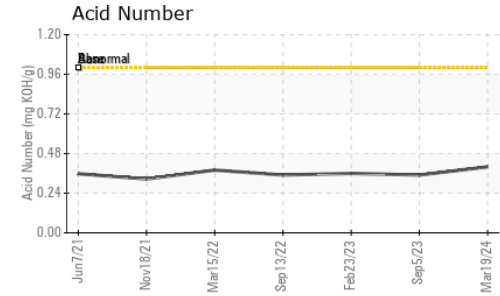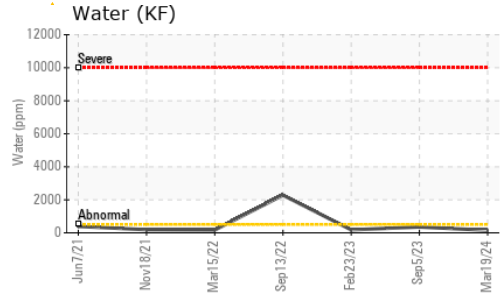





VISUAL	method	limit/base	current	history1	history2
White Metal	scalar	*Visual	NONE	NONE	VLITE
Yellow Metal	scalar	*Visual	NONE	NONE	NONE
Precipitate	scalar	*Visual	NONE	NONE	NONE
Silt	scalar	*Visual	▲ MODER	NONE	NONE
Debris	scalar	*Visual	NONE	NONE	LIGHT
Sand/Dirt	scalar	*Visual	NONE	NONE	NONE
Appearance	scalar	*Visual	NORML	NORML	NORML
Odor	scalar	*Visual	NORML	NORML	NORML
Emulsified Water	scalar	*Visual	>0.05	NEG	NEG
Free Water	scalar	*Visual		NEG	NEG

FLUID PROPERTIES	method	limit/base	current	history1	history2
Visc @ 40°C	cSt	ASTM D445 45	49.8	49.7	47.0

SAMPLE IMAGES	method	limit/base	current	history1	history2
---------------	--------	------------	---------	----------	----------

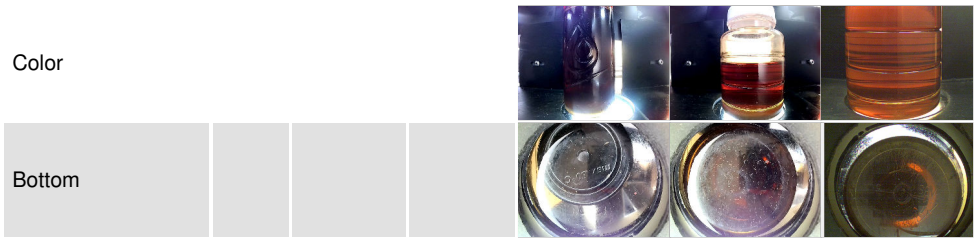

## GRAPHS

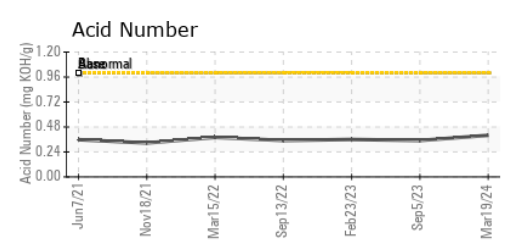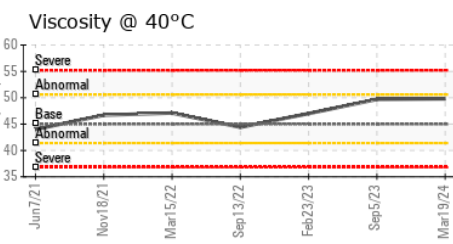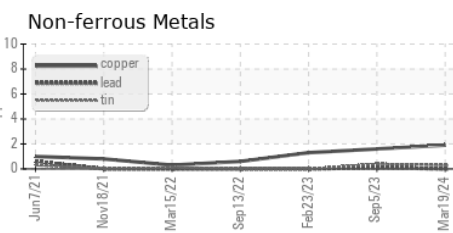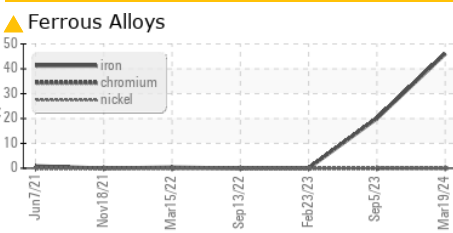

**Laboratory** : WearCheck USA - 501 Madison Ave., Cary, NC 27513  
**Sample No.** : KC121771  
**Lab Number** : 06123631  
**Unique Number** : 10937782  
**Test Package** : IND 2  
**Received** : 20 Mar 2024  
**Tested** : 25 Mar 2024  
**Diagnosed** : 25 Mar 2024 - Jonathan Hester

**AMAZON**  
 9700 S 13TH ST  
 OAK CREEK, WI  
 US 53154  
 Contact: Service Manager  
 ssswosin@amazon.com  
 T:  
 F:

To discuss this sample report, contact Customer Service at 1-800-237-1369.  
 \* - Denotes test methods that are outside of the ISO 17025 scope of accreditation.  
 Statements of conformity to specifications are based on the simple acceptance decision rule (JCGM 106:2012)