




# OIL ANALYSIS REPORT

Sample Rating Trend

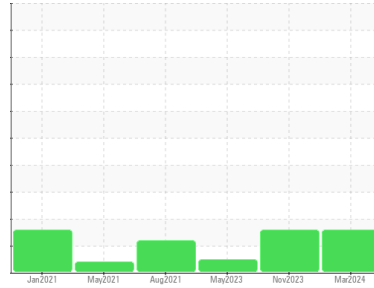

ISO



Machine Id  
**6207972 (S/N 1006)**

Component  
**Compressor**

Fluid  
**KAESER SIGMA (OEM) FG-460 (--- GAL)**

## DIAGNOSIS

### Recommendation

No corrective action is recommended at this time. The filter change at the time of sampling has been noted. Resample at the next service interval to monitor.

### Wear

All component wear rates are normal.

### Contamination

There is a moderate amount of particulates present in the oil.

### Fluid Condition

The AN level is acceptable for this fluid. The condition of the oil is suitable for further service.

SAMPLE INFORMATION		method	limit/base	current	history1	history2
Sample Number	Client Info			<b>KC121749</b>	KC124787	KC112007
Sample Date	Client Info			<b>05 Mar 2024</b>	10 Nov 2023	19 May 2023
Machine Age	hrs	Client Info		<b>230</b>	2300	2300
Oil Age	hrs	Client Info		<b>0</b>	0	0
Oil Changed	Client Info			<b>N/A</b>	N/A	Not Changd
Sample Status				<b>ATTENTION</b>	ATTENTION	NORMAL

WEAR METALS		method	limit/base	current	history1	history2
Iron	ppm	ASTM D5185m	>50	<b>0</b>	0	0
Chromium	ppm	ASTM D5185m	>10	<b>0</b>	0	0
Nickel	ppm	ASTM D5185m	>3	<b>0</b>	0	0
Titanium	ppm	ASTM D5185m	>3	<b>0</b>	0	0
Silver	ppm	ASTM D5185m	>2	<b>0</b>	0	0
Aluminum	ppm	ASTM D5185m	>10	<b>0</b>	0	0
Lead	ppm	ASTM D5185m	>10	<b>0</b>	0	0
Copper	ppm	ASTM D5185m	>50	<b>0</b>	0	0
Tin	ppm	ASTM D5185m	>10	<b>&lt;1</b>	0	0
Antimony	ppm	ASTM D5185m		<b>---</b>	---	---
Vanadium	ppm	ASTM D5185m		<b>0</b>	0	0
Cadmium	ppm	ASTM D5185m		<b>0</b>	0	0






ADDITIVES		method	limit/base	current	history1	history2
Boron	ppm	ASTM D5185m		<b>0</b>	0	0
Barium	ppm	ASTM D5185m		<b>0</b>	2	0
Molybdenum	ppm	ASTM D5185m		<b>0</b>	0	0
Manganese	ppm	ASTM D5185m		<b>&lt;1</b>	0	0
Magnesium	ppm	ASTM D5185m		<b>&lt;1</b>	2	2
Calcium	ppm	ASTM D5185m		<b>0</b>	1	0
Phosphorus	ppm	ASTM D5185m	500	<b>522</b>	442	538
Zinc	ppm	ASTM D5185m		<b>0</b>	9	0

CONTAMINANTS		method	limit/base	current	history1	history2
Silicon	ppm	ASTM D5185m	>25	<b>0</b>	<1	1
Sodium	ppm	ASTM D5185m		<b>&lt;1</b>	0	1
Potassium	ppm	ASTM D5185m	>20	<b>0</b>	0	1
Water	%	ASTM D6304	>0.05	<b>0.005</b>	0.002	0.002
ppm Water	ppm	ASTM D6304	>500	<b>57</b>	19	18.5

FLUID CLEANLINESS		method	limit/base	current	history1	history2
Particles >4µm		ASTM D7647		<b>7417</b>	5491	5216
Particles >6µm		ASTM D7647	>1300	<b>2116</b>	1481	1138
Particles >14µm		ASTM D7647	>80	<b>121</b>	98	58
Particles >21µm		ASTM D7647	>20	<b>21</b>	27	13
Particles >38µm		ASTM D7647	>4	<b>0</b>	1	1
Particles >71µm		ASTM D7647	>3	<b>0</b>	0	1
Oil Cleanliness		ISO 4406 (c)	>--/17/13	<b>20/18/14</b>	20/18/14	20/17/13

FLUID DEGRADATION		method	limit/base	current	history1	history2
Acid Number (AN)	mg KOH/g	ASTM D8045	1.5	<b>1.702</b>	1.60	1.53


# OIL ANALYSIS REPORT

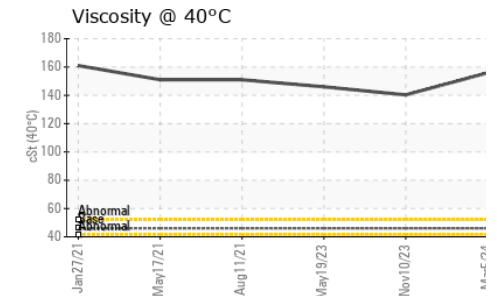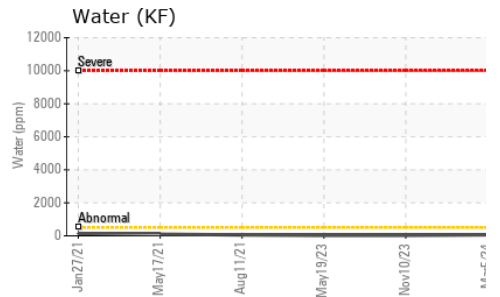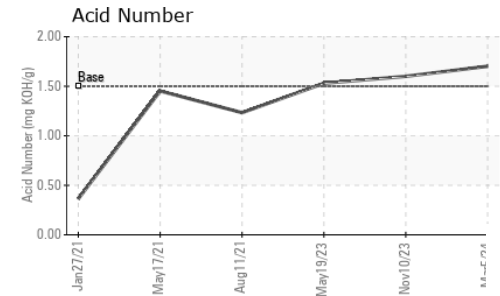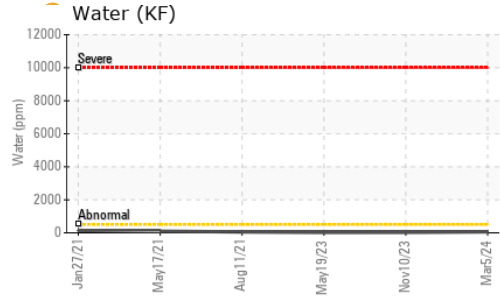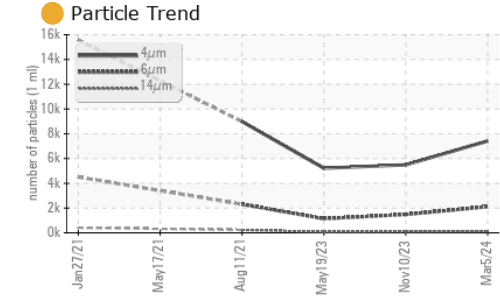





VISUAL	method	limit/base	current	history1	history2
White Metal	scalar	*Visual	NONE	NONE	NONE
Yellow Metal	scalar	*Visual	NONE	NONE	NONE
Precipitate	scalar	*Visual	NONE	NONE	NONE
Silt	scalar	*Visual	NONE	NONE	NONE
Debris	scalar	*Visual	NONE	NONE	NONE
Sand/Dirt	scalar	*Visual	NONE	NONE	NONE
Appearance	scalar	*Visual	NORML	NORML	NORML
Odor	scalar	*Visual	NORML	NORML	NORML
Emulsified Water	scalar	*Visual	>0.05	NEG	NEG
Free Water	scalar	*Visual		NEG	NEG

FLUID PROPERTIES	method	limit/base	current	history1	history2
Visc @ 40°C	cSt	ASTM D445 46	155.9	140.3	146

SAMPLE IMAGES	method	limit/base	current	history1	history2
---------------	--------	------------	---------	----------	----------

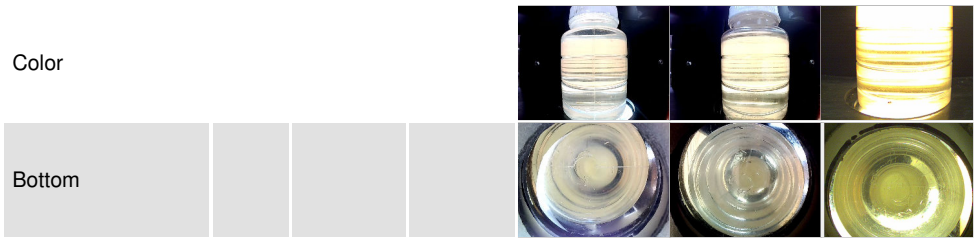

## GRAPHS

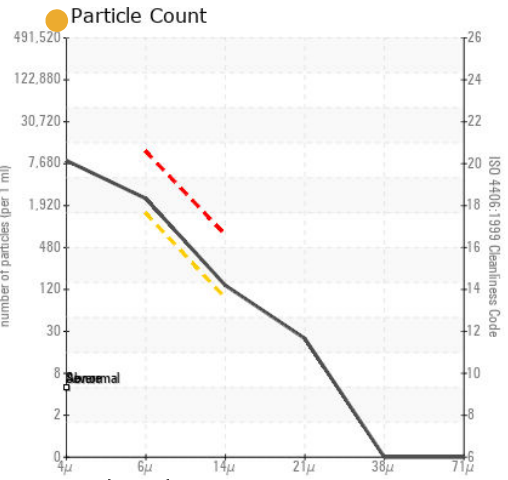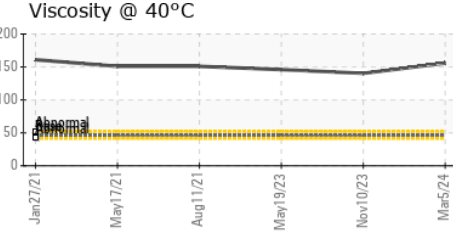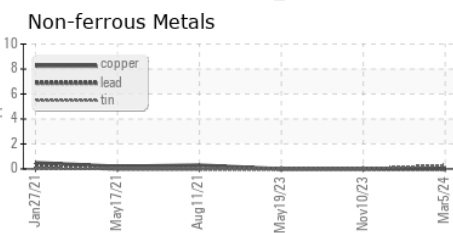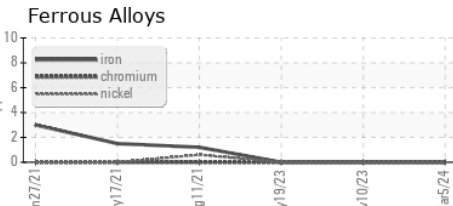

**Laboratory** : WearCheck USA - 501 Madison Ave., Cary, NC 27513  
**Sample No.** : KC121749  
**Lab Number** : 06123636  
**Unique Number** : 10937787  
**Test Package** : IND 2

**PREFORM TECHNOLOGIES**  
 11362 S AIRFIELD RD  
 SWANTON, OH  
 US 43558  
 Contact: N NEINLOVE  
 N.NEINLOVE@PREFORMTECHNOLOGIES.COM  
 T:  
 F:

To discuss this sample report, contact Customer Service at 1-800-237-1369.  
 \* - Denotes test methods that are outside of the ISO 17025 scope of accreditation.  
 Statements of conformity to specifications are based on the simple acceptance decision rule (JCGM 106:2012)