




# OIL ANALYSIS REPORT

Sample Rating Trend

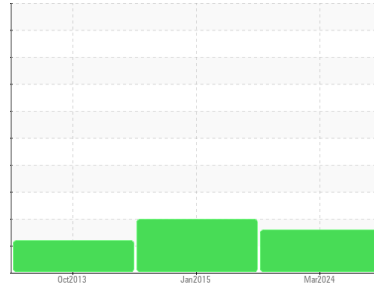

Machine Id  
**KAESER ASD 30 3125208 (S/N 1374)**

Component  
**Compressor**  
Fluid  
**KAESER SIGMA (OEM) M-460 (--- GAL)**

## DIAGNOSIS

### ▲ Recommendation

Oil and filter change at the time of sampling has been noted. Resample at the next service interval to monitor.

### Wear

All component wear rates are normal.

### ▲ Contamination

There is a high amount of particulates present in the oil.

### Fluid Condition

The AN level is acceptable for this fluid. The condition of the oil is suitable for further service.

## SAMPLE INFORMATION

	method	limit/base	current	history1	history2
Sample Number	Client Info		<b>KCPA015538</b>	KCP40492	KCP29808
Sample Date	Client Info		<b>08 Mar 2024</b>	27 Jan 2015	04 Oct 2013
Machine Age	hrs	Client Info	<b>22266</b>	17993	17389
Oil Age	hrs	Client Info	<b>151</b>	1518	914
Oil Changed	Client Info		<b>Changed</b>	Changed	N/A
Sample Status			<b>ABNORMAL</b>	ABNORMAL	MARGINAL

## WEAR METALS

	method	limit/base	current	history1	history2
Iron	ppm	ASTM D5185m >50	<b>0</b>	2	1
Chromium	ppm	ASTM D5185m >10	<b>0</b>	0	0
Nickel	ppm	ASTM D5185m >3	<b>0</b>	0	0
Titanium	ppm	ASTM D5185m >3	<b>0</b>	0	0
Silver	ppm	ASTM D5185m >2	<b>0</b>	0	0
Aluminum	ppm	ASTM D5185m >10	<b>0</b>	<1	<1
Lead	ppm	ASTM D5185m >10	<b>0</b>	0	<1
Copper	ppm	ASTM D5185m >50	<b>5</b>	5	3
Tin	ppm	ASTM D5185m >10	<b>&lt;1</b>	0	0
Antimony	ppm	ASTM D5185m	<b>---</b>	0	0
Vanadium	ppm	ASTM D5185m	<b>0</b>	0	0
Cadmium	ppm	ASTM D5185m	<b>0</b>	0	0

## ADDITIVES

	method	limit/base	current	history1	history2
Boron	ppm	ASTM D5185m 0	<b>0</b>	<1	<1
Barium	ppm	ASTM D5185m 90	<b>21</b>	0	0
Molybdenum	ppm	ASTM D5185m 0	<b>0</b>	<1	0
Manganese	ppm	ASTM D5185m	<b>1</b>	<1	<1
Magnesium	ppm	ASTM D5185m 100	<b>70</b>	26	52
Calcium	ppm	ASTM D5185m 0	<b>1</b>	0	0
Phosphorus	ppm	ASTM D5185m 0	<b>0</b>	0	0
Zinc	ppm	ASTM D5185m 0	<b>8</b>	30	11
Sulfur	ppm	ASTM D5185m 23500	<b>22037</b>	20197	19439

## CONTAMINANTS

	method	limit/base	current	history1	history2
Silicon	ppm	ASTM D5185m >25	<b>0</b>	<1	<1
Sodium	ppm	ASTM D5185m	<b>18</b>	8	12
Potassium	ppm	ASTM D5185m >20	<b>2</b>	0	5
Water	%	ASTM D6304 >0.05	<b>0.010</b>	0.034	0.029
ppm Water	ppm	ASTM D6304 >500	<b>105</b>	340	290






## FLUID CLEANLINESS

	method	limit/base	current	history1	history2
Particles >4µm	ASTM D7647		<b>20002</b>	6731	1653
Particles >6µm	ASTM D7647	>1300	▲ <b>5171</b>	▲ 3666	900
Particles >14µm	ASTM D7647	>80	▲ <b>200</b>	▲ 624	▲ 153
Particles >21µm	ASTM D7647	>20	▲ <b>46</b>	▲ 210	▲ 51
Particles >38µm	ASTM D7647	>4	<b>2</b>	▲ 32	▲ 7
Particles >71µm	ASTM D7647	>3	<b>0</b>	▲ 3	0
Oil Cleanliness	ISO 4406 (c)	>--/17/13	▲ <b>22/20/15</b>	▲ 19/16	▲ 17/14

## FLUID DEGRADATION

	method	limit/base	current	history1	history2
Acid Number (AN)	mg KOH/g	ASTM D8045 1.0	<b>0.43</b>	0.444	0.294

# OIL ANALYSIS REPORT

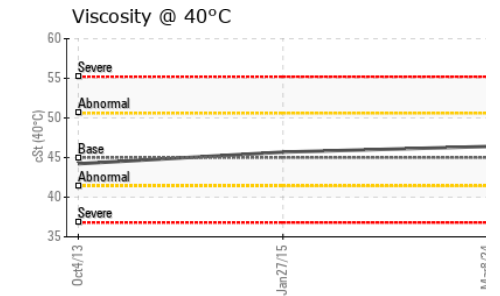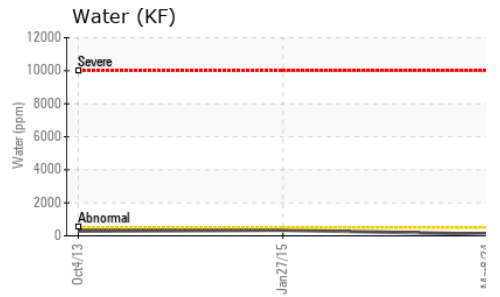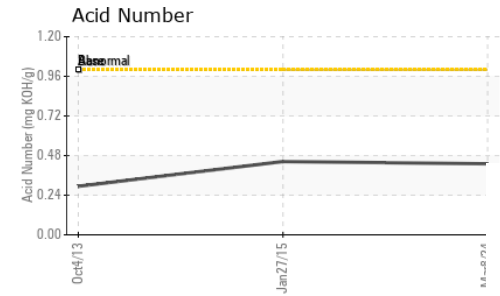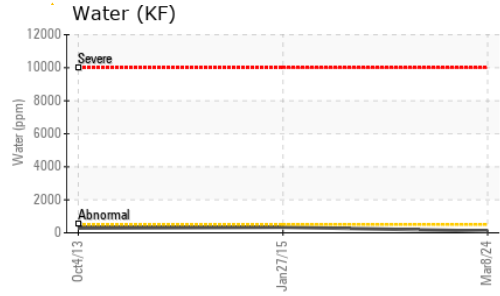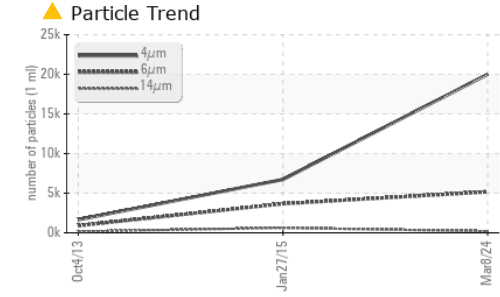






VISUAL	method	limit/base	current	history1	history2
White Metal	scalar	*Visual	NONE	NONE	LIGHT
Yellow Metal	scalar	*Visual	NONE	NONE	NONE
Precipitate	scalar	*Visual	NONE	NONE	NONE
Silt	scalar	*Visual	NONE	NONE	NONE
Debris	scalar	*Visual	NONE	LIGHT	NONE
Sand/Dirt	scalar	*Visual	NONE	NONE	NONE
Appearance	scalar	*Visual	NORML	NORML	NORML
Odor	scalar	*Visual	NORML	NORML	NORML
Emulsified Water	scalar	*Visual	>0.05	NEG	NEG
Free Water	scalar	*Visual		NEG	NEG

FLUID PROPERTIES	method	limit/base	current	history1	history2
Visc @ 40°C	cSt	ASTM D445	45	46.4	45.69

SAMPLE IMAGES	method	limit/base	current	history1	history2
---------------	--------	------------	---------	----------	----------

Color		no image	no image
Bottom		no image	no image

## GRAPHS

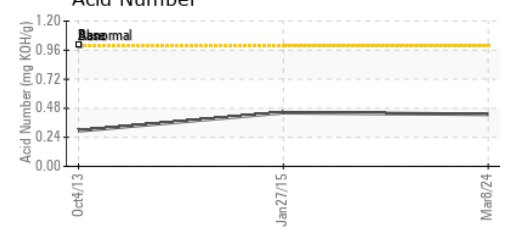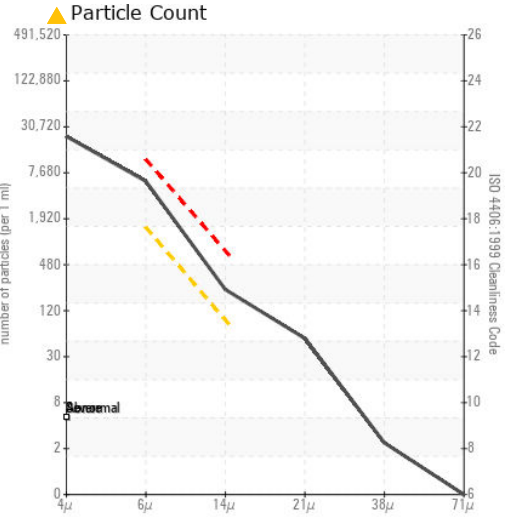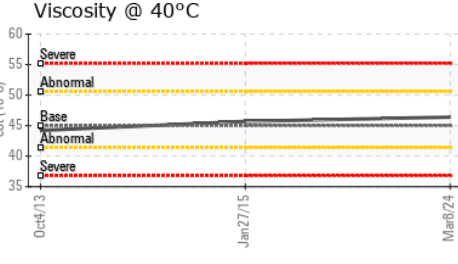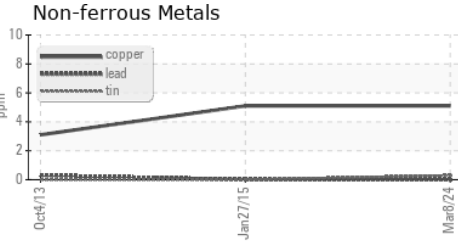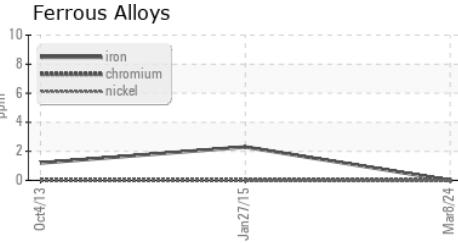

**Laboratory** : WearCheck USA - 501 Madison Ave., Cary, NC 27513  
**Sample No.** : KCPA015538  
**Lab Number** : 06123649  
**Unique Number** : 10937800  
**Test Package** : IND 2 ( Additional Tests: KF, PrtCount )

**MONARCH METALS**  
 2597 W 64TH AVE  
 DENVER, CO  
 US 80221  
 Contact:

To discuss this sample report, contact Customer Service at 1-800-237-1369.  
 \* - Denotes test methods that are outside of the ISO 17025 scope of accreditation.  
 Statements of conformity to specifications are based on the simple acceptance decision rule (JCGM 106:2012)

T:  
F: