




OIL ANALYSIS REPORT

Sample Rating Trend

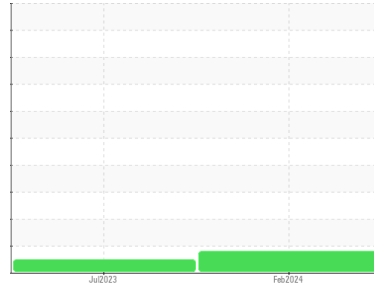

WEAR



Machine Id
KAESER DSD 150 8522309 (S/N 1491)

Component
Compressor

Fluid
KAESER SIGMA (OEM) FG-460 (--- QTS)

DIAGNOSIS

Recommendation

Oil and filter change at the time of sampling has been noted. Resample at the next service interval to monitor.

Wear

The aluminum level is abnormal. All other component wear rates are normal.

Contamination

There is no indication of any contamination in the oil. The amount and size of particulates present in the system are acceptable.

Fluid Condition

The AN level is acceptable for this fluid. The condition of the oil is suitable for further service.

SAMPLE INFORMATION		method	limit/base	current	history1	history2
Sample Number	Client Info			KCP36715	KCP55017	---
Sample Date	Client Info			07 Feb 2024	26 Jul 2023	---
Machine Age	hrs	Client Info		6032	3916	---
Oil Age	hrs	Client Info		2116	3916	---
Oil Changed	Client Info			Changed	Changed	---
Sample Status				ABNORMAL	NORMAL	---

WEAR METALS		method	limit/base	current	history1	history2
Iron	ppm	ASTM D5185m	>50	2	0	---
Chromium	ppm	ASTM D5185m	>10	0	0	---
Nickel	ppm	ASTM D5185m	>3	0	<1	---
Titanium	ppm	ASTM D5185m	>3	0	0	---
Silver	ppm	ASTM D5185m	>2	0	<1	---
Aluminum	ppm	ASTM D5185m	>10	▲ 10	2	---
Lead	ppm	ASTM D5185m	>10	0	<1	---
Copper	ppm	ASTM D5185m	>50	1	3	---
Tin	ppm	ASTM D5185m	>10	<1	<1	---
Vanadium	ppm	ASTM D5185m		0	0	---
Cadmium	ppm	ASTM D5185m		0	0	---






ADDITIVES		method	limit/base	current	history1	history2
Boron	ppm	ASTM D5185m		0	0	---
Barium	ppm	ASTM D5185m		2	0	---
Molybdenum	ppm	ASTM D5185m		0	0	---
Manganese	ppm	ASTM D5185m		<1	0	---
Magnesium	ppm	ASTM D5185m		<1	0	---
Calcium	ppm	ASTM D5185m		0	0	---
Phosphorus	ppm	ASTM D5185m	500	223	14	---
Zinc	ppm	ASTM D5185m		208	0	---
Sulfur	ppm	ASTM D5185m		1794	823	---

CONTAMINANTS		method	limit/base	current	history1	history2
Silicon	ppm	ASTM D5185m	>25	0	0	---
Sodium	ppm	ASTM D5185m		2	0	---
Potassium	ppm	ASTM D5185m	>20	<1	<1	---
Water	%	ASTM D6304	>0.05	0.003	0.009	---
ppm Water	ppm	ASTM D6304	>500	27	91.4	---

FLUID CLEANLINESS		method	limit/base	current	history1	history2
Particles >4µm		ASTM D7647		883	1504	---
Particles >6µm		ASTM D7647	>1300	232	355	---
Particles >14µm		ASTM D7647	>80	21	27	---
Particles >21µm		ASTM D7647	>20	5	11	---
Particles >38µm		ASTM D7647	>4	0	0	---
Particles >71µm		ASTM D7647	>3	0	0	---
Oil Cleanliness		ISO 4406 (c)	>--/17/13	17/15/12	18/16/12	---

FLUID DEGRADATION		method	limit/base	current	history1	history2
Acid Number (AN)	mg KOH/g	ASTM D8045	1.5	0.71	0.36	---


OIL ANALYSIS REPORT

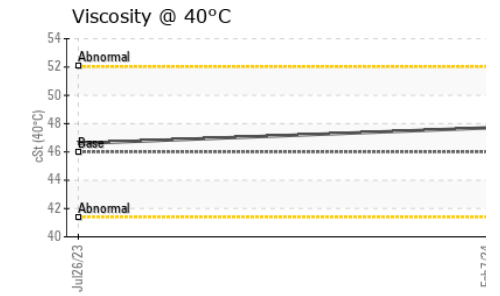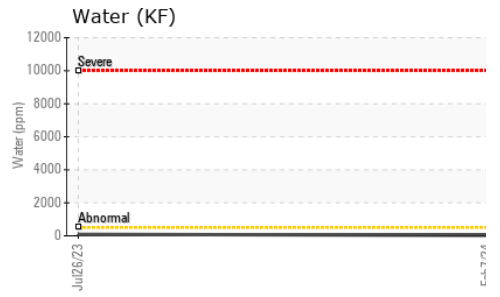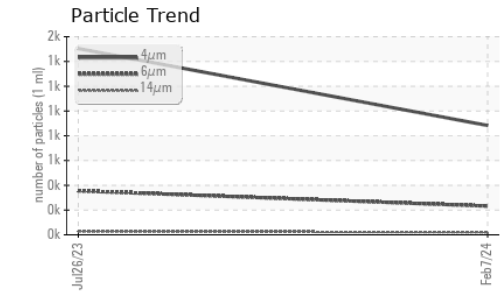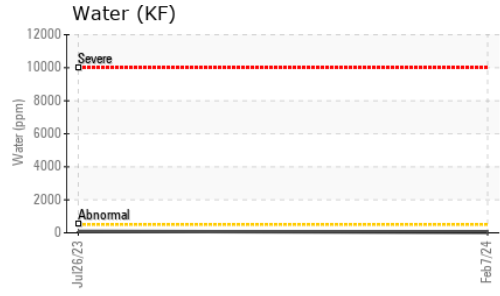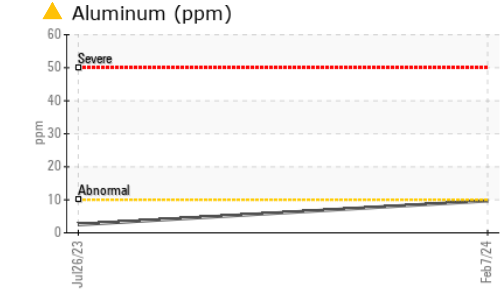






VISUAL	method	limit/base	current	history1	history2	
White Metal	scalar	*Visual	NONE	LIGHT	LIGHT	---
Yellow Metal	scalar	*Visual	NONE	NONE	NONE	---
Precipitate	scalar	*Visual	NONE	NONE	NONE	---
Silt	scalar	*Visual	NONE	NONE	NONE	---
Debris	scalar	*Visual	NONE	NONE	NONE	---
Sand/Dirt	scalar	*Visual	NONE	NONE	NONE	---
Appearance	scalar	*Visual	NORML	NORML	NORML	---
Odor	scalar	*Visual	NORML	NORML	NORML	---
Emulsified Water	scalar	*Visual	>0.05	NEG	NEG	---
Free Water	scalar	*Visual		NEG	NEG	---

FLUID PROPERTIES	method	limit/base	current	history1	history2	
Visc @ 40°C	cSt	ASTM D445	46	47.7	46.6	---

SAMPLE IMAGES	method	limit/base	current	history1	history2
---------------	--------	------------	---------	----------	----------

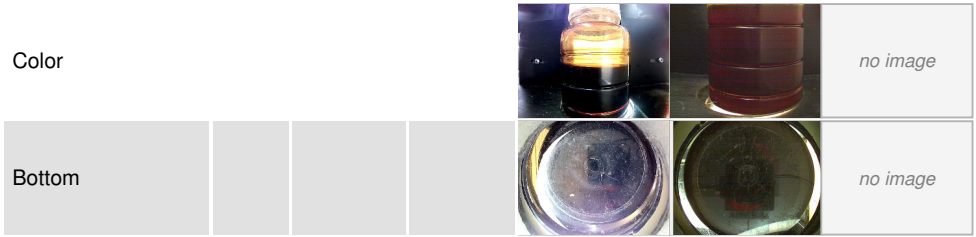

GRAPHS

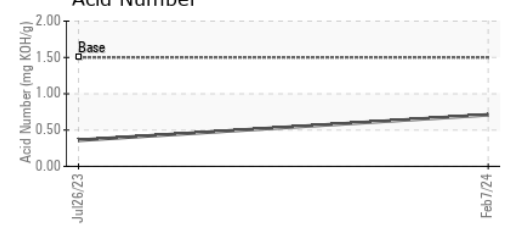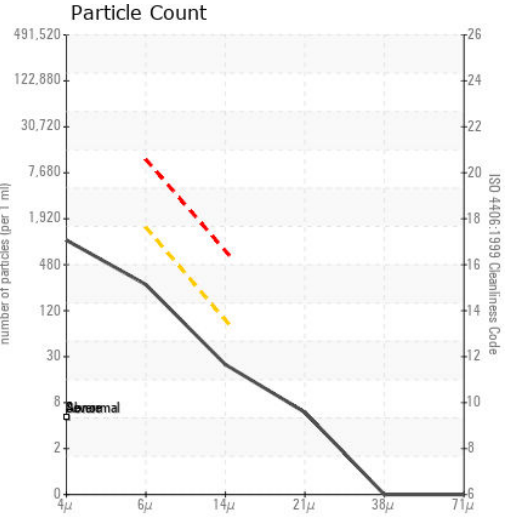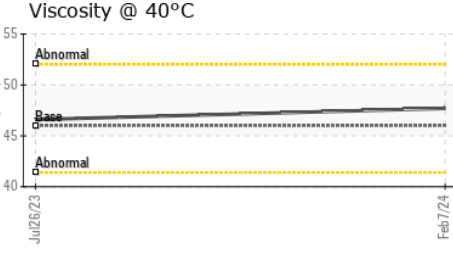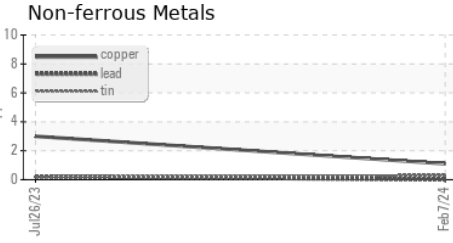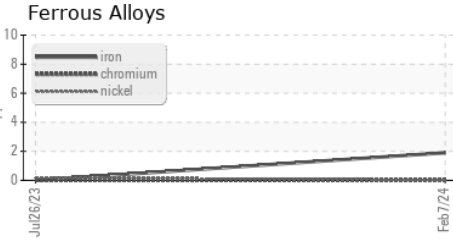

Laboratory : WearCheck USA - 501 Madison Ave., Cary, NC 27513
Sample No. : KCP36715 **Received** : 20 Mar 2024
Lab Number : **06123654** **Tested** : 25 Mar 2024
Unique Number : 10937805 **Diagnosed** : 25 Mar 2024 - Jonathan Hester
Test Package : IND 2 (Additional Tests: KF, PrtCount)

DART CONTAINER
 2120 LITHONIA IND BLVD
 LITHONIA, GA
 US 30058
 Contact: Service Manager
 RAWLE.BLN@DART.BIZ
 T:
 F:

To discuss this sample report, contact Customer Service at 1-800-237-1369.
 * - Denotes test methods that are outside of the ISO 17025 scope of accreditation.
 Statements of conformity to specifications are based on the simple acceptance decision rule (JCGM 106:2012)